


# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# 551-599-WCT-2W-FAN2

Component Gearbox

GEAR OIL ISO 220 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0039529		
Sample Date		Client Info		17 Apr 2024		
Machine Age	mths	Client Info		0		
Oil Age	mths	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	61		
Chromium	ppm	ASTM D5185m	>15	<1		
Nickel	ppm	ASTM D5185m	>15	<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>25	6		
Lead	ppm	ASTM D5185m	>100	<1		
Copper	ppm	ASTM D5185m	>200	<1		
Tin	ppm	ASTM D5185m	>25	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	2		
Barium	ppm	ASTM D5185m	15	0		
Molybdenum	ppm	ASTM D5185m	15	1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	50	7		
Calcium	ppm	ASTM D5185m	50	78		
Phosphorus	ppm	ASTM D5185m	350	49		
Zinc	ppm	ASTM D5185m	100	22		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	5		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.2	0.00		
ppm Water	ppm	ASTM D6304	>2000	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.081		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.2	NEG		
Free Water	scalar	*Visual		NEG	ion: <u>W</u> IKE MAN	GINIOXYPED



## **OIL ANALYSIS REPORT**

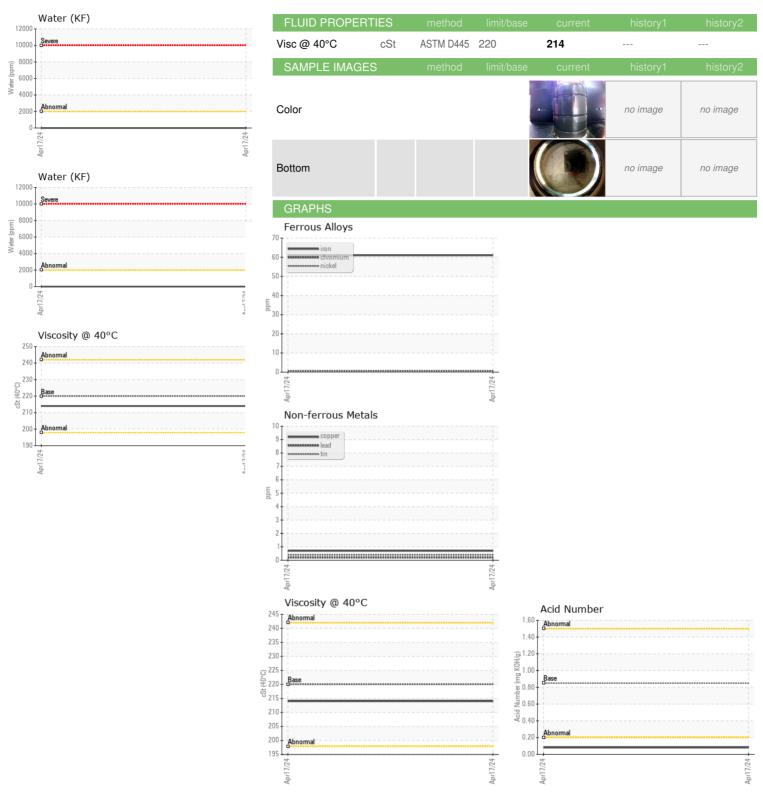



Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : RP0039529 Lab Number : 06154494 Unique Number : 10989917

Test Package : IND 2

Received : 19 Apr 2024 **Tested** : 22 Apr 2024

Diagnosed : 23 Apr 2024 - Don Baldridge

**OXY VINYLS** 76 PORCUPINE RD PEDRICKTOWN, NJ US 08067 Contact: MIKE MANGINI michael\_mangini@oxy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (856)472-1248