




OIL ANALYSIS REPORT

Sample Rating Trend

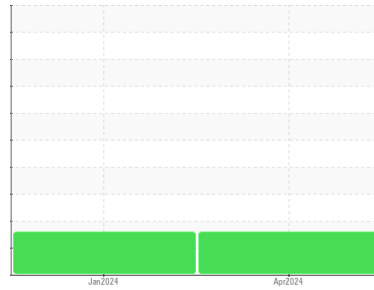

DIRT



Area

DIAMOND BLUE 8K [SVO-60796]

Machine Id
INGERSOLL RAND VN1272U12081 - SPARTAN LIGHT MEXICO

Component

Compressor

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06154516	UCH06065759	---
Sample Date	Client Info		08 Apr 2024	08 Jan 2024	---
Machine Age	hrs	Client Info	76616	74686	---
Oil Age	hrs	Client Info	6895	4965	---
Oil Changed	Client Info		Changed	Not Changd	---
Sample Status			ATTENTION	ATTENTION	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.8	NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m	<1	0	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	<1	0	---
Aluminum	ppm	ASTM D5185m >25	1	0	---
Lead	ppm	ASTM D5185m >25	0	0	---
Copper	ppm	ASTM D5185m >50	15	4	---
Tin	ppm	ASTM D5185m >15	<1	<1	---
Vanadium	ppm	ASTM D5185m	<1	<1	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	0	0	---
Barium	ppm	ASTM D5185m 525	465	568	---
Molybdenum	ppm	ASTM D5185m 10	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 5	3	<1	---
Calcium	ppm	ASTM D5185m 10	9	3	---
Phosphorus	ppm	ASTM D5185m 250	14	15	---
Zinc	ppm	ASTM D5185m 100	17	6	---
Sulfur	ppm	ASTM D5185m 400	312	355	---

CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	59	38	---
Sodium	ppm	ASTM D5185m	47	40	---
Potassium	ppm	ASTM D5185m >20	7	3	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.43	0.27	---




OIL ANALYSIS REPORT

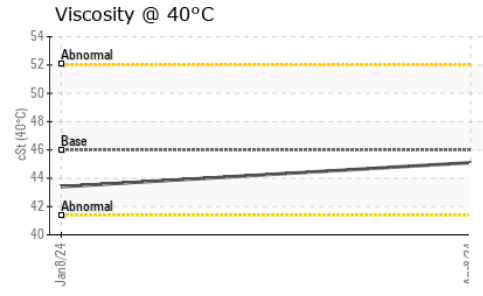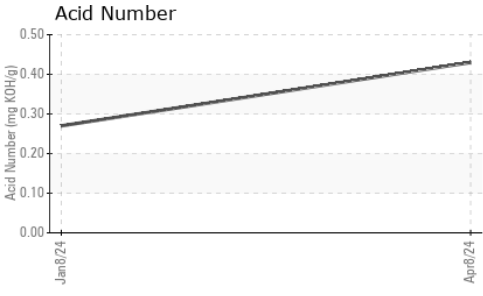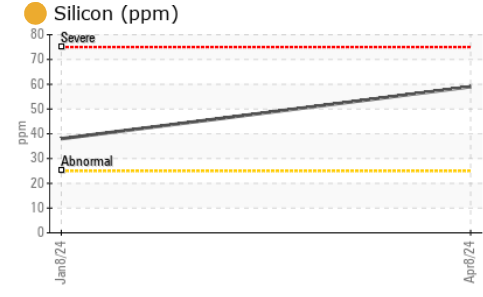





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.8	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.1	43.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

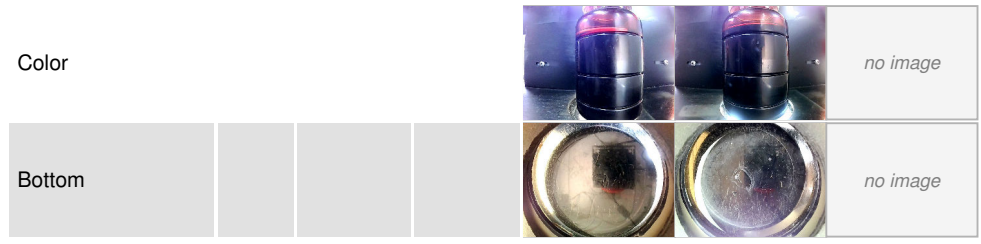

GRAPHS

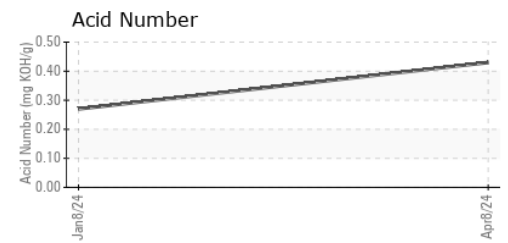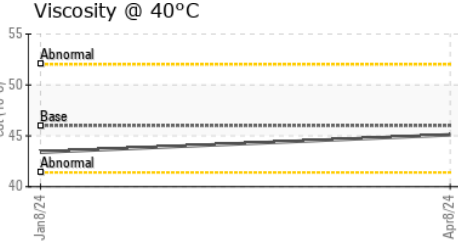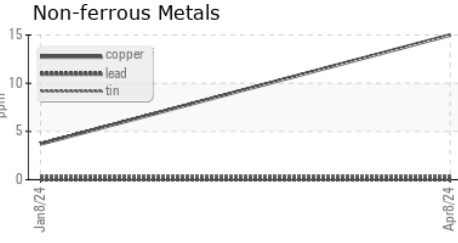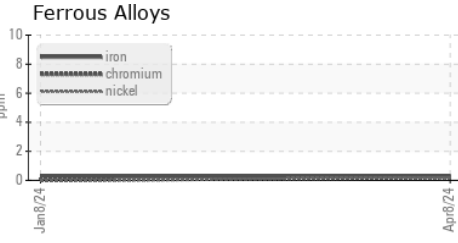

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06154516 **Received** : 19 Apr 2024
Lab Number : 06154516 **Tested** : 22 Apr 2024
Unique Number : 10989939 **Diagnosed** : 23 Apr 2024 - Sean Felton
Test Package : IND 2

JOHN HENRY FOSTER COMPANY
 4700 LEBOURGET STREET
 SAINT LOUIS, MO
 US 63134
 Contact: RACHEL VON HATTEN
 rvonhatten@jhf.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)