

## **OIL ANALYSIS REPORT**

# LFC-1030-CM-01-CM031 [1958019] PH01AG21-1030 - PREHEAT TANK 1 AGITATOR

Gearbox Fluid

{not provided} (3 GAL)

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend





#### SAMPLE INFORMATION method WC0897654 WC0851584 WC0851587 Sample Number **Client Info** 20 Oct 2023 20 Oct 2023 Sample Date Client Info 15 Apr 2024 0 0 0 Machine Age days **Client Info** Oil Age davs Client Info 0 0 0 Oil Changed **Client Info** N/A N/A N/A NORMAL ABNORMAL Sample Status NORMAL CONTAMINATION Water WC Method >0.2 NEG NEG NEG WEAR METALS Iron ppm ASTM D5185m >200 135 131 70 Chromium ASTM D5185m >15 1 ppm <1 <1 Nickel <1 0 0 ppm ASTM D5185m >15 Titanium ASTM D5185m <1 0 0 ppm ASTM D5185m 0 Silver <1 0 ppm Aluminum ppm ASTM D5185m >25 2 <1 0 Lead ASTM D5185m >100 0 0 <1 ppm Copper >200 <1 ppm ASTM D5185m 1 1 0 Tin ASTM D5185m >25 <1 0 ppm Vanadium 0 0 ppm ASTM D5185m <1 0 0 Cadmium ppm ASTM D5185m <1 ASTM D5185m 0 0 Boron ppm <1 0 Barium ppm ASTM D5185m 0 0 Molvbdenum ppm ASTM D5185m <1 0 0 Manganese ASTM D5185m <1 <1 ppm <1 0 Magnesium ASTM D5185m 1 0 ppm 7 0 Calcium ASTM D5185m ppm 11 Phosphorus ASTM D5185m 321 314 183 ppm Zinc ppm ASTM D5185m 56 66 12 Sulfur ASTM D5185m 4033 3834 1749 ppm 7 Silicon ppm ASTM D5185m >50 14 11 Sodium ppm ASTM D5185m 1 0 0 2 Potassium ASTM D5185m >20 0 0 ppm FLUID DEGRADATION

1 LOID DEGITION					
Acid Number (AN)	mg KOH/g	ASTM D8045	0.64	0.63	0.49




# **OIL ANALYSIS REPORT**





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	🔺 MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		217	217	220
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						
Bottom					$\bigcirc$	

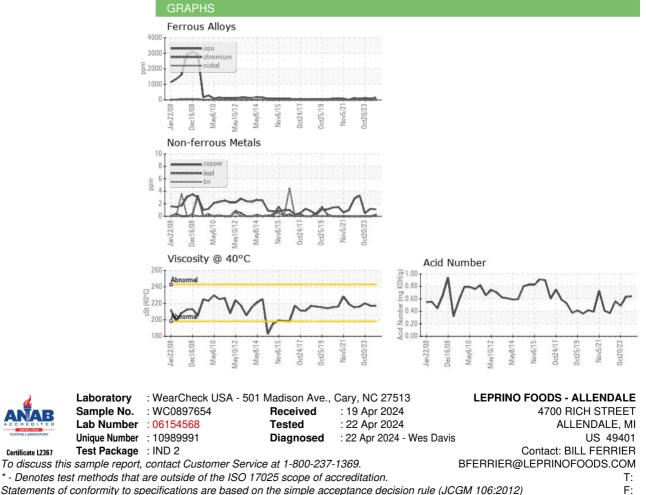

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: BILL FERRIER - LEPALL Page 2 of 2