




OIL ANALYSIS REPORT



Machine Id
JENBACHER GM03 (S/N 1144776)
 Component
Biogas Engine
 Fluid
MAHLER Q8 Mahler G8 SAE 40 (--- GAL)

Sample Rating Trend

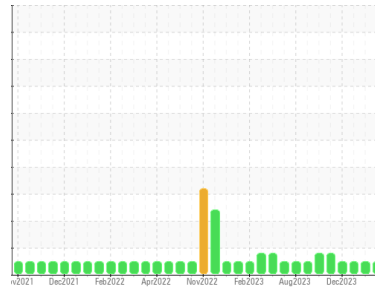

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0914241	WC0914252	WC0853018
Sample Date	Client Info			16 Apr 2024	21 Mar 2024	28 Feb 2024
Machine Age	hrs	Client Info		49826	49543	49318
Oil Age	hrs	Client Info		3198	2915	2690
Oil Changed	Client Info			Not Changed	Not Changed	Not Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>.2		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	10	9	7
Chromium	ppm	ASTM D5185m	>5	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>15	4	5	4
Lead	ppm	ASTM D5185m	>20	1	<1	3
Copper	ppm	ASTM D5185m	>15	1	2	2
Tin	ppm	ASTM D5185m	>5	8	8	7
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	3	3
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		2	2	<1
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		14	16	16
Calcium	ppm	ASTM D5185m		2574	2575	2433
Phosphorus	ppm	ASTM D5185m		442	462	464
Zinc	ppm	ASTM D5185m		478	550	557
Sulfur	ppm	ASTM D5185m		2934	3100	2725

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	56	56	50
Sodium	ppm	ASTM D5185m	>20	2	2	2
Potassium	ppm	ASTM D5185m	>20	0	3	0


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>2	0.1	0	0
Nitration	Abs/cm	*ASTM D7624	>20	7.9	7.9	7.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.7	19.3	18.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.4	15.9	15.0
Acid Number (AN)	mg KOH/g	ASTM D8045		1.77	1.72	1.64
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	6.30	3.90	6.67



OIL ANALYSIS REPORT

FT-IR (Direct Trend)

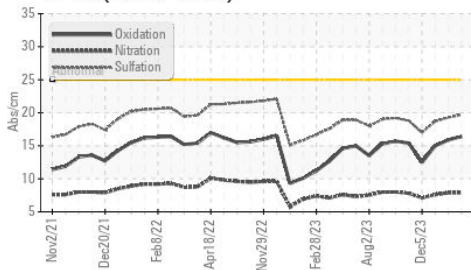


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	14.1	14.2

GRAPHS


Acid Number

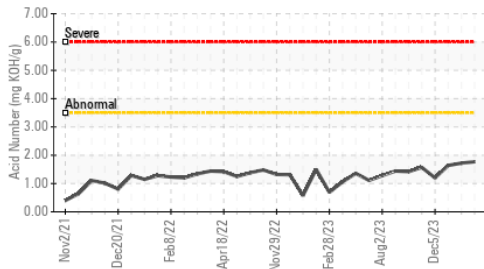


Base Number

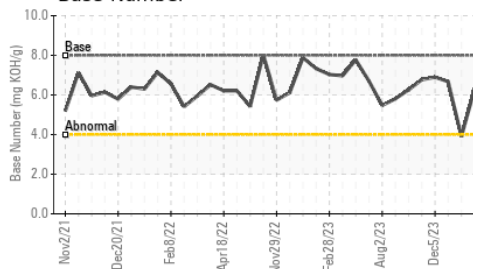


Viscosity @ 100°C

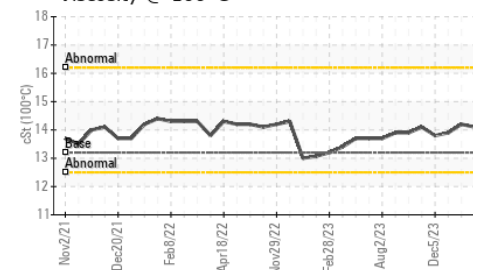


Iron (ppm)

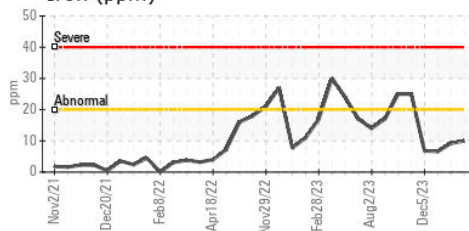


Aluminum (ppm)

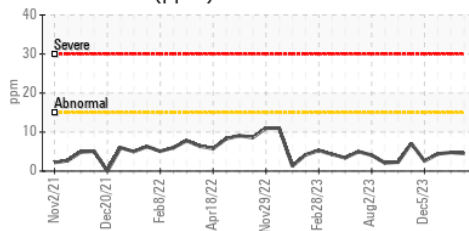


Copper (ppm)

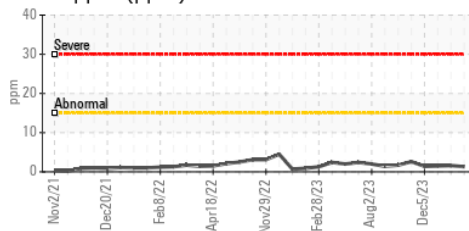


Viscosity @ 100°C

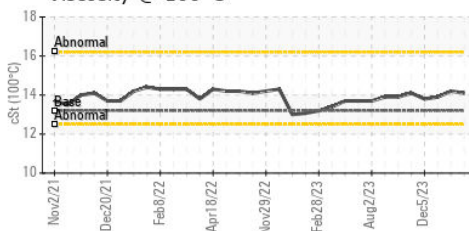


Lead (ppm)

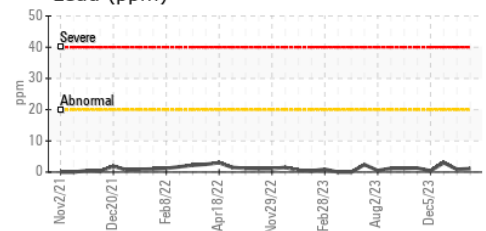


Chromium (ppm)

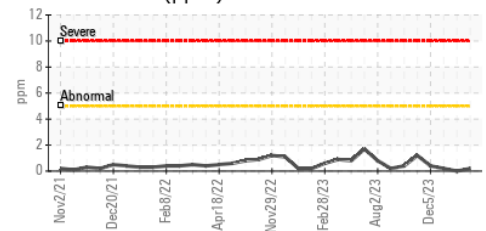

Silicon (ppm)

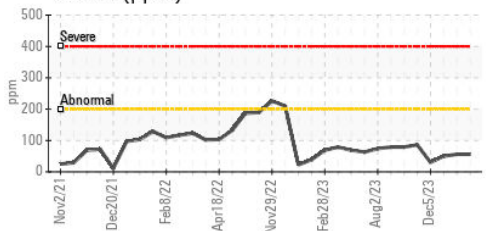

Base Number

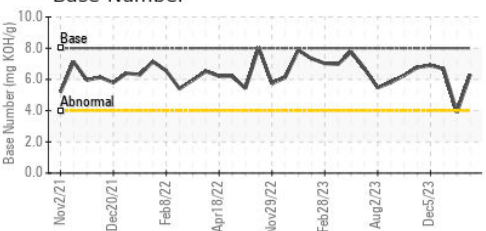

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0914241

Lab Number : 06154643

Unique Number : 10990066

Test Package : MOB 2

Received : 19 Apr 2024

Tested : 23 Apr 2024

Diagnosed : 23 Apr 2024 - Sean Felton

RICHLAND CREEK

5691 S RICHLAND CREEK RD

BUFORD, GA

US 30518

Contact: MATT DICKENS

matt.dickens@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)