




# OIL ANALYSIS REPORT

Sample Rating Trend

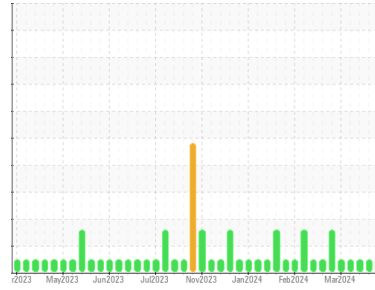

**NORMAL**



Machine Id

**LGS00181**

Component

**Middle Biogas Engine**

Fluid

**CITGO PACEMAKER GAS ENGINE LFG LA 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>WC0803407</b>	WC0803406	WC0803405	
Sample Date	Client Info	<b>15 Apr 2024</b>	08 Apr 2024	01 Apr 2024	
Machine Age	hrs	Client Info	<b>66882</b>	66712	66547
Oil Age	hrs	Client Info	<b>287</b>	116	327
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >45	<b>6</b>	2	6
Chromium	ppm ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm ASTM D5185m >2	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>1</b>	2	2
Lead	ppm ASTM D5185m >5	<b>&lt;1</b>	0	1
Copper	ppm ASTM D5185m >14	<b>1</b>	2	1
Tin	ppm ASTM D5185m >13	<b>3</b>	2	4
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	<1	<1
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>2</b>	1	<1
Manganese	ppm ASTM D5185m	<b>0</b>	1	<1
Magnesium	ppm ASTM D5185m	<b>29</b>	15	10
Calcium	ppm ASTM D5185m	<b>1462</b>	1469	1403
Phosphorus	ppm ASTM D5185m	<b>284</b>	302	287
Zinc	ppm ASTM D5185m	<b>312</b>	360	346
Sulfur	ppm ASTM D5185m	<b>3191</b>	3294	3471

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >200	<b>181</b>	91	197
Sodium	ppm ASTM D5185m	<b>1</b>	2	7
Potassium	ppm ASTM D5185m >20	<b>0</b>	2	7

## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm *ASTM D7624 >20	<b>3.3</b>	3.2	3.4
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>16.8</b>	15.6	17.0


## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>7.2</b>	6.9	7.4
Acid Number (AN)	mg KOH/g ASTM D8045 1.16	<b>0.87</b>	0.75	0.85
Base Number (BN)	mg KOH/g ASTM D2896 5	<b>3.03</b>	3.47	2.90




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

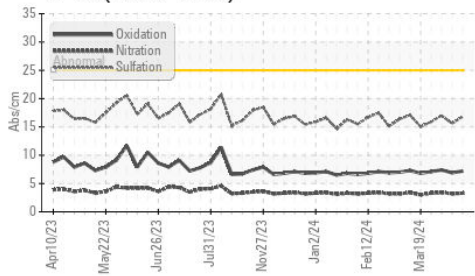


Acid Number

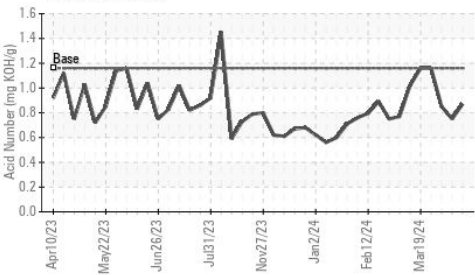

Base Number

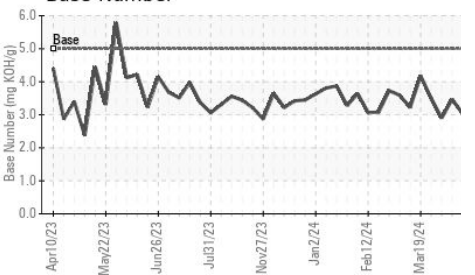









Viscosity @ 100°C

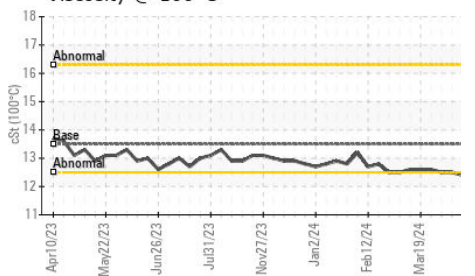

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.5	12.4	12.5

### GRAPHS

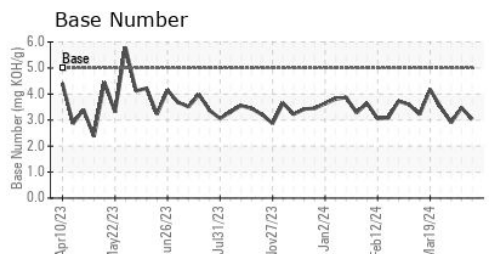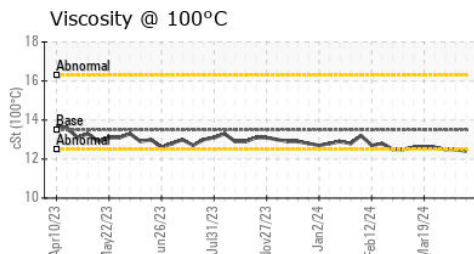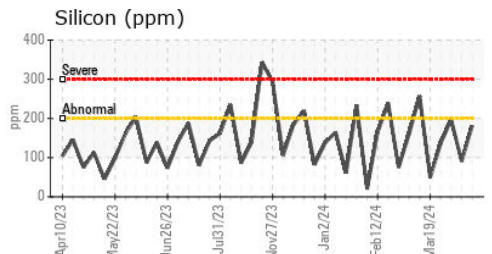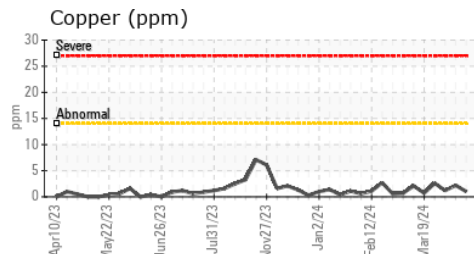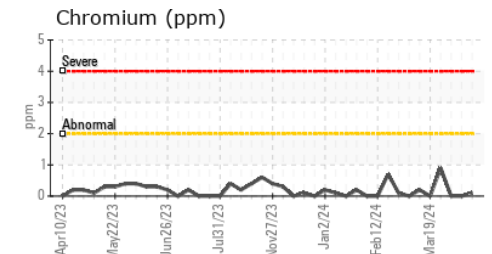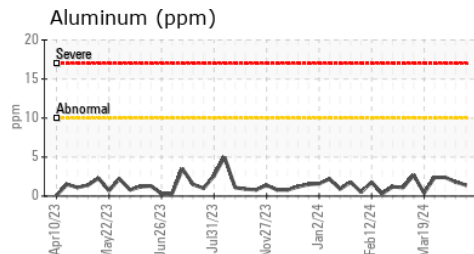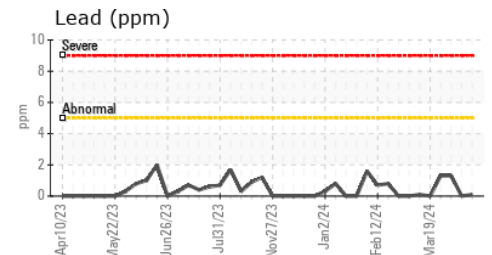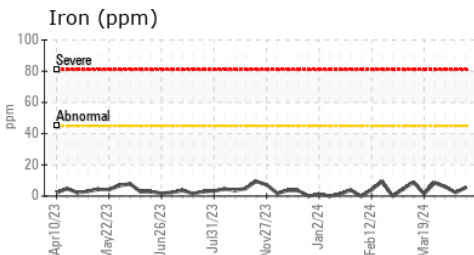

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0803407 **Received** : 19 Apr 2024  
**Lab Number** : 06154650 **Tested** : 23 Apr 2024  
**Unique Number** : 10990073 **Diagnosed** : 23 Apr 2024 - Sean Felton  
**Test Package** : MOB 2

**BLACK OAK**  
 5054 HWY HH  
 HARTVILLE, MO  
 US 65667  
 Contact: CHIP MATHEWS  
 chip.matthews@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)