




OIL ANALYSIS REPORT

Sample Rating Trend

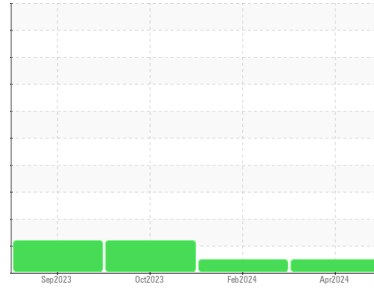

NORMAL



Machine Id
YVONNE S

Component
Port Genset

Fluid
CHEVRON DELO 400 MULTIGRADE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0759609	WC0759612	WC0759655
Sample Date	Client Info			01 Apr 2024	23 Feb 2024	26 Oct 2023
Machine Age	hrs	Client Info		2736	2308	785
Oil Age	hrs	Client Info		500	500	0
Oil Changed	Client Info			Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	10	18
Chromium	ppm	ASTM D5185m	>4	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	<1	<1	0
Titanium	ppm	ASTM D5185m		7	3	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	2	3	2
Lead	ppm	ASTM D5185m	>17	<1	<1	0
Copper	ppm	ASTM D5185m	>70	10	41	▲ 464
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	151	206	232	111
Barium	ppm	ASTM D5185m	0.4	0	0	4
Molybdenum	ppm	ASTM D5185m	250	79	89	42
Manganese	ppm	ASTM D5185m		<1	<1	3
Magnesium	ppm	ASTM D5185m	0	578	453	209
Calcium	ppm	ASTM D5185m	2046	1906	2051	2391
Phosphorus	ppm	ASTM D5185m	1043	825	733	884
Zinc	ppm	ASTM D5185m	943	922	921	1062
Sulfur	ppm	ASTM D5185m	5012	3300	2769	2504




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8	10	12
Sodium	ppm	ASTM D5185m		<1	2	3
Potassium	ppm	ASTM D5185m	>20	3	2	<1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	9.0	9.4	9.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.3	21.7	20.5

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.6	17.3	18.0
Base Number (BN)	mg KOH/g	ASTM D2896	12.5	7.1	6.6	6.8







OIL ANALYSIS REPORT

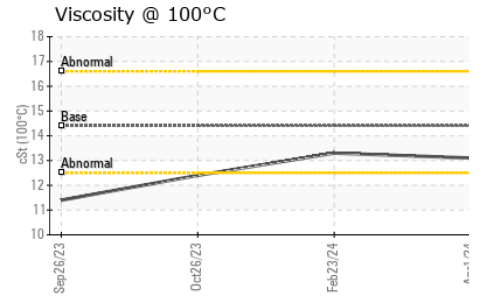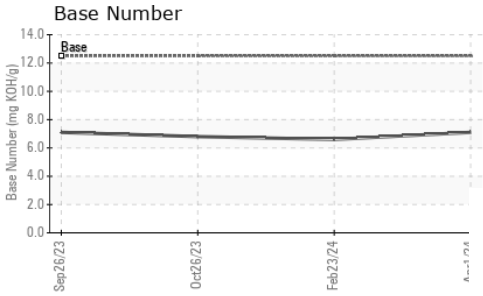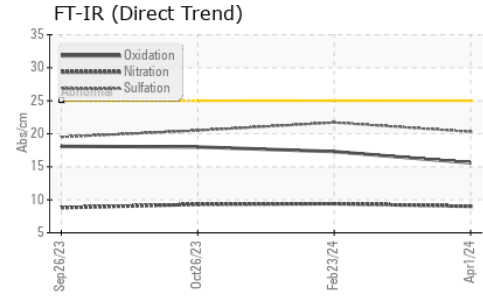

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.1	13.3

GRAPHS

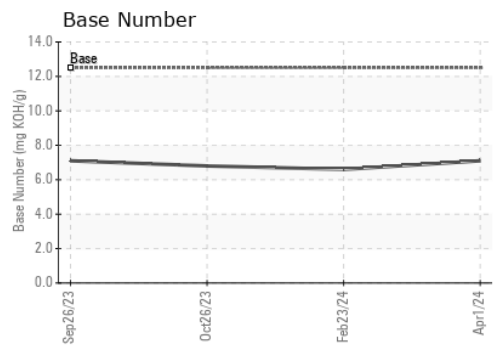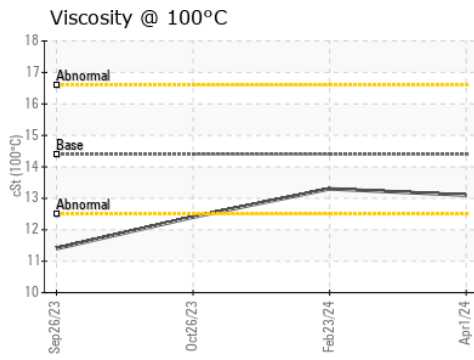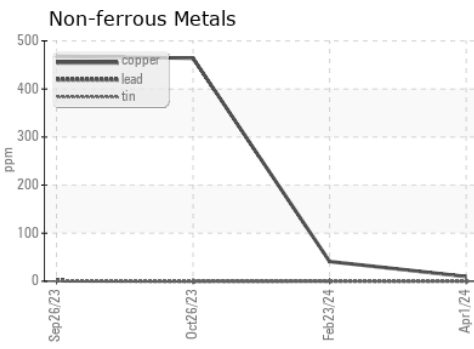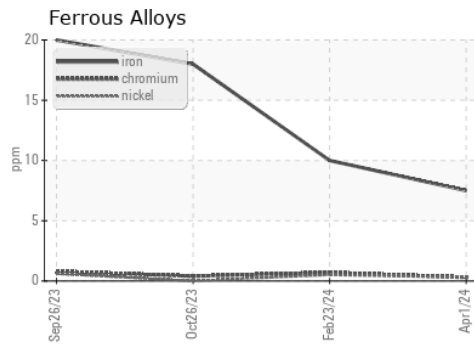

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0759609 **Received** : 19 Apr 2024
Lab Number : **06155140** **Tested** : 22 Apr 2024
Unique Number : 10990563 **Diagnosed** : 22 Apr 2024 - Wes Davis
Test Package : FLEET

ASSOCIATED TERMINALS - CRANE
 CONVENT, LA
 US 70723
 Contact: GREG JOSEY
 gjosey@associatedterminals.com
 T:
 F: (225)562-3515

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)