




# OIL ANALYSIS REPORT

Sample Rating Trend

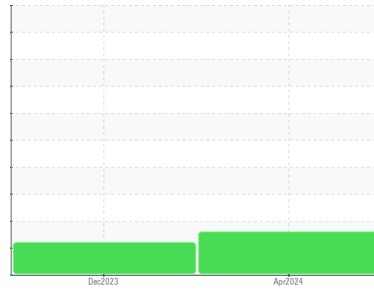

ISO



Machine Id

**KAESER AS 30 9072449 (S/N 2251)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC121924</b>	KC125348	---
Sample Date	Client Info		<b>12 Apr 2024</b>	28 Dec 2023	---
Machine Age	hrs	Client Info	<b>3378</b>	2064	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>ABNORMAL</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>7</b>	12	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 90	<b>17</b>	2	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Zinc	ppm	ASTM D5185m	<b>7</b>	0	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>2</b>	3	---
Potassium	ppm	ASTM D5185m >20	<b>3</b>	2	---
Water	%	ASTM D6304 >0.05	<b>0.010</b>	0.005	---
ppm Water	ppm	ASTM D6304 >500	<b>102</b>	55	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>11026</b>	3227	---
Particles >6µm	ASTM D7647	>1300	<b>▲ 2919</b>	1221	---
Particles >14µm	ASTM D7647	>80	<b>▲ 241</b>	● 140	---
Particles >21µm	ASTM D7647	>20	<b>▲ 62</b>	● 35	---
Particles >38µm	ASTM D7647	>4	<b>2</b>	0	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>▲ 21/19/15</b>	● 19/17/14	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.37</b>	0.28	---


# OIL ANALYSIS REPORT

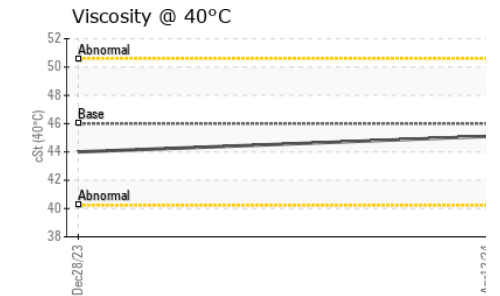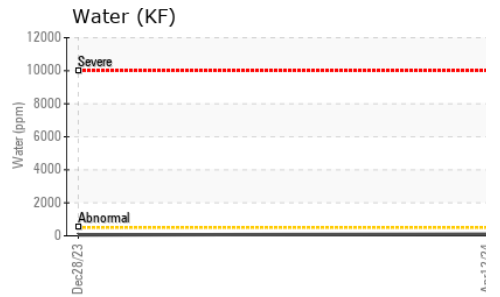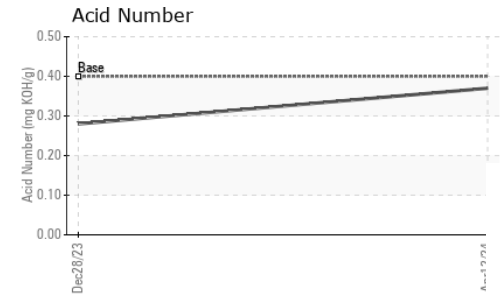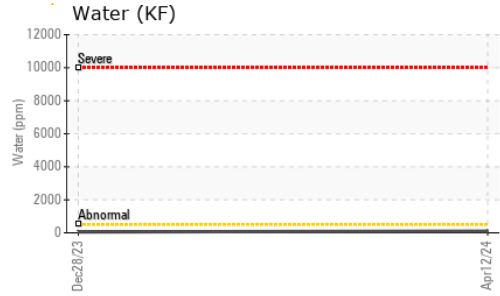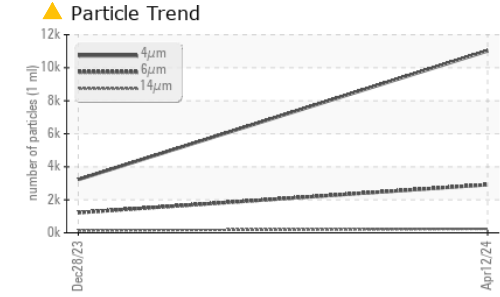





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.1	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

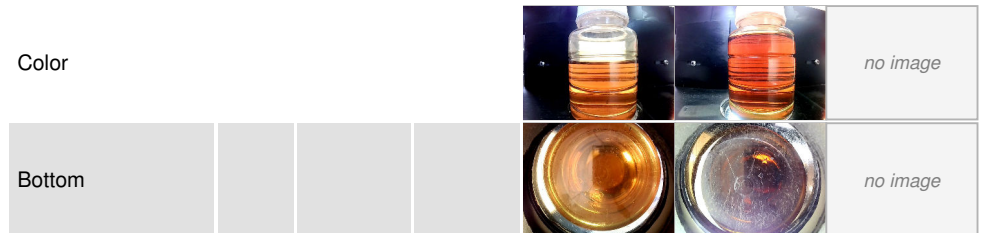

## GRAPHS

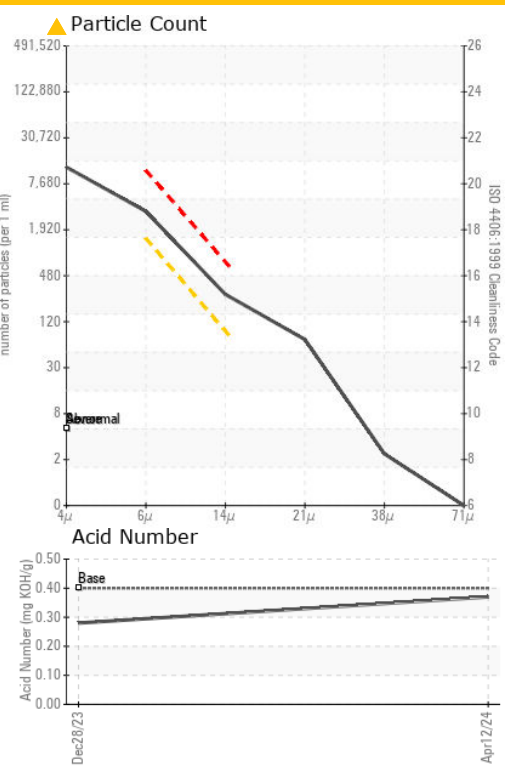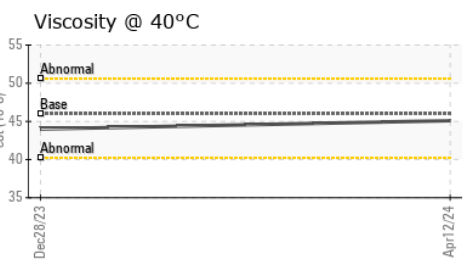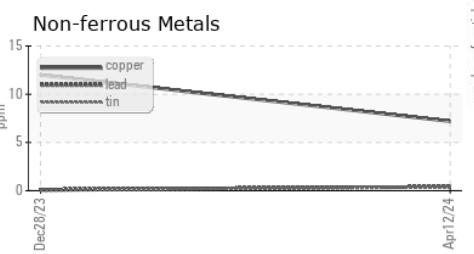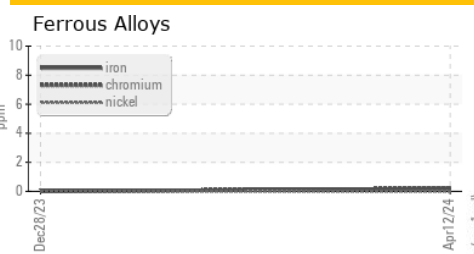

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121924  
**Lab Number** : 06155197  
**Unique Number** : 10990620  
**Test Package** : IND 2  
**Received** : 19 Apr 2024  
**Tested** : 24 Apr 2024  
**Diagnosed** : 24 Apr 2024 - Jonathan Hester

**JP LAMBORN**  
 625 MCCUE RD  
 LAKELAND, FL  
 US 33815  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)