


OIL ANALYSIS REPORT

Sample Rating Trend

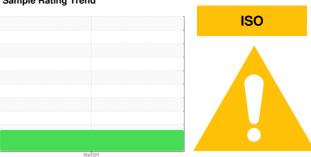

Machine Id

KAESER 8919353

Component Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2024		
				Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC123219		
Sample Date		Client Info		29 Mar 2024		
Machine Age	hrs	Client Info		3143		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		2		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m	500	85		
Zinc	ppm	ASTM D5185m		79		
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m		2		
Water	%	ASTM D6304	>0.05	0.002		
ppm Water	ppm	ASTM D6304	>500	25		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		17175		
Particles >6µm		ASTM D7647	>1300	4494		
Particles >14μm		ASTM D7647	>80	<u>^</u> 293		
Particles >21μm		ASTM D7647	>20	<u>▲</u> 68		
Particles >38μm		ASTM D7647	>4	2		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/19/15</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.33		



OIL ANALYSIS REPORT

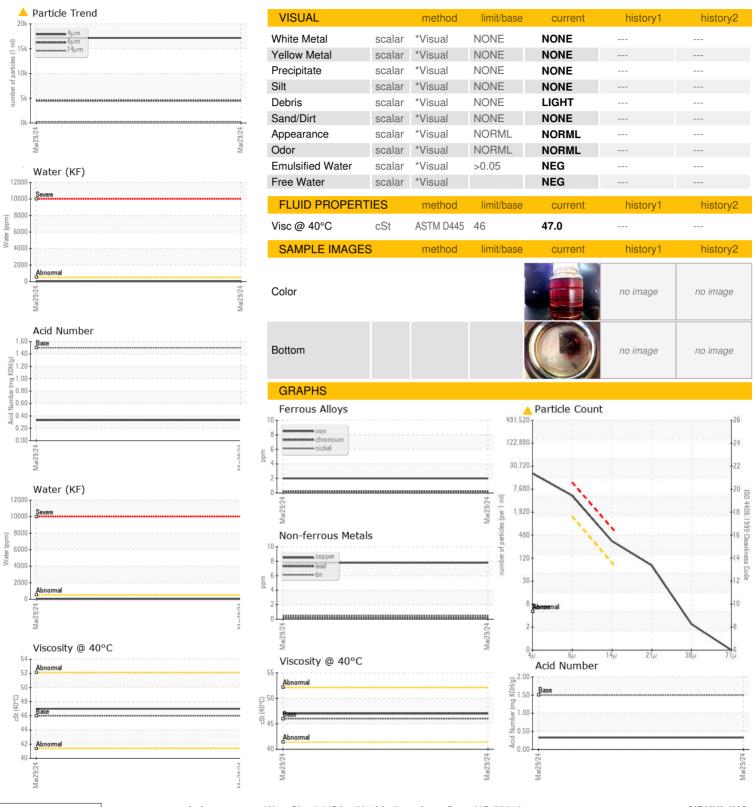





Certificate 12367

Laboratory Sample No.

: KC123219 Lab Number : 06155201 Unique Number : 10990624 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Apr 2024 Tested : 24 Apr 2024

Diagnosed : 24 Apr 2024 - Jonathan Hester

CIRKUL INC 4456 EAGLE FALLS PL TAMPA, FL US 33619

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: CIRTAM [WUSCAR] 06155201 (Generated: 04/24/2024 10:24:14) Rev: 1

Contact/Location: Service Manager - CIRTAM

T:

F: