


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

9054966 (S/N 2141)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2024	Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC123244	KC123262	
Sample Date		Client Info		01 Apr 2024	17 Jan 2024	
Machine Age	hrs	Client Info		1970	918	
Oil Age	hrs	Client Info		0	0	
Oil Changed	0	Client Info		N/A	N/A	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	6	3	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	7	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	31	57	
Calcium	ppm	ASTM D5185m	2	0	1	
Phosphorus	ppm	ASTM D5185m	_	<1	<1	
Zinc	ppm	ASTM D5185m		19	6	
CONTAMINANTS			limit/base			history2
		method		current	history1	
Silicon	ppm	ASTM D5185m	>25	<1	1	
Sodium	ppm	ASTM D5185m		6	12	
Potassium	ppm	ASTM D5185m	>20	7	13	
Water	%	ASTM D6304	>0.05	0.020	0.027	
ppm Water	ppm	ASTM D6304	>500	206	273	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4335	30154	
Particles >6µm		ASTM D7647	>1300	394	<u>▲</u> 15067	
Particles >14μm		ASTM D7647	>80	14	<u>▲</u> 518	
Particles >21µm		ASTM D7647	>20	3	<u></u> 41	
Particles >38μm		ASTM D7647	>4	0	1	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16/11	<u>22/21/16</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.32

0.35



OIL ANALYSIS REPORT

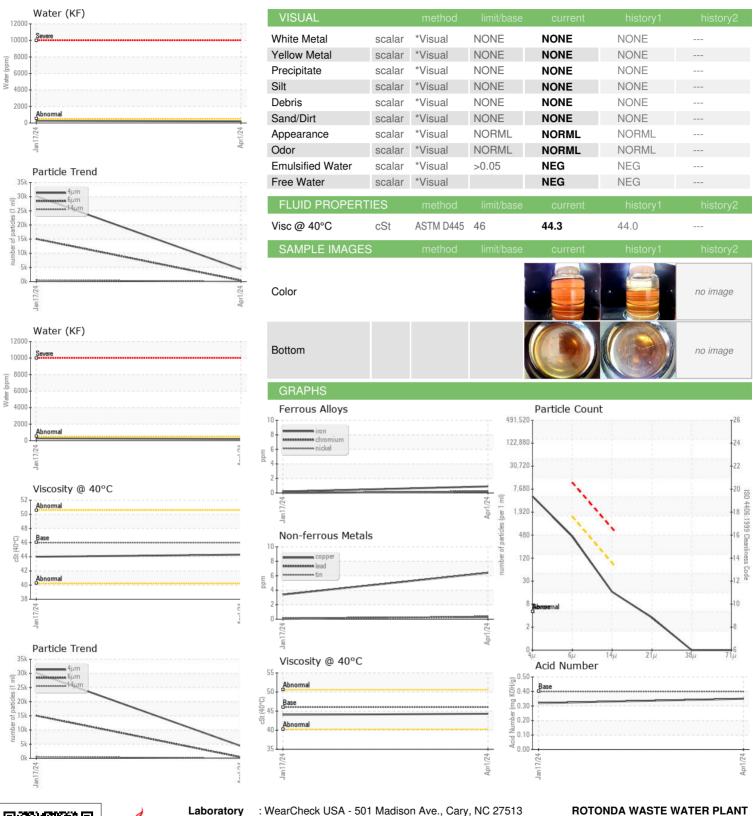





Certificate 12367

Laboratory Sample No. Lab Number : 06155203 Unique Number : 10990626

: KC123244 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Apr 2024 **Tested** : 24 Apr 2024

Diagnosed : 24 Apr 2024 - Jonathan Hester

CAPE HAZE, FL US 33946

Contact: Service Manager

3740 KENDALL RD

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: ROTCAP [WUSCAR] 06155203 (Generated: 04/24/2024 10:26:59) Rev: 1

Contact/Location: Service Manager - ROTCAP

T:

F: