

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 8641320

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Mar2024		
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC123233		
Sample Date		Client Info		27 Mar 2024		
Machine Age	hrs	Client Info		937		
Oil Age	hrs	Client Info		0		
Oil Changed	1113	Client Info		N/A		
Sample Status		Ciletit iiiio		NORMAL		
				NONWAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	13		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	61		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	3		
Zinc	ppm	ASTM D5185m	0	2		
	ррін		-			
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	27		
Water	%	ASTM D6304	>0.05	0.021		
ppm Water	ppm	ASTM D6304	>500	212		
FLUID CLEANLINE	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5414		
Particles >6µm		ASTM D7647	>1300	749		
Particles >14µm		ASTM D7647	>80	37		
Particles >21µm		ASTM D7647	>20	10		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/17/12		
FLUID DEGRADAT	ΓΙΟΝ	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.34



OIL ANALYSIS REPORT

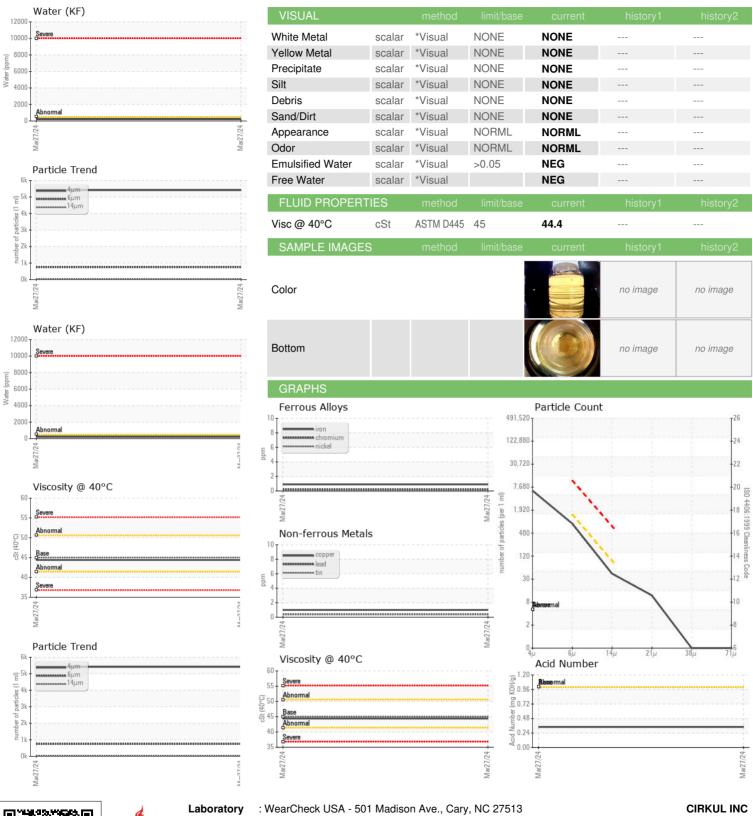



Certificate 12367

Sample No. : KC123233 **Lab Number** : 06155204 Unique Number : 10990627

Test Package : IND 2

Received : 19 Apr 2024 **Tested** : 24 Apr 2024

Diagnosed : 24 Apr 2024 - Jonathan Hester 4456 EAGLE FALLS PL TAMPA, FL US 33619

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: CIRTAM [WUSCAR] 06155204 (Generated: 04/24/2024 10:24:06) Rev: 1

Contact/Location: Service Manager - CIRTAM

T:

F: