

OIL ANALYSIS REPORT









Machine Id C-3 (S/N 10242F32979071)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

OIL #3 (GAL)		<u> </u>		Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006361		
Sample Date		Client Info		25 Mar 2024		
Machine Age	hrs	Client Info		697		
Oil Age	hrs	Client Info		697		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	<1		
Copper	ppm	ASTM D5185m	>8	<1		
Tin	ppm	ASTM D5185m	>4	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.01	0.001		
ppm Water	ppm	ASTM D6304	>100	2		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 30273		
Particles >6µm		ASTM D7647	>2500	3356		
Particles >14µm		ASTM D7647	>320	48		
Particles >21µm		ASTM D7647	>80	7		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>22/19/13</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014		



OIL ANALYSIS REPORT

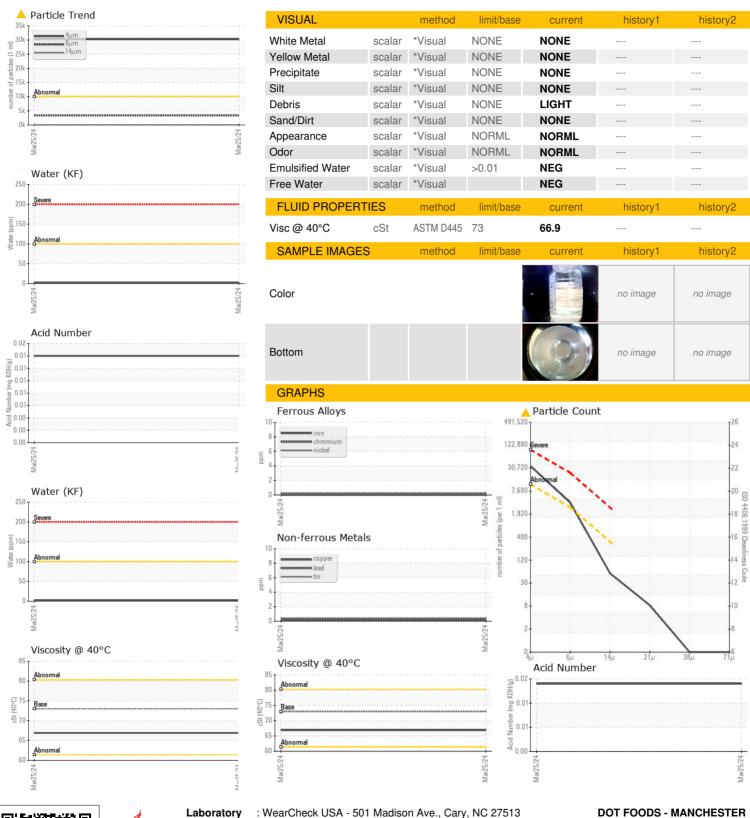



Certificate 12367

Sample No.

Laboratory

: USP0006361 Lab Number : 06155211 Unique Number : 10990634 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Apr 2024

Tested : 23 Apr 2024 Diagnosed : 23 Apr 2024 - Doug Bogart

600 MANCHESTER INDUSTRIAL PKWY MANCHESTER, TN

US 37355 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: