




# OIL ANALYSIS REPORT

Sample Rating Trend

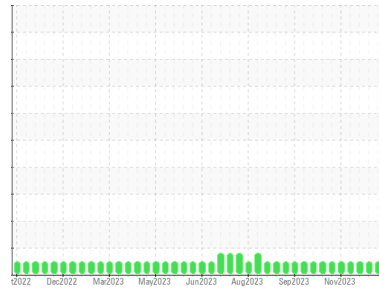

**NORMAL**



Machine Id  
**CAPTIS ENERGY ENG 2 (S/N 1251397)**  
 Component  
**Natural Gas Engine**  
 Fluid  
**MAHLER Q8 Mahler G8 SAE 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0914336</b>	WC0914343	WC0835566
Sample Date	Client Info			<b>15 Apr 2024</b>	08 Apr 2024	11 Dec 2023
Machine Age	hrs	Client Info		<b>24462</b>	24310	22047
Oil Age	hrs	Client Info		<b>3869</b>	3717	1440
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>4</b>	4	0
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>9	<b>2</b>	3	2
Lead	ppm	ASTM D5185m	>30	<b>&lt;1</b>	2	0
Copper	ppm	ASTM D5185m	>35	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>2</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>2</b>	3	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	<1
Magnesium	ppm	ASTM D5185m		<b>10</b>	10	15
Calcium	ppm	ASTM D5185m		<b>2401</b>	2471	2229
Phosphorus	ppm	ASTM D5185m		<b>447</b>	443	452
Zinc	ppm	ASTM D5185m		<b>509</b>	499	539
Sulfur	ppm	ASTM D5185m		<b>2658</b>	2338	2494

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	<b>5</b>	5	5
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	2


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.0</b>	8.1	7.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>17.5</b>	17.7	16.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.8</b>	14.1	11.8
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.89</b>	0.92	0.19
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	<b>6.23</b>	6.05	6.63




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

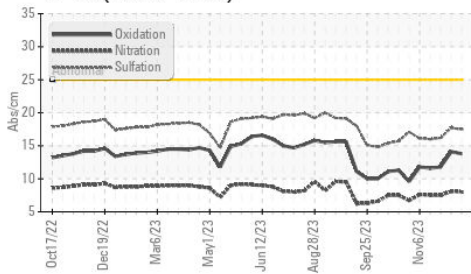


Acid Number

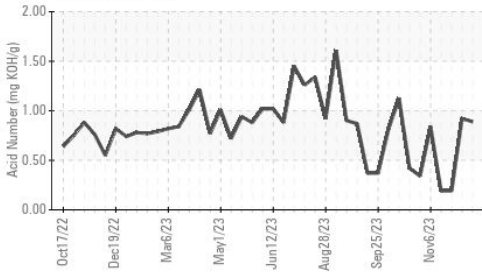

Base Number

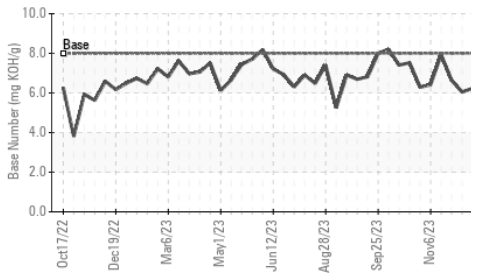

Viscosity @ 100°C

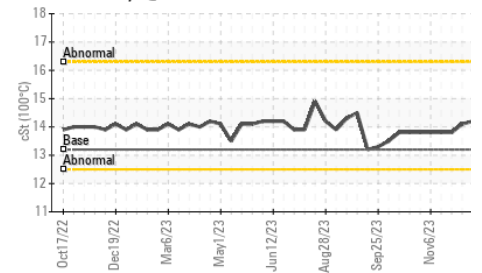


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	14.2	14.1

## GRAPHS


Iron (ppm)

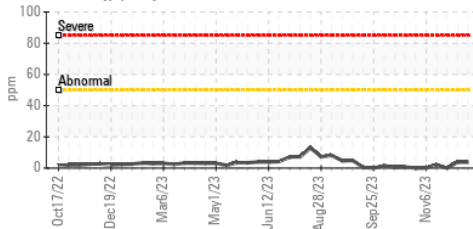


Lead (ppm)

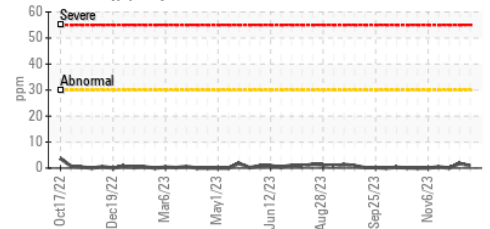


Aluminum (ppm)

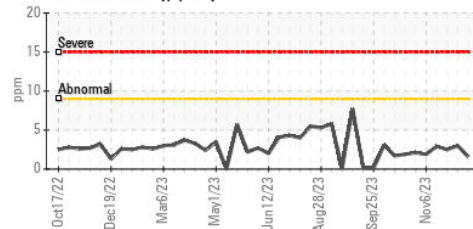


Chromium (ppm)

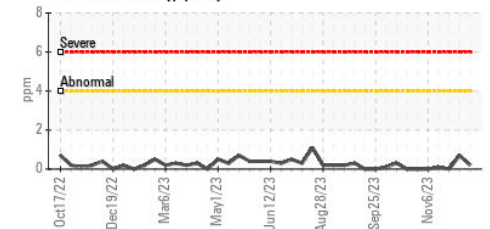


Copper (ppm)

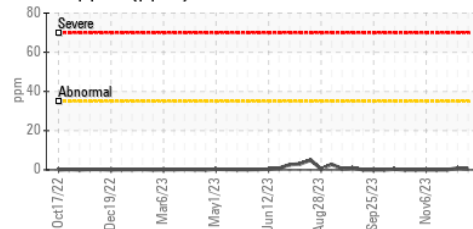


Silicon (ppm)

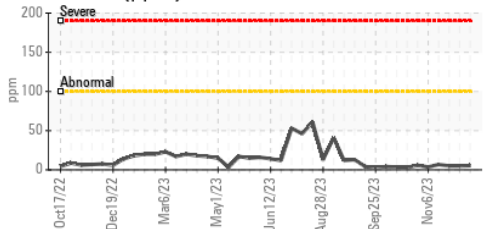

Viscosity @ 100°C

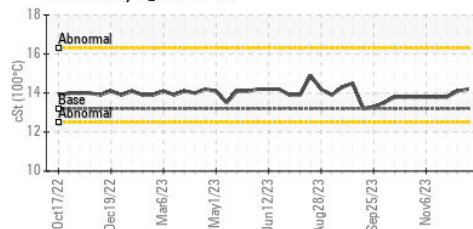

Base Number

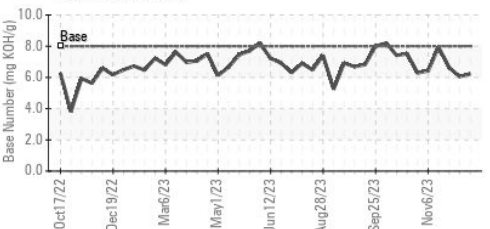

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0914336  
**Lab Number** : 06155250  
**Unique Number** : 10990673  
**Test Package** : MOB 2

**CUBE DISTRICT ENERGY**  
 1000 WINDWARD CONCOURSE SUITE 150  
 ALPHARETTA, GA  
 US 30005  
 Contact: ED LEWIS  
 ed.lewis@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: