




OIL ANALYSIS REPORT

Sample Rating Trend

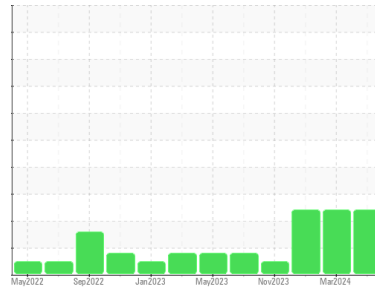

GLYCOL



Machine Id
SANDY LOU

Component
Starboard Genset

Fluid
CHEVRON DELO 400 SDE SAE 15W40 (3 GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of the coolant leak. Check for low coolant level. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Sodium and/or potassium levels are high.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		MW0047377	MW0047383	MW0047397
Sample Date	Client Info		15 Apr 2024	13 Mar 2024	30 Jan 2024
Machine Age	hrs	Client Info	26841	26554	26389
Oil Age	hrs	Client Info	287	170	551
Oil Changed	Client Info		Not Chngd	Not Chngd	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	9	13	28
Chromium	ppm	ASTM D5185m	>4	<1	<1	2
Nickel	ppm	ASTM D5185m	>2	0	<1	<1
Titanium	ppm	ASTM D5185m		14	14	13
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	2	5	7
Lead	ppm	ASTM D5185m	>17	2	3	15
Copper	ppm	ASTM D5185m	>70	1	2	4
Tin	ppm	ASTM D5185m	>15	<1	<1	1
Vanadium	ppm	ASTM D5185m		<1	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		34	34	21
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		46	72	116
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		684	705	640
Calcium	ppm	ASTM D5185m		1501	1453	1429
Phosphorus	ppm	ASTM D5185m	760	597	795	665
Zinc	ppm	ASTM D5185m	800	758	886	817
Sulfur	ppm	ASTM D5185m	3000	3316	3324	2985

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	4	6	9
Sodium	ppm	ASTM D5185m		▲ 63	▲ 170	▲ 364
Potassium	ppm	ASTM D5185m	>20	▲ 136	▲ 350	▲ 754

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0.1	0.2
Nitration	Abs/cm	*ASTM D7624	>20	11.1	11.2	14.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.2	19.6	23.5


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	19.0	14.9	21.3
Base Number (BN)	mg KOH/g	ASTM D2896	10	7.2	8.7	6.6




OIL ANALYSIS REPORT


Glycol Contamination

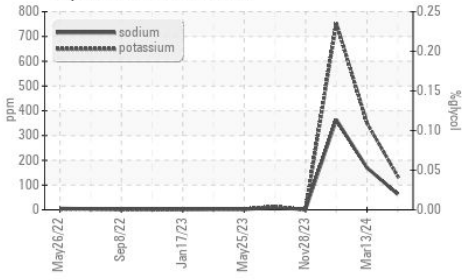


FT-IR (Direct Trend)

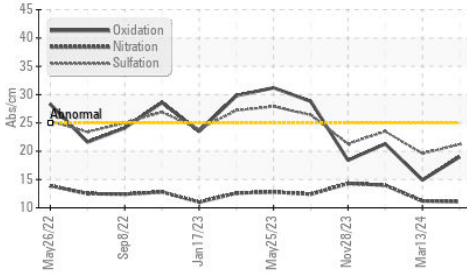

Base Number

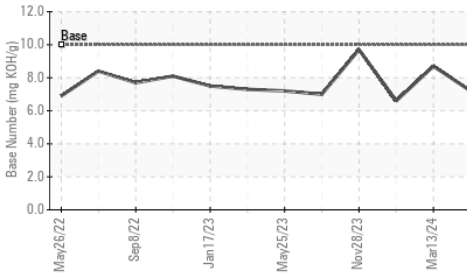

Viscosity @ 100°C

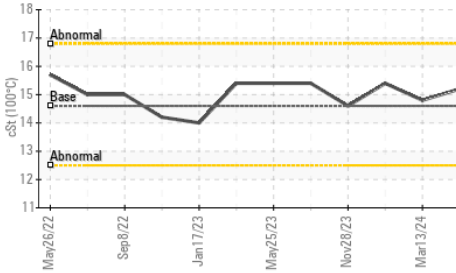


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.6	15.2	14.8

GRAPHS


Ferrous Alloys

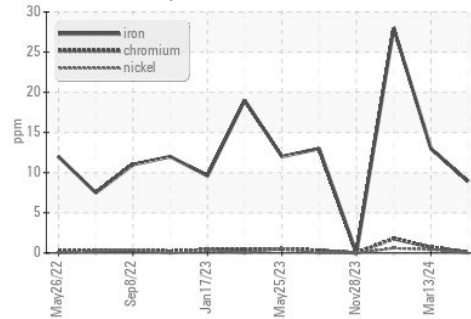


Non-ferrous Metals

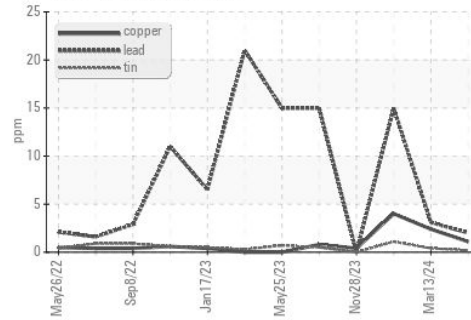

Viscosity @ 100°C

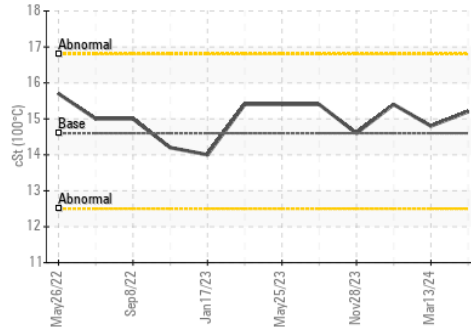

Base Number

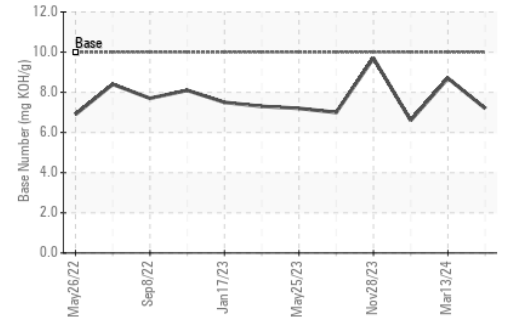

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : MW0047377

Lab Number : 06155586

Unique Number : 10991009

Test Package : MAR 2

Received : 22 Apr 2024

Tested : 23 Apr 2024

Diagnosed : 24 Apr 2024 - Jonathan Hester

OSAGE MARINE

750 E DAVIS ST

ST LOUIS, MO

US 63111

Contact: MIKE KESSLER

mike.kessler@osagemarine.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)