




# OIL ANALYSIS REPORT

Sample Rating Trend

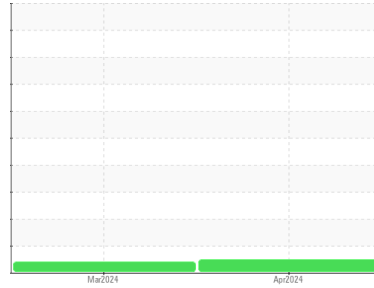

**NORMAL**



Machine Id

**MAIN TANK**

Component

**Hydraulic System**

Fluid

**AW HYDRAULIC OIL ISO 46 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0905615</b>	WC0920365	---
Sample Date	Client Info			<b>20 Apr 2024</b>	22 Mar 2024	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>3</b>	1	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>20	<b>2</b>	<1	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	25	<b>1</b>	0	---
Calcium	ppm	ASTM D5185m	200	<b>34</b>	28	---
Phosphorus	ppm	ASTM D5185m	300	<b>308</b>	320	---
Zinc	ppm	ASTM D5185m	370	<b>356</b>	325	---
Sulfur	ppm	ASTM D5185m	2500	<b>897</b>	904	---





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>0</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>2421</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>829</b>	---	---
Particles >14µm		ASTM D7647	>160	<b>83</b>	---	---
Particles >21µm		ASTM D7647	>40	<b>24</b>	---	---
Particles >38µm		ASTM D7647	>10	<b>1</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>18/17/14</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.37</b>	0.439	---




# OIL ANALYSIS REPORT

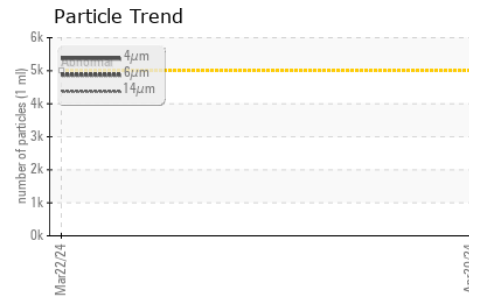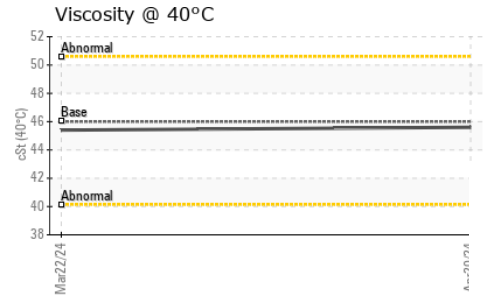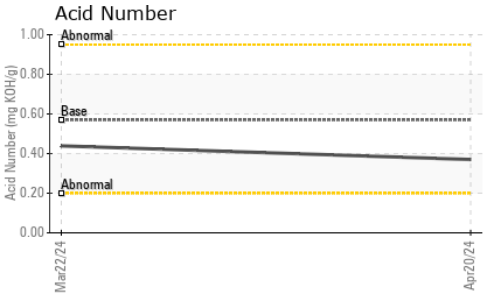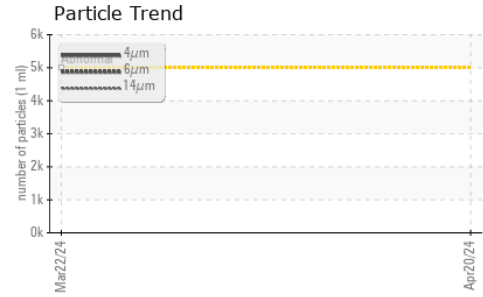






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>45.6</b>	45.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

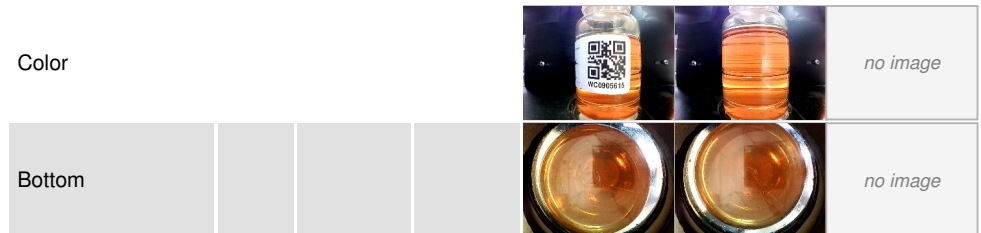

## GRAPHS

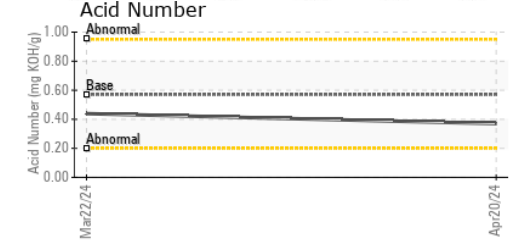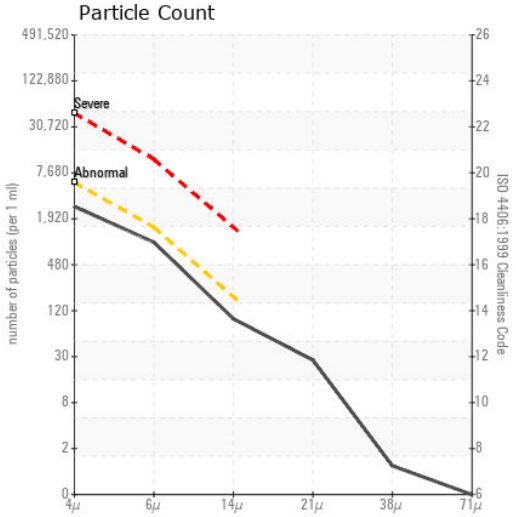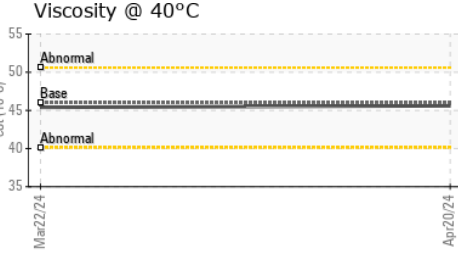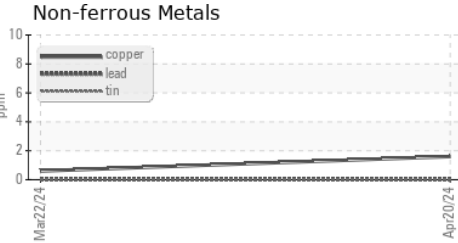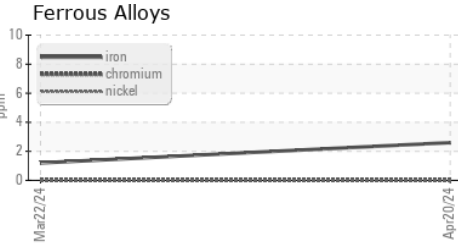

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0905615      **Received** : 22 Apr 2024  
**Lab Number** : 06155861      **Tested** : 23 Apr 2024  
**Unique Number** : 10991284      **Diagnosed** : 24 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**ALLVAC SAF CONDITIONING**  
 3750 ALLOY WAY  
 MONROE, NC  
 US 28110  
 Contact: JEREMY ALMOND  
 jeremy.almond@atimetals.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)