



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id

## 6 KAESER

Component

### 1 Screw Compressor

Fluid

### ROYAL PURPLE Polyguard FDA ISO 46 (--- GAL)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: From the screw. )

##### Wear

All component wear rates are normal.

##### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0891437</b>	---	---
Sample Date	Client Info			<b>11 Apr 2024</b>	---	---
Machine Age	hrs	Client Info		<b>61538</b>	---	---
Oil Age	hrs	Client Info		<b>4000</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>5	<b>4</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>30	<b>9</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>241</b>	---	---
Zinc	ppm	ASTM D5185m		<b>68</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>610</b>	---	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304	>0.1	<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304	>1000	<b>23</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>7995</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>1786</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>139</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>34</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>1</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/14</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.45</b>	---	---




# OIL ANALYSIS REPORT

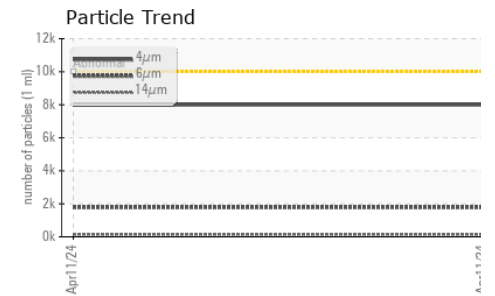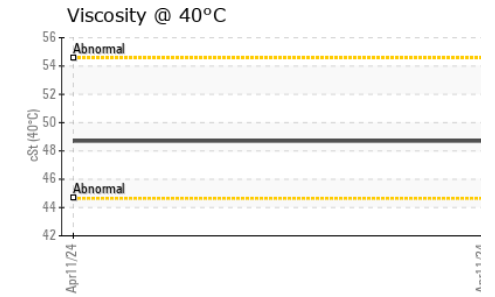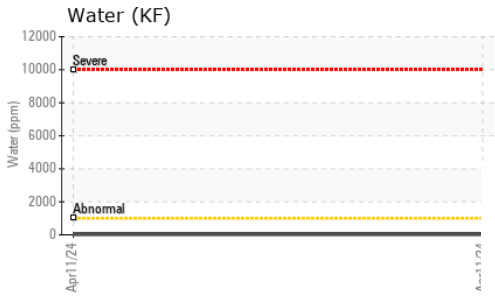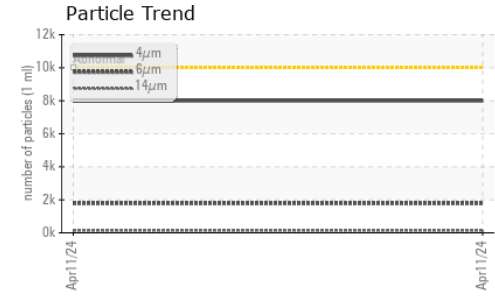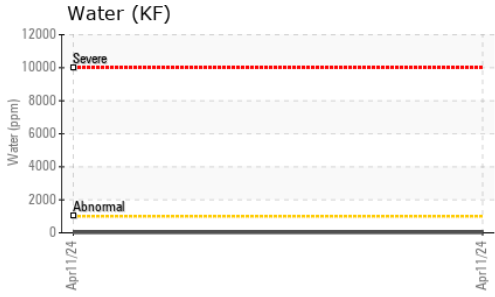





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

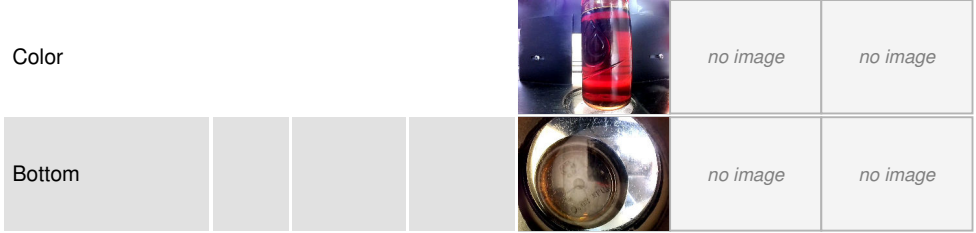

## GRAPHS

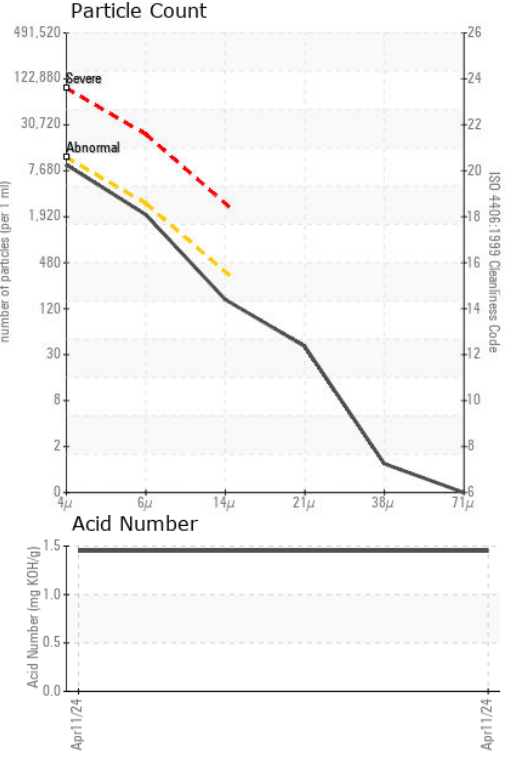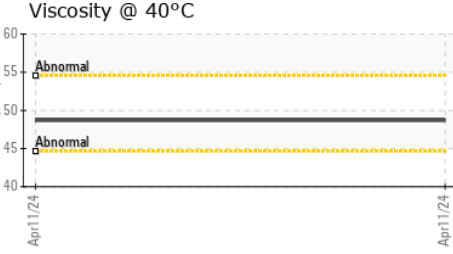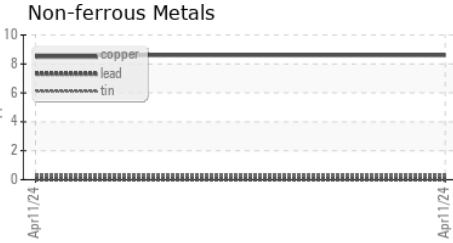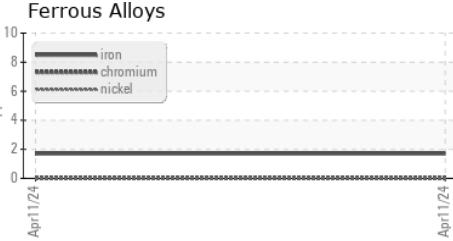

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0891437  
**Lab Number** : 06155890  
**Unique Number** : 10991313  
**Test Package** : PLANT  
**Received** : 22 Apr 2024  
**Tested** : 23 Apr 2024  
**Diagnosed** : 24 Apr 2024 - Don Baldrige

**TEXAS COMPRESSOR SERVICE**  
 1545 HOUSTON RD  
 BURLESON, TX  
 US 76028  
 Contact: JASON VIBBERT  
 JASON.VIBBERT@DART.BIZ

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)