

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER KAESER CSV 125

3 Vacuum Pump

KAESER SIGMA (OEM) S-460 (15 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO50000995		
Sample Date		Client Info		17 Apr 2024		
Machine Age	hrs	Client Info		39266		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	4		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	71		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	78		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		19211		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>.1	0.018		
ppm Water	ppm	ASTM D6304	>1000	183		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1027		
Particles >6µm		ASTM D7647	>1300	273		
Particles >14µm		ASTM D7647	>160	28		
Particles >21µm		ASTM D7647	>40	10		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/15/12		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41		



OIL ANALYSIS REPORT

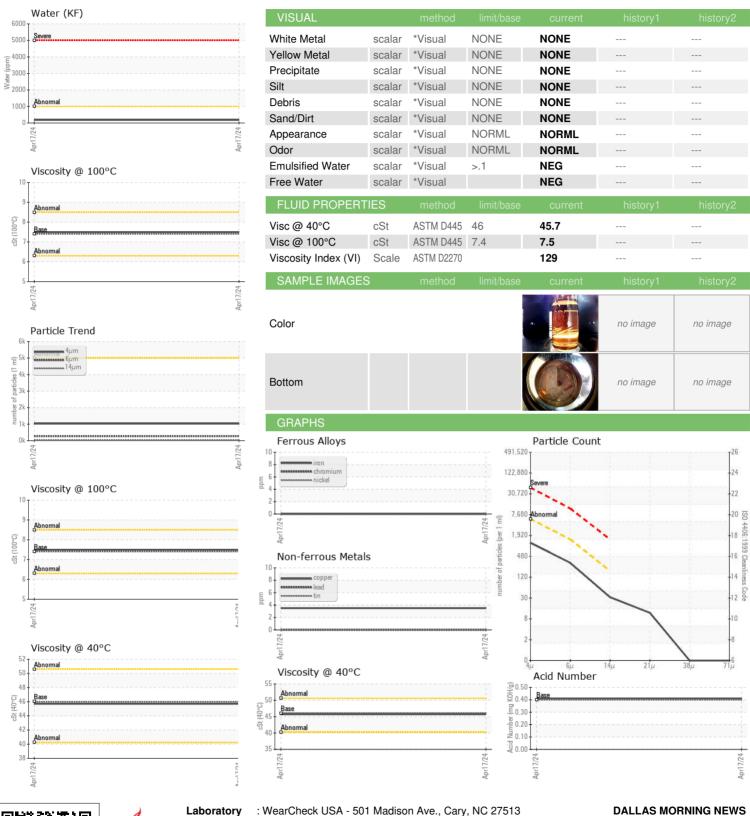





Certificate 12367

Laboratory Sample No.

Lab Number : 06155932

: TO50000995

Received : 22 Apr 2024 **Tested** Unique Number : 10991355

: 24 Apr 2024 Diagnosed : 24 Apr 2024 - Jonathan Hester

Test Package: IND 2 (Additional Tests: KF, KV100, PQ, PrtCount, VI) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

DALLAS MORNING NEWS

3900 W PLANO PKWY PLANO, TX US 75075

Contact: KENNY CLARK kclark@dallasnews.com T: (214)977-6929

F: (214)977-6888

Contact/Location: KENNY CLARK - DALPLATO