

## **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



Machine Id

# **KAESER KAESER DSD 125**

1 Vacuum Pump

KAESER SIGMA (OEM) S-460 (15 GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr2024				
CAMPLE INFORM	AATION		11 1- 0			
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		TO50000989		
Sample Date		Client Info		17 Apr 2024		
Machine Age	hrs	Client Info		71590		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>20	2		
Tin	ppm	ASTM D5185m	>20	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum		ASTM D5185m	30	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium		ASTM D5185m	90	19		
Calcium	ppm	ASTM D5185m		0		
Phosphorus		ASTM D5185m	2	0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		19753		
	ppm			19755		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>.1	0.006		
ppm Water	ppm	ASTM D6304	>1000	67		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	619		
Particles >6µm		ASTM D7647	>1300	105		
Particles >14µm		ASTM D7647	>160	8		
Particles >21µm		ASTM D7647	>40	2		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/14/10		
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
A siel Niversland (ANI)	I/OII/-	VCTM D004E	0.4	0.41		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.41



## **OIL ANALYSIS REPORT**

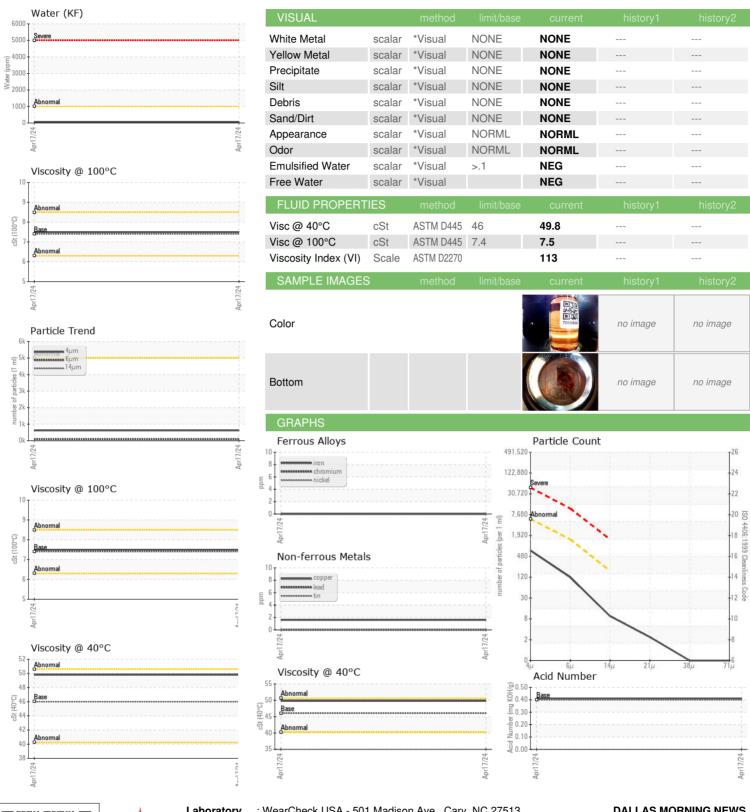





Certificate 12367

Laboratory Sample No. Lab Number

: TO50000989 : 06155935 Unique Number: 10991358

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 22 Apr 2024 Tested : 24 Apr 2024 Diagnosed

: 24 Apr 2024 - Jonathan Hester Test Package: IND 2 (Additional Tests: KF, KV100, PQ, PrtCount, VI) To discuss this sample report, contact Customer Service at 1-800-237-1369.

**DALLAS MORNING NEWS** 

3900 W PLANO PKWY PLANO, TX US 75075

Contact: KENNY CLARK kclark@dallasnews.com T: (214)977-6929

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (214)977-6888 Contact/Location: KENNY CLARK - DALPLATO