




# OIL ANALYSIS REPORT

Sample Rating Trend

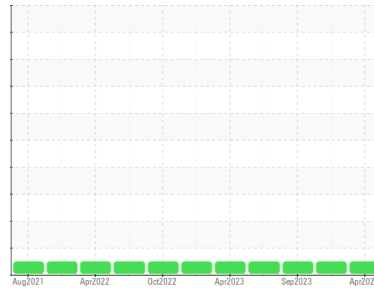

**NORMAL**



Machine Id  
**HSS SC6 (S/N 1655)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0006485</b>	USP0004831	USP0001976
Sample Date	Client Info	<b>21 Apr 2024</b>	16 Jan 2024	20 Sep 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>8	<b>&lt;1</b>	0	0
Chromium ppm ASTM D5185m	>2	<b>&lt;1</b>	<1	0
Nickel ppm ASTM D5185m		<b>&lt;1</b>	0	<1
Titanium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Silver ppm ASTM D5185m	>2	<b>0</b>	0	0
Aluminum ppm ASTM D5185m	>3	<b>2</b>	0	0
Lead ppm ASTM D5185m	>2	<b>0</b>	0	0
Copper ppm ASTM D5185m	>8	<b>&lt;1</b>	0	0
Tin ppm ASTM D5185m	>4	<b>&lt;1</b>	0	0
Vanadium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium ppm ASTM D5185m		<b>&lt;1</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	0
Barium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum ppm ASTM D5185m		<b>&lt;1</b>	0	0
Manganese ppm ASTM D5185m		<b>0</b>	0	0
Magnesium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Calcium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Phosphorus ppm ASTM D5185m		<b>0</b>	0	<1
Zinc ppm ASTM D5185m		<b>0</b>	0	0
Sulfur ppm ASTM D5185m	50	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>1</b>	0	<1
Sodium ppm ASTM D5185m		<b>&lt;1</b>	0	0
Potassium ppm ASTM D5185m	>20	<b>1</b>	<1	<1
Water % ASTM D6304	>0.01	<b>0.00</b>	0.003	0.001
ppm Water ppm ASTM D6304	>100	<b>0</b>	28	0.00

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	<b>903</b>	2299	429
Particles >6µm ASTM D7647	>2500	<b>168</b>	413	140
Particles >14µm ASTM D7647	>640	<b>9</b>	29	13
Particles >21µm ASTM D7647	>160	<b>2</b>	8	4
Particles >38µm ASTM D7647	>40	<b>0</b>	0	1
Particles >71µm ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness ISO 4406 (c)	>20/18/16	<b>17/15/10</b>	18/16/12	16/14/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D974	0.005	<b>0.014</b>	0.014	0.015




# OIL ANALYSIS REPORT

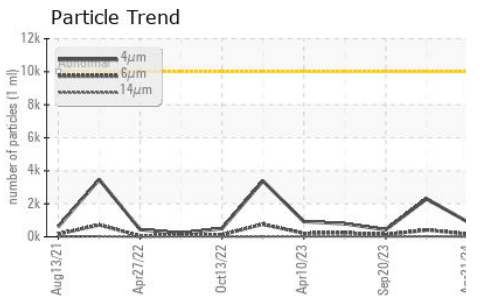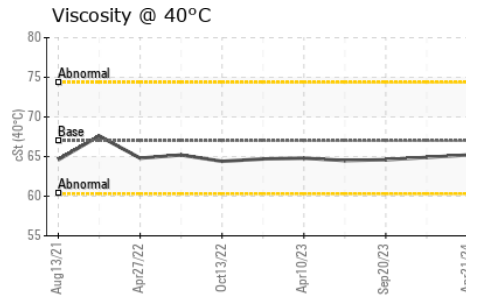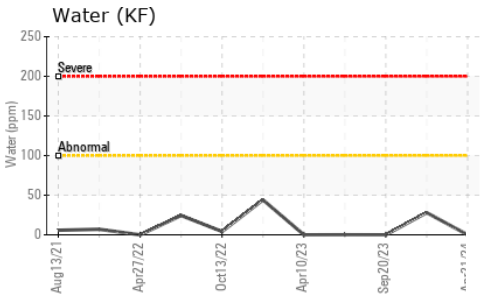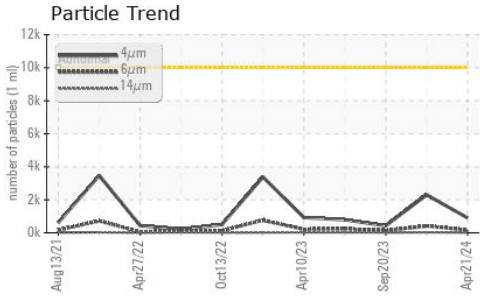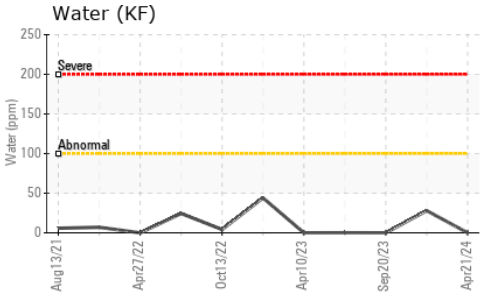





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	65.2	64.9	64.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

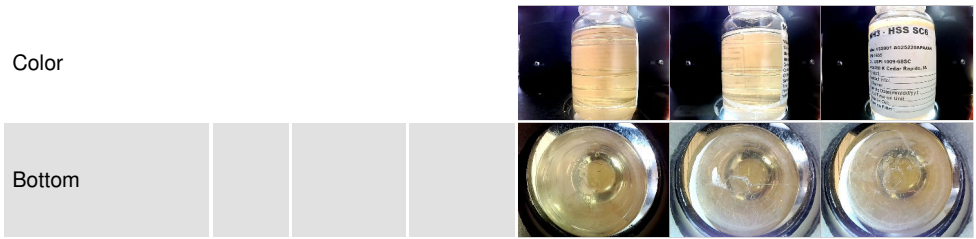

## GRAPHS

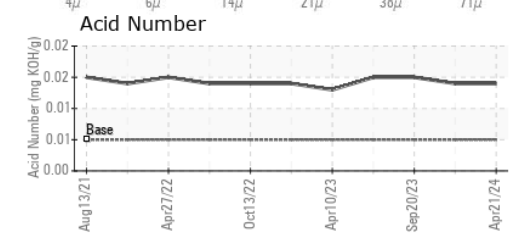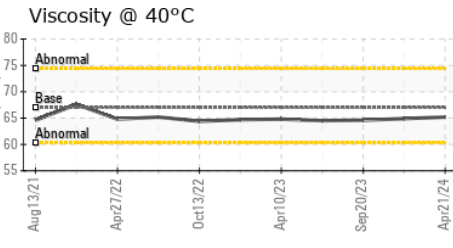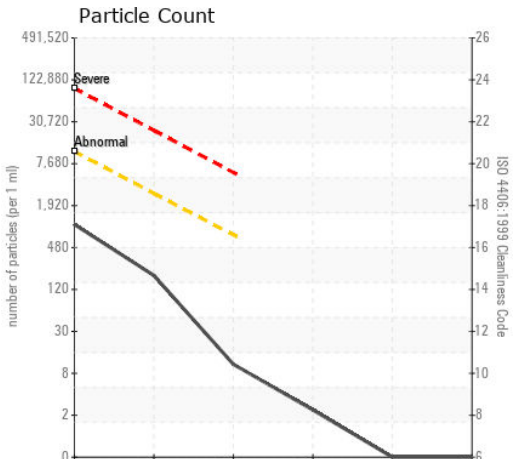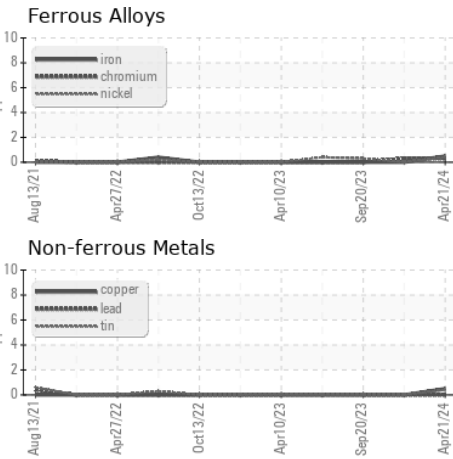

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP006485  
**Lab Number** : 06156028  
**Unique Number** : 10991451  
**Test Package** : IND 2  
**Received** : 22 Apr 2024  
**Tested** : 23 Apr 2024  
**Diagnosed** : 24 Apr 2024 - Jonathan Hester

**KraftHeinz - Cedar Rapids - Plant 8370**  
 4601 C ST SW  
 CEDAR RAPIDS, IA  
 US 52404  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)