

OIL ANALYSIS REPORT

Area PG-46 [279257] GARDNER DENVER S370016 - MENASHA

Component Compressor

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear


All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

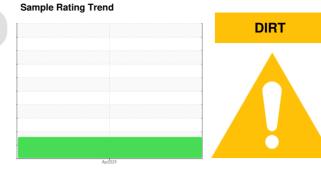



SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000697		
Sample Date		Client Info		13 Apr 2024		
Machine Age	hrs	Client Info		78720		
Oil Age	hrs	Client Info		3921		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
CONTAMINATION	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		1		
Phosphorus	ppm	ASTM D5185m		549		
Zinc	ppm	ASTM D5185m		186		
Sulfur	ppm	ASTM D5185m		120		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<u> </u>		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.43		




OIL ANALYSIS REPORT







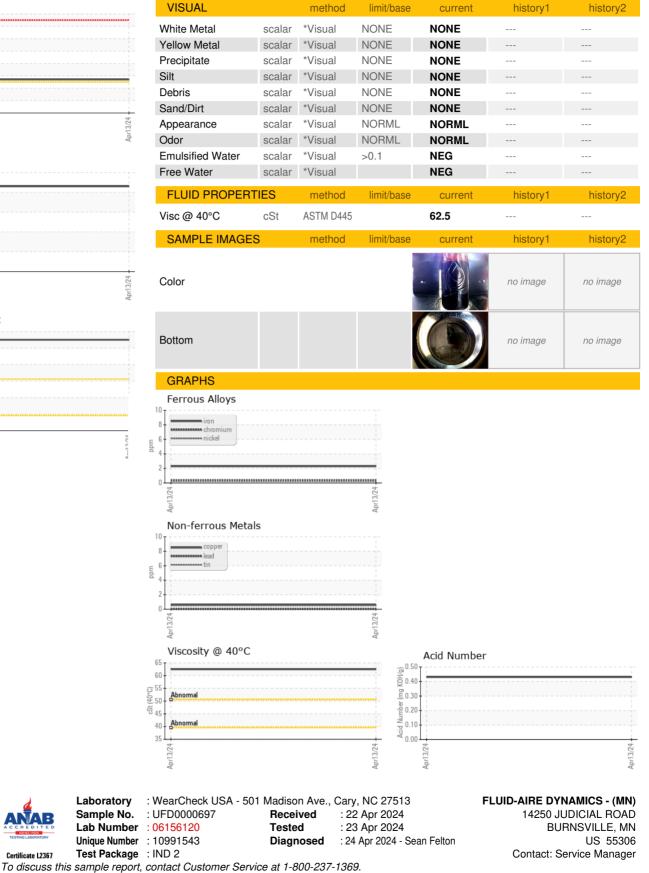

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Laboratory

Sample No.

Contact/Location: Service Manager - UCFLUBUR

T:

F: