

# **OIL ANALYSIS REPORT**

Area PG-46 [279257] Machine Id GARDNER DENVER S121427 - MENASHA Component

Component Compressor

#### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear


All component wear rates are normal.

## Contamination

Moderate concentration of visible dirt/debris present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.






NORMAL

SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000268		
Sample Date		Client Info		13 Apr 2024		
Machine Age	hrs	Client Info		88922		
Oil Age	hrs	Client Info		3941		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	10		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		1		
Phosphorus	ppm	ASTM D5185m		309		
Zinc	ppm	ASTM D5185m		9		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	14		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.66		

Sample Rating Trend



# **OIL ANALYSIS REPORT**

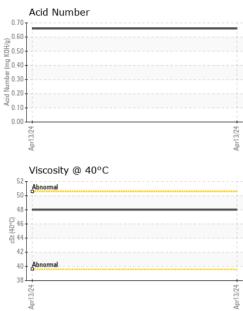

	VISUAL		method	limit/base	current	history1	history2	
	White Metal	scalar	*Visual	NONE	NONE			
	Yellow Metal	scalar	*Visual	NONE	NONE			
	Precipitate	scalar	*Visual	NONE	NONE			
	Silt	scalar	*Visual	NONE	NONE			
1	Debris	scalar	*Visual	NONE	MODER			
	Sand/Dirt	scalar	*Visual	NONE	NONE			
Apr13,24	Appearance	scalar	*Visual	NORML	NORML			
Ap	Odor	scalar	*Visual	NORML	NORML			
	Emulsified Water	scalar	*Visual	>0.1	NEG			
1	Free Water	scalar	*Visual		NEG			
	FLUID PROPERT	IES	method	limit/base	current	history1	history2	
	Visc @ 40°C	cSt	ASTM D445		48.0			
	SAMPLE IMAGES	3	method	limit/base	current	history1	history2	
Apri 3/24 +	Color				•	no image	no image	
	Bottom					no image	no image	
	Non-ferrous Metal			Apr13/24				
	udd 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 4 2 0 1 2 0 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1							
	Viscosity @ 40°C			H(g) 80	Acid Numbe	r		
	50 9 50 45 50 50 50 50 50 50 50 50 50			0.8 (0)H(0) (0)H(0) (0) (0.2 0.0	0			
	Apr13/24			Apr13/24	Apr13/24		And 3/24	
Laboratory Sample No. Lab Number Unique Number Unique Number Test Package	: UFD0000268 : 06156121 : 10991544 : IND 2	Rece Teste Diagr	Madison Ave., Cary, NC 27513 Received : 22 Apr 2024 Tested : 23 Apr 2024 Diagnosed : 24 Apr 2024 - Sean Felton			FLUID-AIRE DYNAMICS - (MN 14250 JUDICIAL ROAD BURNSVILLE, MN US 55306 Contact: Service Manage		
discuss this sample report, Denotes test methods that atements of conformity to sp	are outside of the ISO 1	7025 sco	ope of accred	litation.	rule (JCGM 1	06:2012)	T: F:	

Report Id: UCFLUBUR [WUSCAR] 06156121 (Generated: 04/24/2024 13:30:46) Rev: 2

Contact/Location: Service Manager - UCFLUBUR