

OIL ANALYSIS REPORT

Area **S46** [284504] GARDNER DENVER S466162 - CROIX GEAR Component

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



Sample Rating Trend




NORMAL


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001590		
Sample Date		Client Info		11 Apr 2024		
Machine Age	hrs	Client Info		32339		
Oil Age	hrs	Client Info		6821		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm		>25	2		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0		
Barium	ppm	ASTM D5185m	1	<1		
Molybdenum	ppm	ASTM D5185m	1	<1		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	1	<1		
Calcium	ppm	ASTM D5185m	1	<1		
Phosphorus	ppm	ASTM D5185m	800	466		
Zinc	ppm	ASTM D5185m	20	<1		
Sulfur	ppm	ASTM D5185m	37	0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.24	0.25		



OIL ANALYSIS REPORT

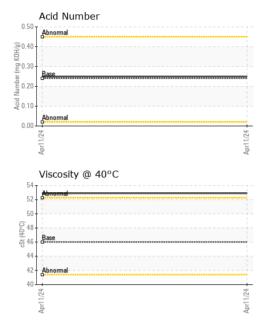

	VISUAL		method	limit/base	current	history1	history2
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
	Precipitate	scalar	*Visual	NONE	NONE		
	Silt	scalar	*Visual	NONE	NONE		
1	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
Apr11/24	Appearance	scalar	*Visual	NORML	NORML		
Ap	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
	Free Water	scalar	*Visual		NEG		
	FLUID PROPERT	TIES	method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	46	52.9		
	SAMPLE IMAGE	S	method	limit/base	current	history1	history2
Apri 1/24	Color					no image	no image
	Bottom					no image	no image
	Ferrous Alloys			Apri1/24			
	Viscosity @ 40°C			9.0 •.0 (0) •.0 (0) •.0 (0) •.0 Veri •.0 Veri •.0 (0)	Acid Numbe	er	
				Page 0.2	20		
	40 Abnormal						
	Apr11/24			Apr11/24	Apr11/24		Apr11/24
Laboratory Sample No. Lab Number Unique Number Test Package	: WearCheck USA - 50 : UFD0001590 : 06156123 : 10991546 : IND 2	Rece Teste Diagr	ladison Ave., Cary, NC 27513 Received : 22 Apr 2024 Tested : 23 Apr 2024 Diagnosed : 24 Apr 2024 - Sean Felton			FLUID-AIRE DYNAMICS - (MN 14250 JUDICIAL ROAE BURNSVILLE, MN US 55306 Contact: Service Manage	
o discuss this sample report - Denotes test methods that tatements of conformity to s	are outside of the ISO 1	7025 sco	ope of accred	litation.	n rule (JCGM 1	106:2012)	T: F:



Ē

Contact/Location: Service Manager - UCFLUBUR