




# OIL ANALYSIS REPORT

Sample Rating Trend

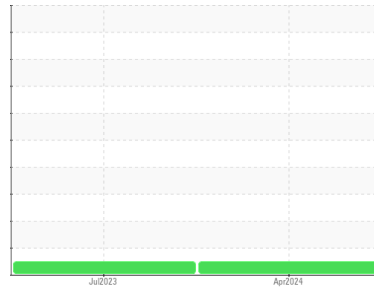

**NORMAL**



Area  
**QUINSYN PLUS**  
 Machine Id  
**QUINCY API853618 - UTC**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06156150</b>	UCH05910095	---
Sample Date	Client Info			<b>16 Apr 2024</b>	11 Jul 2023	---
Machine Age	hrs	Client Info		<b>10134</b>	6786	---
Oil Age	hrs	Client Info		<b>4321</b>	1035	---
Oil Changed	Client Info			<b>Changed</b>	Not Changd	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>1</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>1</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>5</b>	3	---
Phosphorus	ppm	ASTM D5185m		<b>19</b>	14	---
Zinc	ppm	ASTM D5185m		<b>7</b>	4	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	62	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>13</b>	4	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	1	---
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.066</b>	0.107	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---




# OIL ANALYSIS REPORT



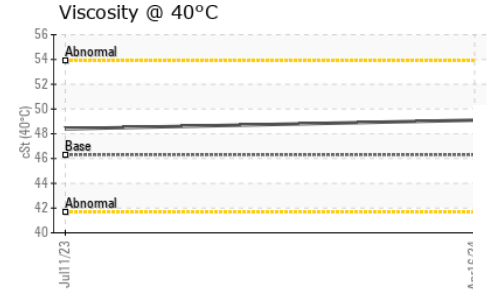
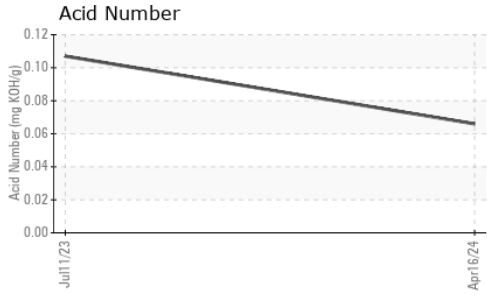


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46.3	<b>49.1</b>	48.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

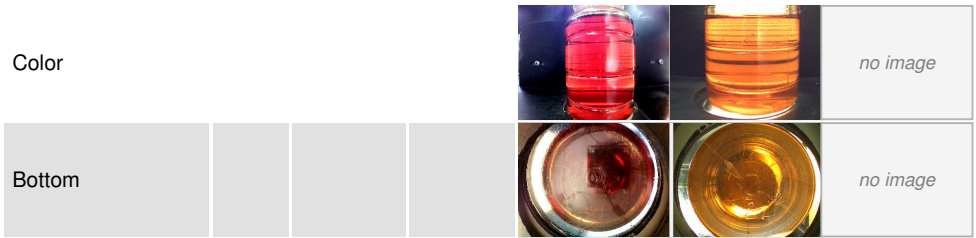

## GRAPHS

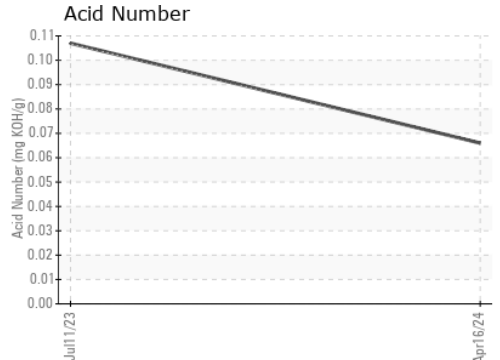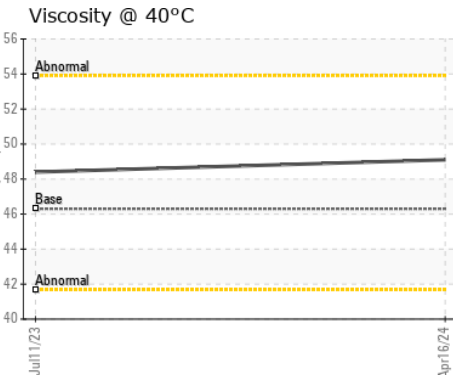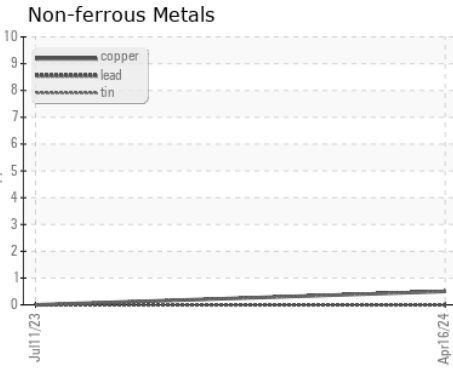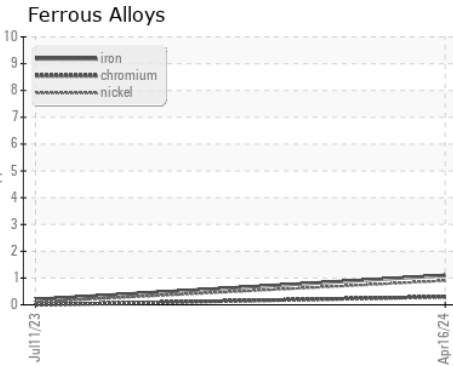

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06156150      **Received** : 22 Apr 2024  
**Lab Number** : **06156150**      **Tested** : 24 Apr 2024  
**Unique Number** : 10991573      **Diagnosed** : 24 Apr 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**TATE ENGINEERING**  
 150 EARLAND DR, BUILDING 5  
 NEW HOLLAND, PA  
 US 17557  
 Contact: BRIAN CODER  
 brian.coder@tate.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)