




# OIL ANALYSIS REPORT

## Sample Rating Trend

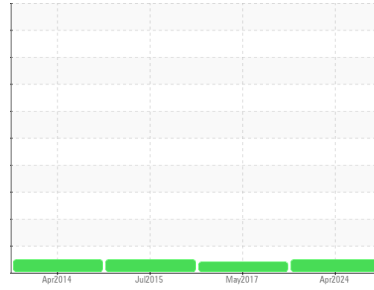

**NORMAL**



Area

**CS-46 [U1-3316042]**

Machine Id

**SULLAIR 200809260098 - VINEBURG MACHINE**

Component

**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06156159</b>	UCH04237674	UCH03811726
Sample Date	Client Info			<b>10 Apr 2024</b>	18 May 2017	13 Jul 2015
Machine Age	hrs	Client Info		<b>44782</b>	0	16862
Oil Age	hrs	Client Info		<b>1558</b>	8000	7976
Oil Changed	Client Info			<b>Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>2</b>	<1	1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	1	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1.5	<b>0</b>	0	3
Barium	ppm	ASTM D5185m	0	<b>&lt;1</b>	17	72
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	0.3	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	406	<b>91</b>	44	4
Zinc	ppm	ASTM D5185m	0	<b>16</b>	<1	0
Sulfur	ppm	ASTM D5185m	1283	<b>442</b>	120	99

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	4	2
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	47
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.463	<b>0.067</b>	0.205	0.436




# OIL ANALYSIS REPORT

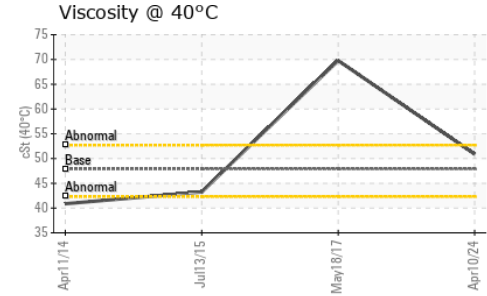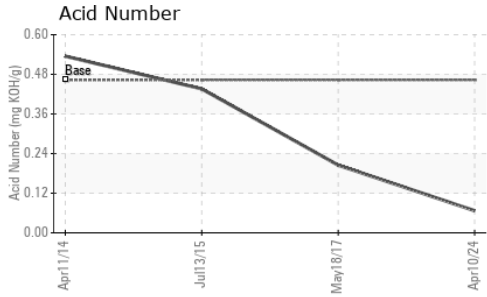





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	47.9	<b>50.9</b>	69.78	43.26

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

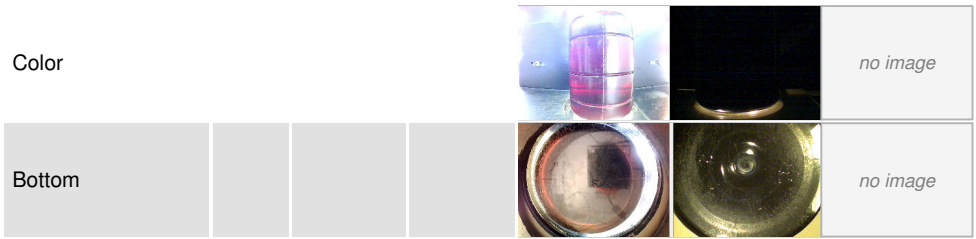

## GRAPHS

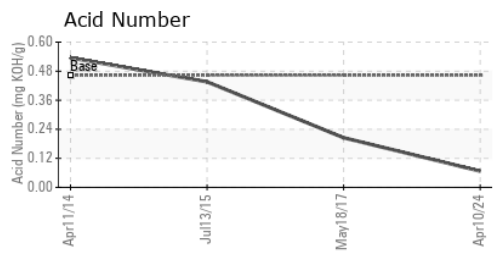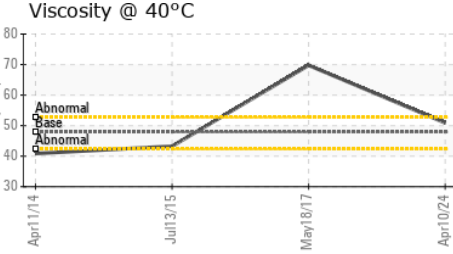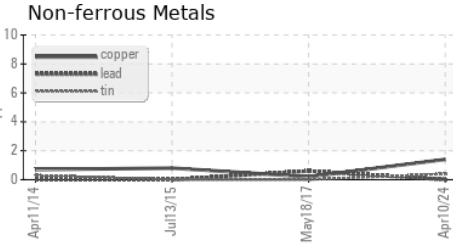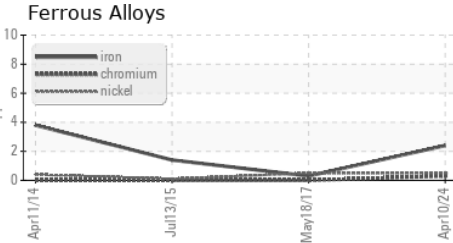

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06156159      **Received** : 22 Apr 2024  
**Lab Number** : **06156159**      **Tested** : 23 Apr 2024  
**Unique Number** : 10991582      **Diagnosed** : 24 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**CISCO AIR SYSTEMS**  
 214 27TH ST  
 SACRAMENTO, CA  
 US 95816  
 Contact: BARRY FRKOVICH  
 barryfrkovich@ciscoair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)