




OIL ANALYSIS REPORT

Sample Rating Trend

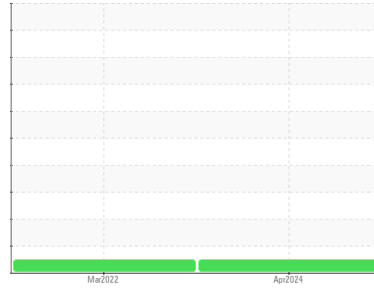

NORMAL



Machine Id
SULLAIR 201409160095 - CPP
 Component
Compressor
 Fluid
SULLUBE OR PG (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0920586	WC0608962	---
Sample Date	Client Info			14 Apr 2024	28 Mar 2022	---
Machine Age	hrs	Client Info		79821	61880	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			Not Changed	N/A	---
Sample Status				NORMAL	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	7	1	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m		<1	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	3	<1	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	2	3	---
Tin	ppm	ASTM D5185m	>15	<1	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	---
Barium	ppm	ASTM D5185m		902	572	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		1	0	---
Calcium	ppm	ASTM D5185m		4	1	---
Phosphorus	ppm	ASTM D5185m		6	24	---
Zinc	ppm	ASTM D5185m		5	<1	---
Sulfur	ppm	ASTM D5185m		282	297	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	<1	---
Sodium	ppm	ASTM D5185m		30	61	---
Potassium	ppm	ASTM D5185m	>20	5	3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.359	0.38	---




OIL ANALYSIS REPORT

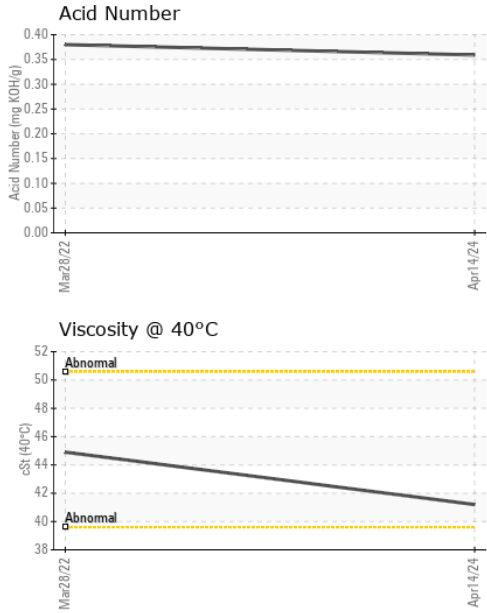





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	MODER	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	MODER	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	41.2	44.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

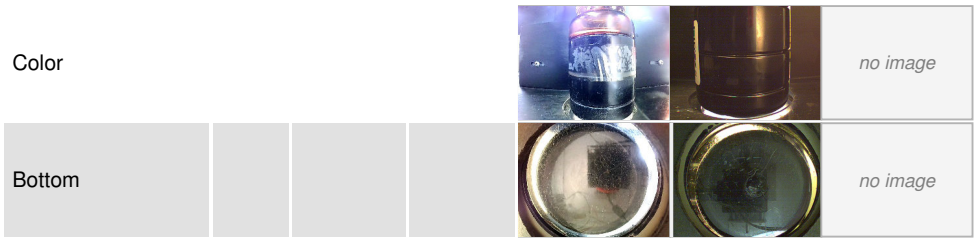

GRAPHS

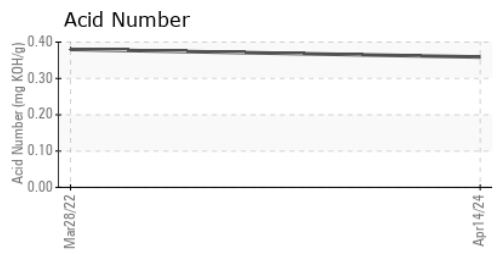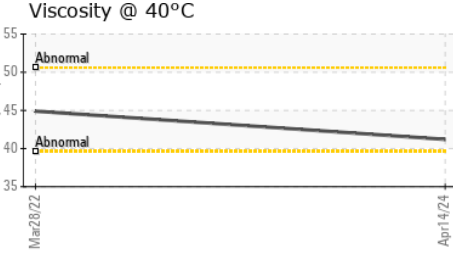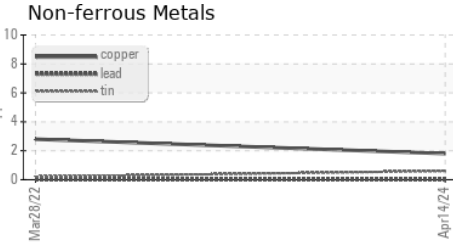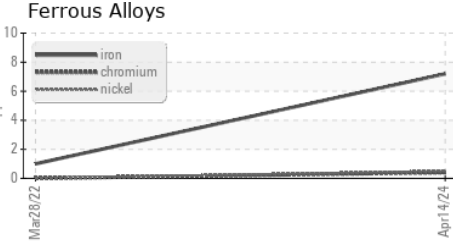

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0920586 **Received** : 22 Apr 2024
Lab Number : **06156163** **Tested** : 23 Apr 2024
Unique Number : 10991586 **Diagnosed** : 24 Apr 2024 - Sean Felton
Test Package : IND 2

JOHN HENRY FOSTER MINNESOTA INC.
 3103 MIKE COLLINS DRIVE
 EAGAN, MN
 US 55121
 Contact: MARTY ADAM
 marty.adam@jhfooster.com
 T: (651)681-5745
 F: (651)681-0536

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)