OIL ANALYSIS REPORT

Machine Id
Coopersville CAT 5 CPVM05BE
Component
Biogas Engine
Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (105 GAL)

Sample Rating Trend

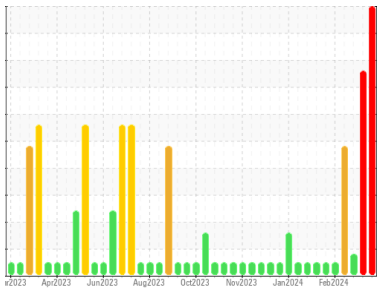

WEAR

DIAGNOSIS

▲ Recommendation
We recommend that you drain the oil and perform a filter service on this component if not already done. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

▲ Wear
The tin level is severe.

▲ Contamination
Elemental level of silicon (Si) above normal.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0871574**	WC0871563	WC0871590
Sample Date		Client Info		**18 Apr 2024**	10 Apr 2024	29 Mar 2024
Machine Age	hrs	Client Info		**16595**	16402	16119
Oil Age	hrs	Client Info		**838**	645	362
Oil Changed		Client Info		**Not Changd**	Not Changd	Changed
Sample Status				**SEVERE**	SEVERE	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method	>.11	**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	**3**	<1	<1
Chromium	ppm	ASTM D5185m	>4	**<1**	0	0
Nickel	ppm	ASTM D5185m		**0**	<1	0
Titanium	ppm	ASTM D5185m		**0**	0	<1
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>6	**2**	3	2
Lead	ppm	ASTM D5185m	>9	**7**	6	3
Copper	ppm	ASTM D5185m	>6	**4**	1	1
Tin	ppm	ASTM D5185m	>4	▲ **9**	▲ 7	▲ 4
Vanadium	ppm	ASTM D5185m		**0**	0	<1
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**2**	0	2
Barium	ppm	ASTM D5185m		**1**	0	0
Molybdenum	ppm	ASTM D5185m		**4**	4	4
Manganese	ppm	ASTM D5185m		**1**	<1	0
Magnesium	ppm	ASTM D5185m		**10**	9	6
Calcium	ppm	ASTM D5185m		**2018**	2015	1770
Phosphorus	ppm	ASTM D5185m		**299**	299	248
Zinc	ppm	ASTM D5185m		**367**	352	318
Sulfur	ppm	ASTM D5185m		**2555**	2594	2122

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>181	▲ **242**	▲ 183	127
Sodium	ppm	ASTM D5185m	>21	**2**	1	1
Potassium	ppm	ASTM D5185m	>20	**<1**	3	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0.1**	0.1	0
Nitration	Abs/cm	*ASTM D7624		**7.3**	7.3	6.7
Sulfation	Abs/.1mm	*ASTM D7415		**20.9**	20.0	17.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		**16.8**	15.7	12.7
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**1.71**	1.69	1.13
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	**3.10**	3.38	3.98

OIL ANALYSIS REPORT

Non-ferrous Metals

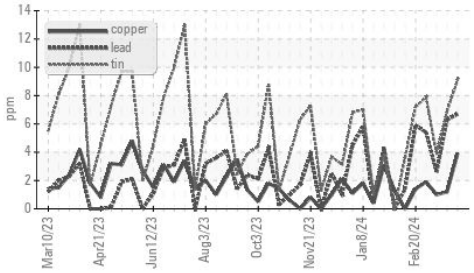

FT-IR (Direct Trend)

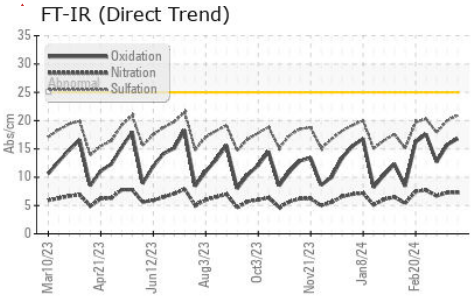

Acid Number

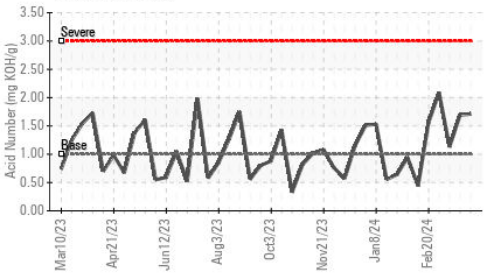

Acid Number

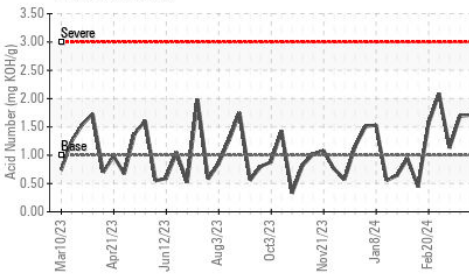

Base Number

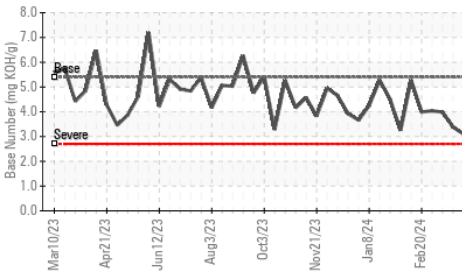

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	**14.0**	13.9	13.7

GRAPHS

Iron (ppm)

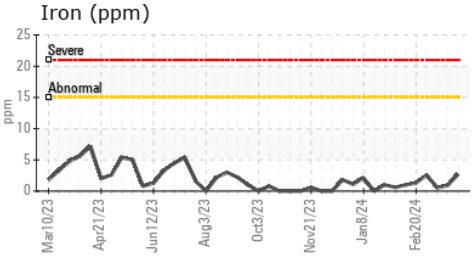

Lead (ppm)

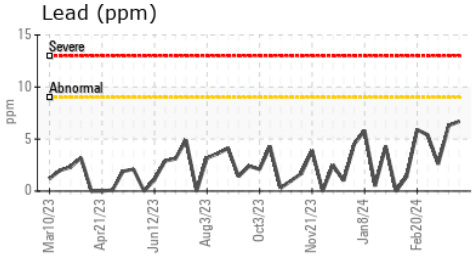

Aluminum (ppm)

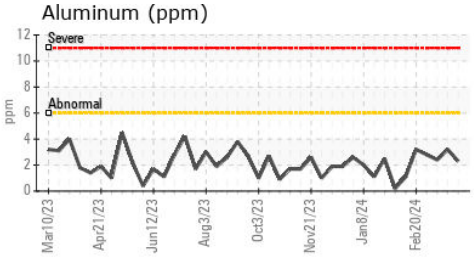

Chromium (ppm)

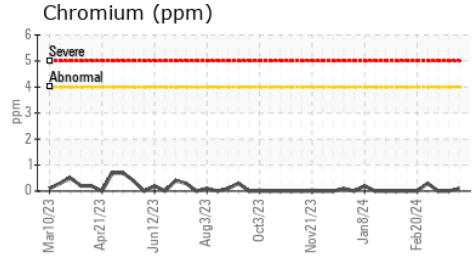

Copper (ppm)

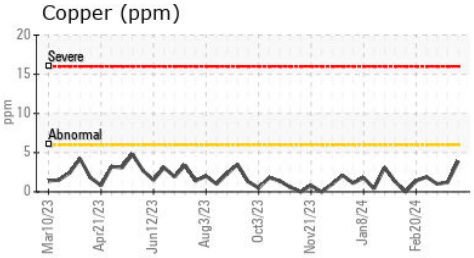

Silicon (ppm)

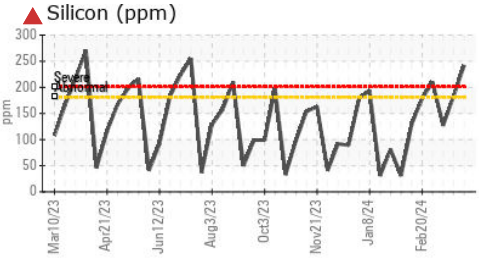

Viscosity @ 100°C

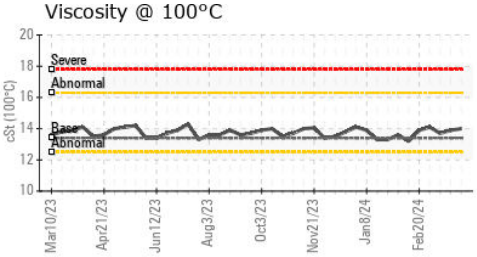

Base Number

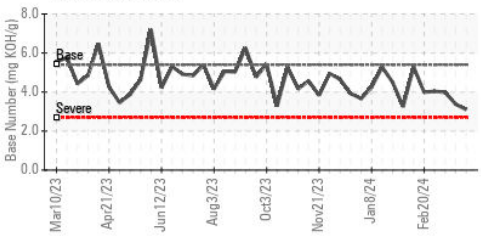

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0871574
Lab Number : 06156195
Unique Number : 10991618
Test Package : MOB 2

Received : 22 Apr 2024
Tested : 23 Apr 2024
Diagnosed : 24 Apr 2024 - Sean Felton

Certificate L2367

EDL NA Recips-Coopersville
Coopersville Powerstation, 15362 68th Avenue
Coopersville, MI
US 49404
Contact: Daniel Young
daniel.young@edlenergy.com
T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)