




OIL ANALYSIS REPORT

Machine Id
Coopersville CAT 6 CPVM06BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (105 GAL)

Sample Rating Trend

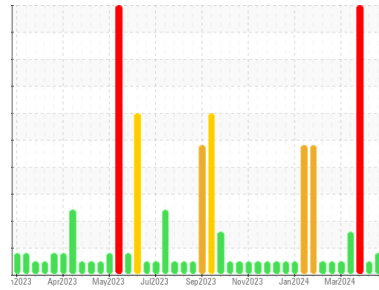

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 The copper level is abnormal. All other component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0871573	WC0871561	WC0871504
Sample Date	Client Info		18 Apr 2024	09 Apr 2024	20 Mar 2024
Machine Age	hrs	Client Info	32202	31990	31510
Oil Age	hrs	Client Info	212	1	810
Oil Changed	Client Info		Not Chngd	Changed	Not Chngd
Sample Status			ABNORMAL	NORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	1	1	2
Chromium	ppm	ASTM D5185m >4	<1	<1	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >6	<1	2	3
Lead	ppm	ASTM D5185m >9	0	2	2
Copper	ppm	ASTM D5185m >6	▲ 8	2	7
Tin	ppm	ASTM D5185m >4	3	3	▲ 7
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	2	3
Barium	ppm	ASTM D5185m	1	0	0
Molybdenum	ppm	ASTM D5185m	2	3	4
Manganese	ppm	ASTM D5185m	1	<1	<1
Magnesium	ppm	ASTM D5185m	8	6	10
Calcium	ppm	ASTM D5185m	1790	1766	1911
Phosphorus	ppm	ASTM D5185m	268	269	310
Zinc	ppm	ASTM D5185m	323	324	364
Sulfur	ppm	ASTM D5185m	2167	2040	2351

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	97	31	▲ 201
Sodium	ppm	ASTM D5185m >21	2	<1	2
Potassium	ppm	ASTM D5185m >20	0	3	4

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0	0
Nitration	Abs/cm	*ASTM D7624	5.9	5.0	7.6
Sulfation	Abs/.1mm	*ASTM D7415	16.5	15.2	19.9


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	10.0	8.4	16.8
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.45	0.603	1.62
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	4.32	5.00	4.89




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

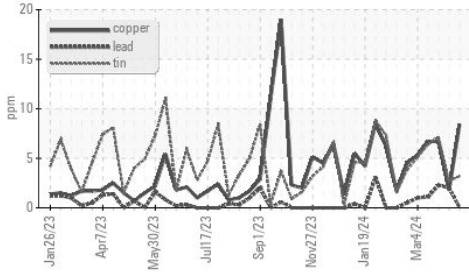


FT-IR (Direct Trend)

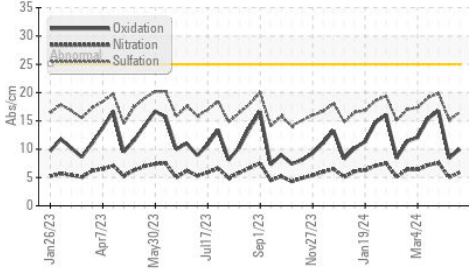


Acid Number

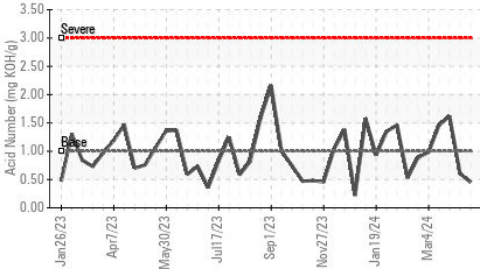

Base Number

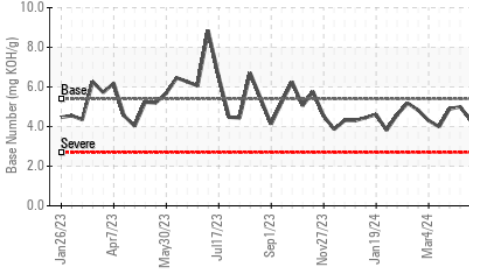









Viscosity @ 100°C

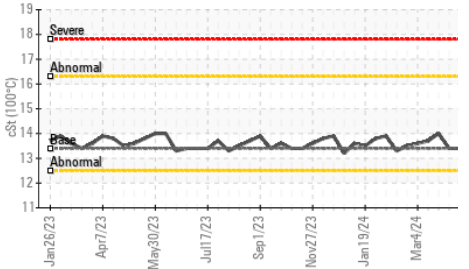

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.4	14.0

GRAPHS

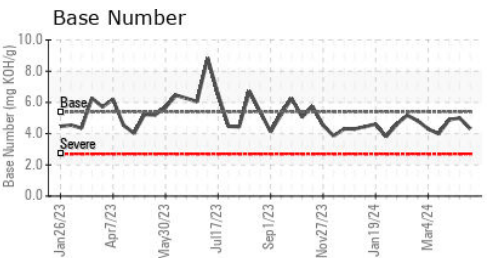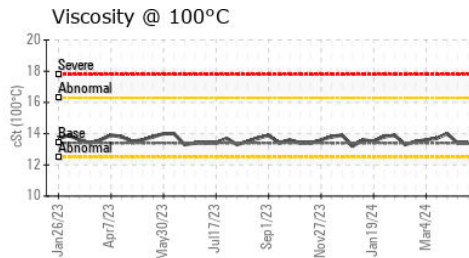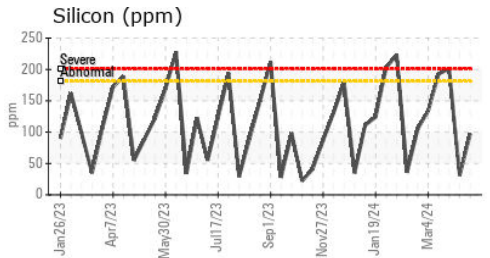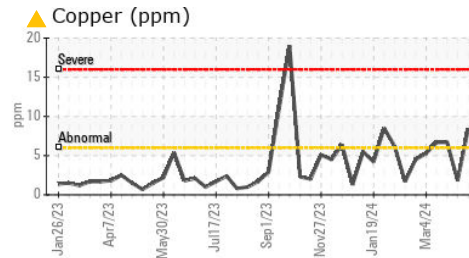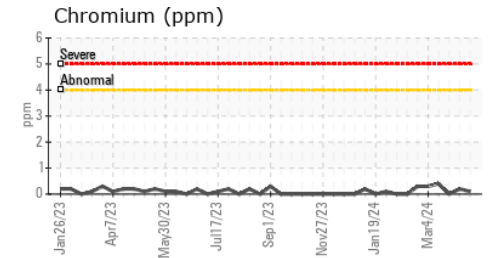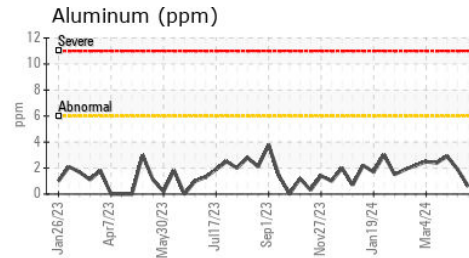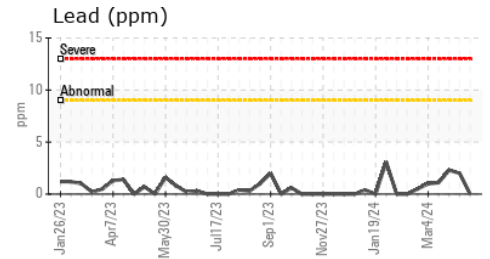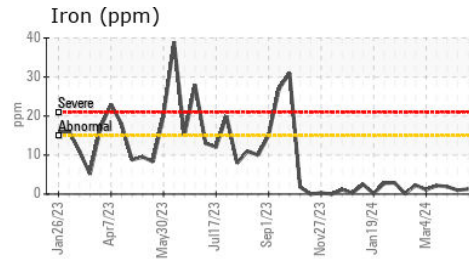

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0871573
Lab Number : 06156196
Unique Number : 10991619
Test Package : MOB 2

Received : 22 Apr 2024
Tested : 23 Apr 2024
Diagnosed : 24 Apr 2024 - Sean Felton

EDL NA Recips-Coopersville
 Coopersville Powerstation, 15362 68th Avenue
 Coopersville, MI
 US 49404

Contact: Daniel Young
 daniel.young@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: