




OIL ANALYSIS REPORT

Sample Rating Trend

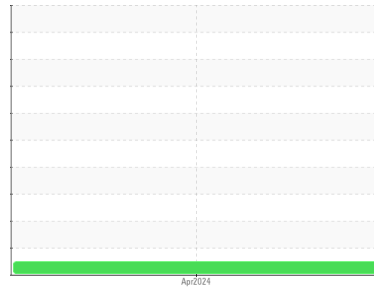

NORMAL



Machine Id
TOTE 3 - CHEVRON RANDO HD 32
 Component
New (Unused) Oil
 Fluid
CHEVRON RANDO HD 32 (300 GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PH0002898	---	---
Sample Date	Client Info			17 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			NEG	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		44	---	---
Phosphorus	ppm	ASTM D5185m		356	---	---
Zinc	ppm	ASTM D5185m		435	---	---
Sulfur	ppm	ASTM D5185m		990	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---






FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	348	---	---
Particles >6µm		ASTM D7647	>1300	82	---	---
Particles >14µm		ASTM D7647	>160	4	---	---
Particles >21µm		ASTM D7647	>40	2	---	---
Particles >38µm		ASTM D7647	>10	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/14/9	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.43	---	---

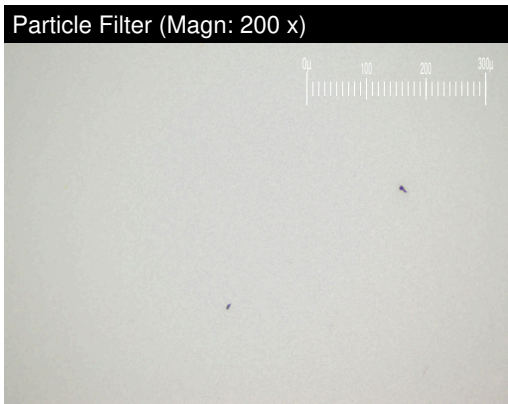



OIL ANALYSIS REPORT

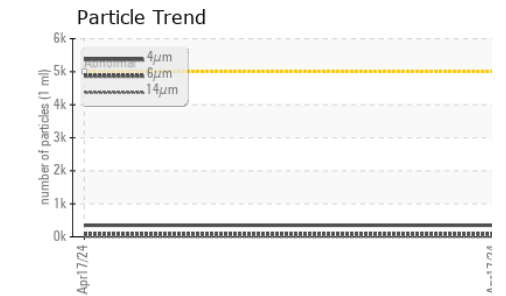
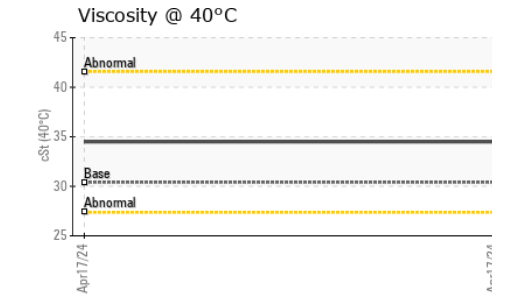
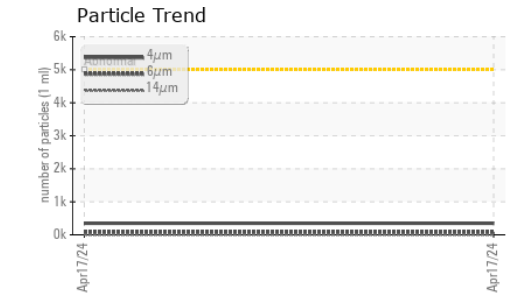
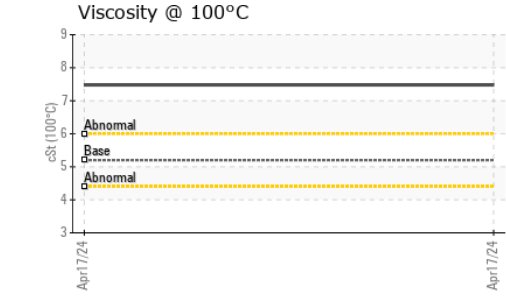
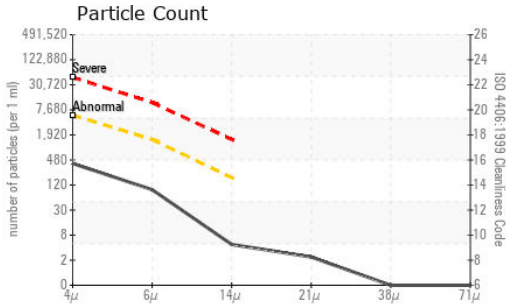


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	30.4	34.49	---
Visc @ 100°C	cSt	ASTM D445	5.2	7.48	---
Viscosity Index (VI)	Scale	ASTM D2270	99	192	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				<i>no image</i>	<i>no image</i>
Bottom				<i>no image</i>	<i>no image</i>
PrtFilter				<i>no image</i>	<i>no image</i>

GRAPHS

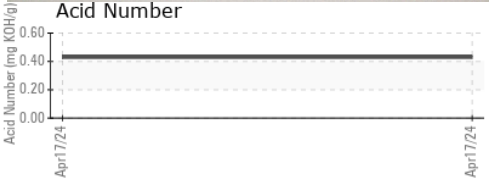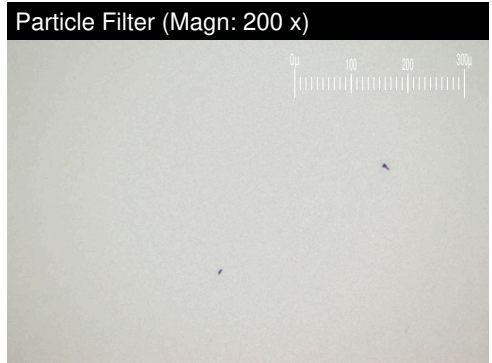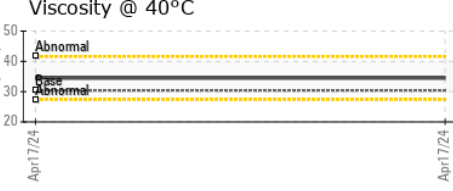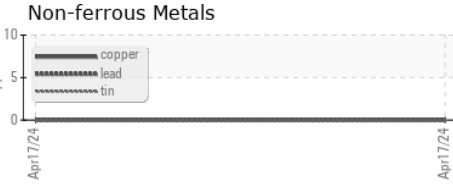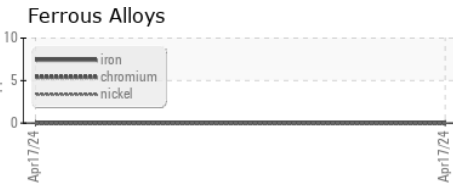

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH0002898 **Received** : 22 Apr 2024
Lab Number : **06156511** **Tested** : 26 Apr 2024
Unique Number : 10991934 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtFilter, VI)

SUPER PRODUCTS
 130 W BEXHORN DR
 MUKWONAGO, WI
 US 53149
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: