



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area
{UNASSIGNED} [Comp 2 Top]
 Machine Id
N/A Citgo Hydurance AW 32 Comp1
 Component
Top Fluid
 Fluid
CITGO AW HYDRAULIC ISO 32 (2800 GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. (Customer Sample Comment: Please rush same day analysis)

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KFS0005059	---	---
Sample Date	Client Info			19 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ATTENTION	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		0	---	---
Chromium	ppm	ASTM D5185m		0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m		0	---	---
Lead	ppm	ASTM D5185m		0	---	---
Copper	ppm	ASTM D5185m		0	---	---
Tin	ppm	ASTM D5185m		0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		0	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		41	---	---
Phosphorus	ppm	ASTM D5185m		295	---	---
Zinc	ppm	ASTM D5185m		407	---	---
Sulfur	ppm	ASTM D5185m		999	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		5	---	---
Sodium	ppm	ASTM D5185m		0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	3615	---	---
Particles >6µm		ASTM D7647	>1300	1531	---	---
Particles >14µm		ASTM D7647	>160	152	---	---
Particles >21µm		ASTM D7647	>40	38	---	---
Particles >38µm		ASTM D7647	>10	2	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	19/18/14	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.43	---	---

OIL ANALYSIS REPORT

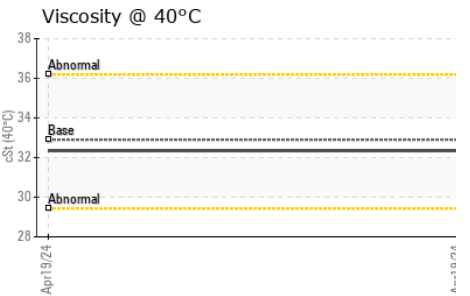
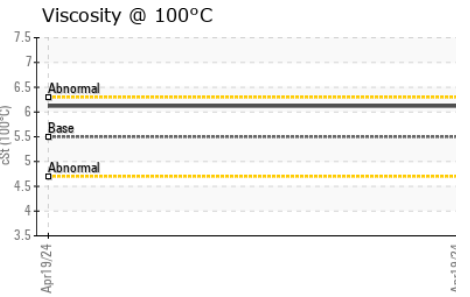
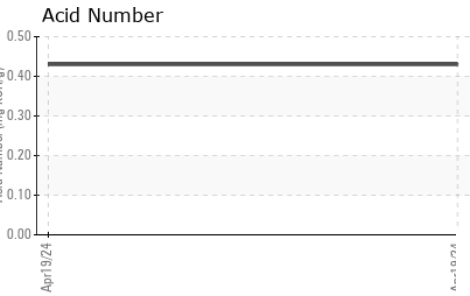
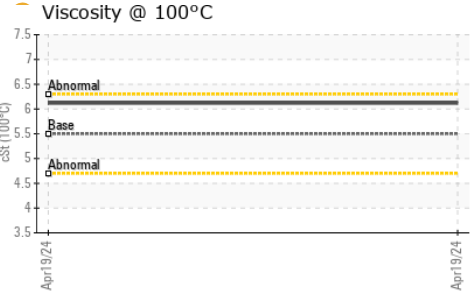
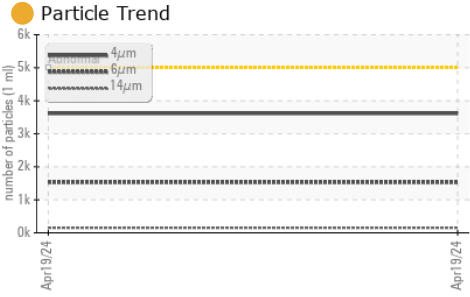


VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	32.9	32.35	---	---
Visc @ 100°C	cSt	ASTM D445	5.5	6.12	---	---
Viscosity Index (VI)	Scale	ASTM D2270	102	139	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

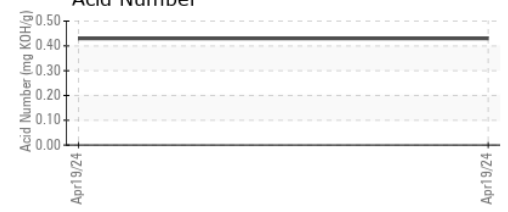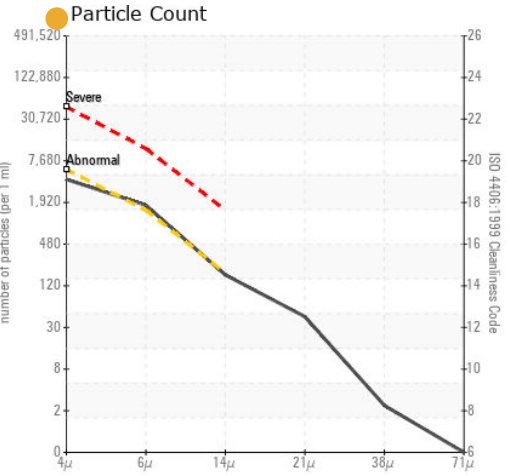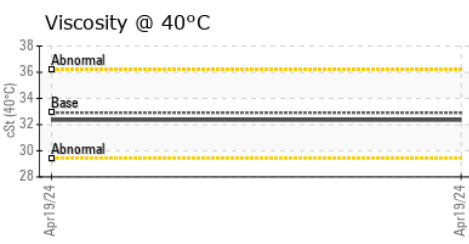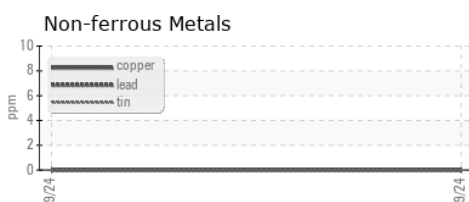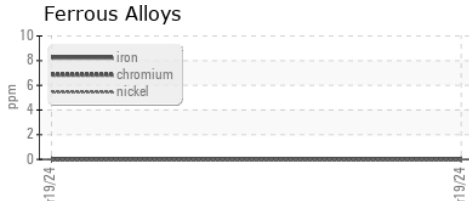

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KFS0005059 **Received** : 22 Apr 2024
Lab Number : **06156566** **Tested** : 22 Apr 2024
Unique Number : 10991989 **Diagnosed** : 22 Apr 2024 - Doug Bogart
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

KIMBRO OIL COMPANY
 2200 CLIFTON AVE
 NASHVILLE, TN
 US 37203
 Contact: CHRIS HIGGINS
 chiggins@kimbrooil.com
 T: (270)305-1347
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)