

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 5088629

Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013697		
Sample Date		Client Info		16 Apr 2024		
Machine Age	hrs	Client Info		11200		
Oil Age	hrs	Client Info		1175		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel		ASTM D5185m	>3	<1		
	ppm					
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	96		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	<1		
Zinc	ppm	ASTM D5185m	0	4		
Sulfur	ppm	ASTM D5185m	23500	30463		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	185		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2646		
Particles >6µm		ASTM D7647	>1300	770		
Particles >14µm		ASTM D7647	>80	51		
Particles >21µm		ASTM D7647	>20	14		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40		
AGU NUMBEL (AN)	iiiy K∪⊓/ÿ	A0 HVI D0040	1.0	0.40		



OIL ANALYSIS REPORT

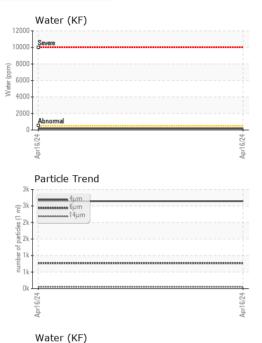

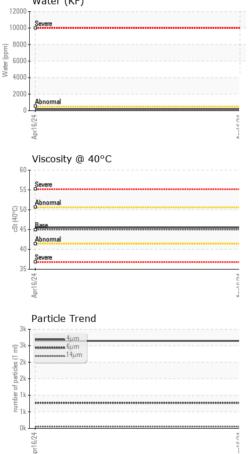

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
√isc @ 40°C	cSt	ASTM D445	45	45.5		
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Color					no image	no image
					0	0
				115 200		
Bottom					no image	no image
GRAPHS						
Ferrous Alloys			101 50	Particle Coun	t	
iron			491,52	U T		T ²⁶
ananananan chromium			122,88	0 -		-24
			30,72			-22
1 1 1			50,72			T
			7,68	0-		-20
Apr16/24			Apr16/24 : (per 1 ml)			+18
Ap			Ap les (p			
Non-ferrous Metal	S		otured 48			-16
copper			Apr16/24 Apr16/24 15 15 16 17 10 18			-14
tin					~	
			3	U-		-12
				⁸ Bibrevernal		-10
54				2		
Apr16/24			Apr16/24			
			A	0 4μ 6μ	14µ 21µ	38µ 71µ
Viscosity @ 40°C				Acid Number		
Severe			_Э 1.2 Но 9	Basemal		
Abnormal			<u>ي</u> 0.0 ق0.7	2		
Base Abnormal			-e 0.4	8-		
Abnormal Base Abnormal Severe			(0) HOX Bu 0.7 Gu 0.4 Mum ba Mum 0.4 N 0.2 V 0.2	4-		
L.						
Apr16/24			Apr16/24	Apr16/2 ⁴		
A			A	Å		
earCheck USA - 50						SERVICES IN
CPA013697	Rece		2 Apr 2024	8801 W	ASHINGTON BL	
156902	Teste		3 Apr 2024	ala Davalla	R	OSEVILLE, C
992325	Diagr	nosed : 24	Apr 2024 - Ang	ela Borella		US 9567



To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Laboratory

Sample No.

Lab Number Unique Number

Contact/Location: MELISSA MONKS - POWROS

Т:

F:

Contact: MELISSA MONKS

melissamonks@poweron.com