




# OIL ANALYSIS REPORT

Sample Rating Trend

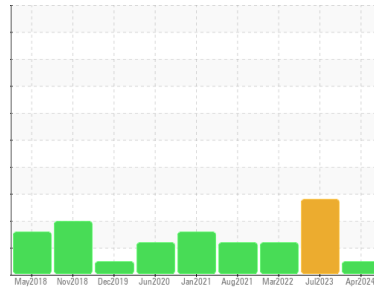

**NORMAL**



Machine Id  
**KAESER ASD 40 3801748 (S/N 1322)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA017134</b>	KCPA005583	KCP45315
Sample Date	Client Info			<b>10 Apr 2024</b>	20 Jul 2023	30 Mar 2022
Machine Age	hrs	Client Info		<b>109083</b>	105328	98116
Oil Age	hrs	Client Info		<b>3755</b>	0	5050
Oil Changed	Client Info			<b>Changed</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	<b>5</b>	7	13
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>6</b>	11	31
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>73</b>	68	94
Calcium	ppm	ASTM D5185m	0	<b>0</b>	5	17
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	3	4
Zinc	ppm	ASTM D5185m	0	<b>17</b>	25	39
Sulfur	ppm	ASTM D5185m	23500	<b>21537</b>	21555	17622

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	1	<1
Sodium	ppm	ASTM D5185m		<b>35</b>	25	69
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	2	6
Water	%	ASTM D6304	>0.05	<b>0.024</b>	▲ 0.091	0.018
ppm Water	ppm	ASTM D6304	>500	<b>246</b>	▲ 911	186.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1866</b>	6595	4342
Particles >6µm		ASTM D7647	>1300	<b>470</b>	▲ 2818	▲ 1715
Particles >14µm		ASTM D7647	>80	<b>46</b>	▲ 150	▲ 254
Particles >21µm		ASTM D7647	>20	<b>13</b>	16	▲ 27
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/13</b>	▲ 20/19/14	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.38</b>	0.39	0.39


# OIL ANALYSIS REPORT

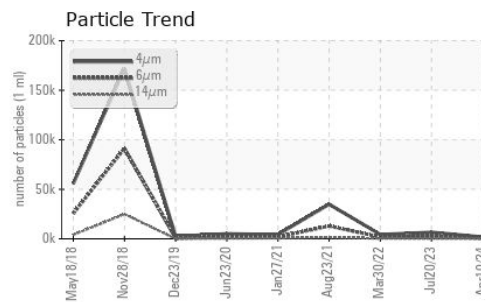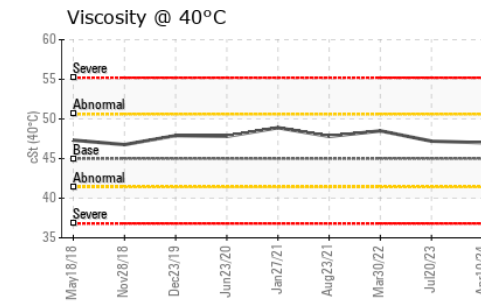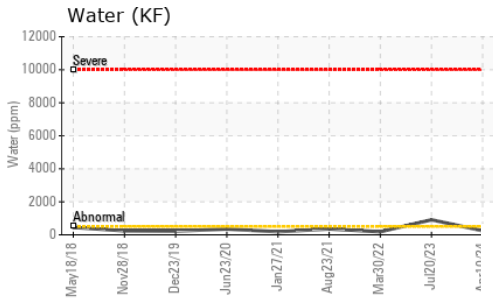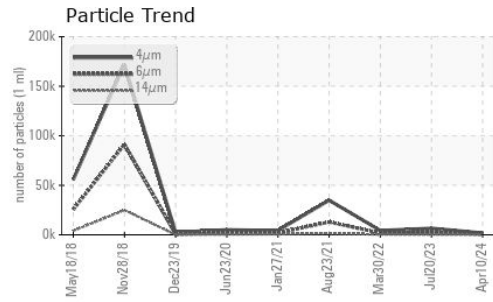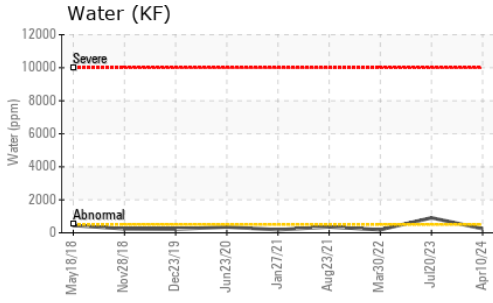






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	47.0	47.2	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

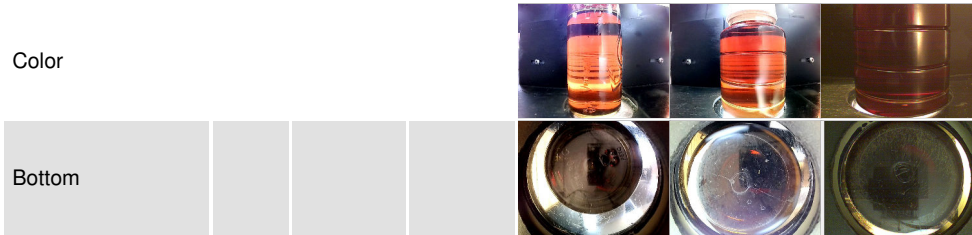

## GRAPHS

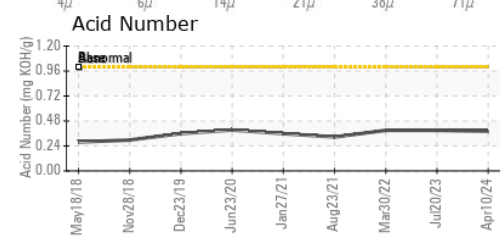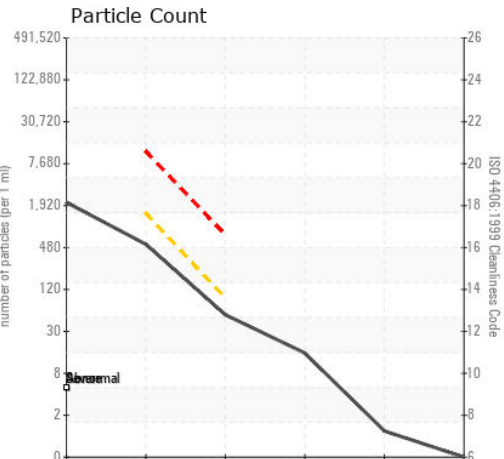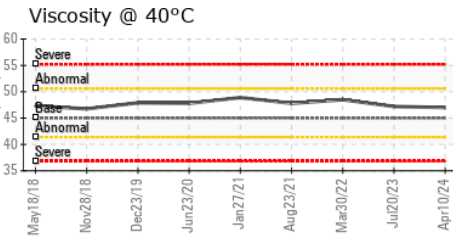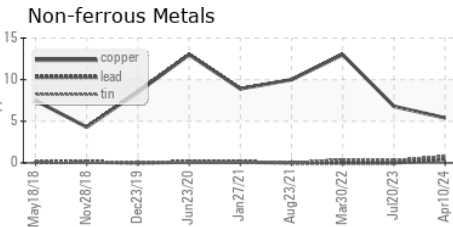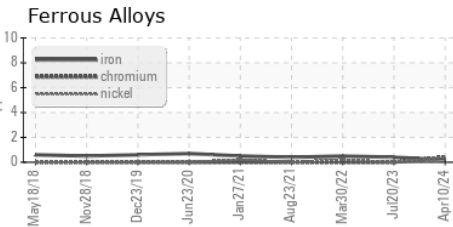

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA017134  
**Lab Number** : 06156921  
**Unique Number** : 10992344  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 22 Apr 2024  
**Tested** : 23 Apr 2024  
**Diagnosed** : 24 Apr 2024 - Angela Borella

**STANDARD OFFSET**  
 500 E OREGON RD  
 LANCASTER, PA  
 US 17543  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: