




OIL ANALYSIS REPORT

Sample Rating Trend

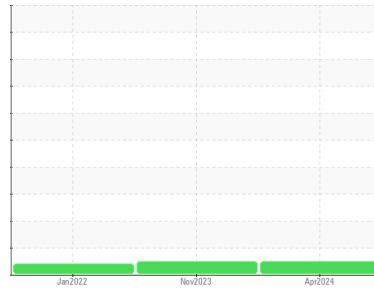

NORMAL



Machine Id

KAESER 6168880

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA013711	KCP54286	KCP39564
Sample Date	Client Info			22 Apr 2024	03 Nov 2023	24 Jan 2022
Machine Age	hrs	Client Info		35040	33144	23626
Oil Age	hrs	Client Info		0	3000	3000
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				NORMAL	NORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	2	1	14
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m		---	---	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	49	63	74
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	80	75	78
Calcium	ppm	ASTM D5185m	0	0	1	3
Phosphorus	ppm	ASTM D5185m	0	0	0	3
Zinc	ppm	ASTM D5185m	0	2	5	14
Sulfur	ppm	ASTM D5185m	23500	21915	20153	21162

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	1
Sodium	ppm	ASTM D5185m		21	25	42
Potassium	ppm	ASTM D5185m	>20	6	4	15
Water	%	ASTM D6304	>0.05	0.033	0.025	0.019
ppm Water	ppm	ASTM D6304	>500	339	255	190.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6125	1567	2760
Particles >6µm		ASTM D7647	>1300	1267	276	695
Particles >14µm		ASTM D7647	>80	76	15	44
Particles >21µm		ASTM D7647	>20	16	6	7
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/17/13	18/15/11	17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41	0.35	0.41


OIL ANALYSIS REPORT

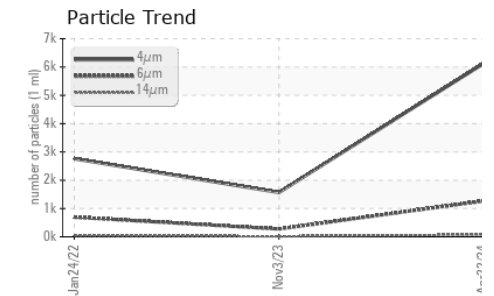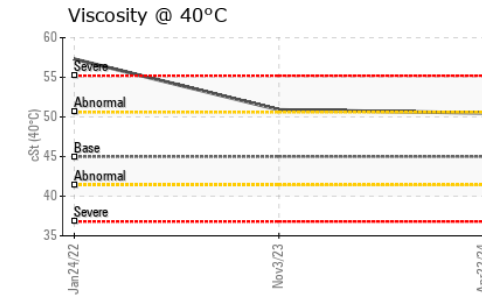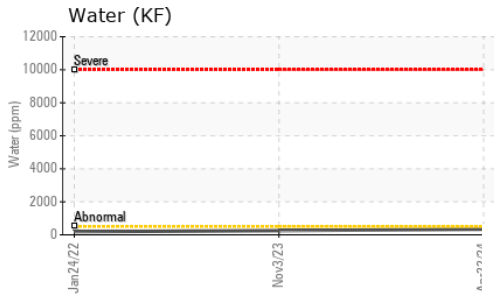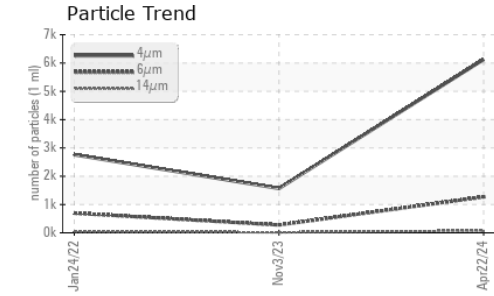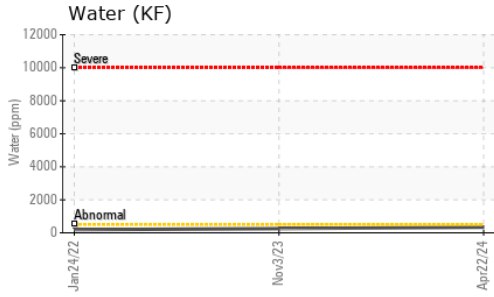





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	50.5	50.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

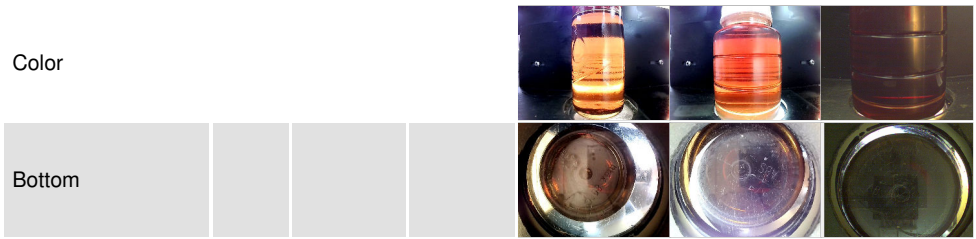

GRAPHS

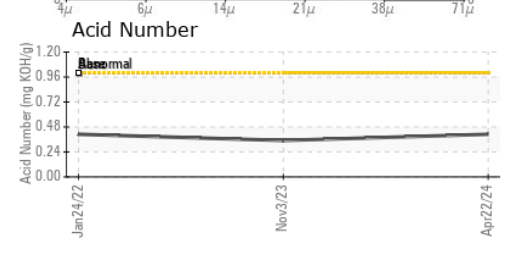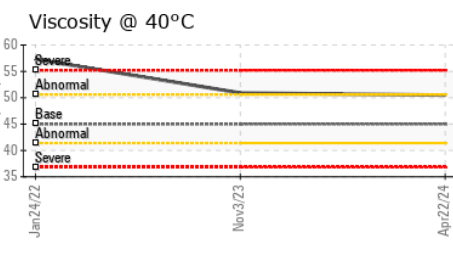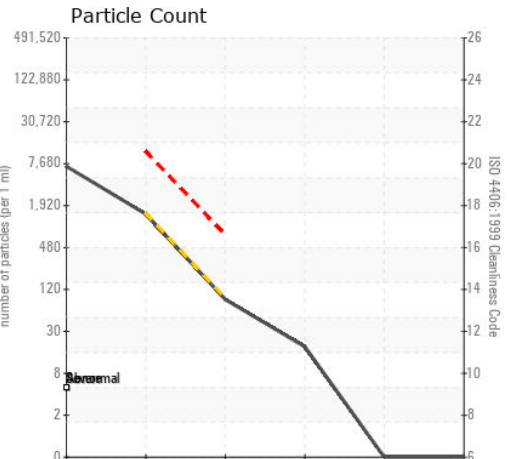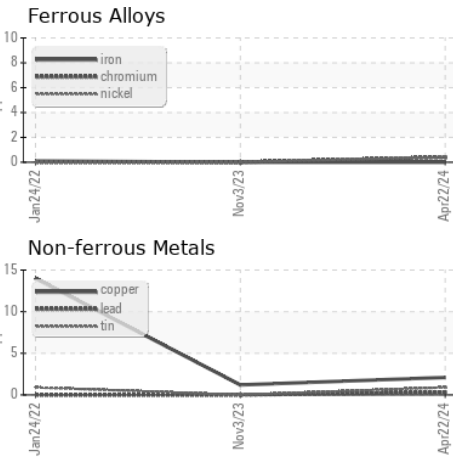

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013711 **Received** : 22 Apr 2024
Lab Number : 06156923 **Tested** : 23 Apr 2024
Unique Number : 10992346 **Diagnosed** : 24 Apr 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON
 3575 S ORANGE AVE
 FRESNO, CA
 US 93725
 Contact: Service Manager
 favjazmi@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)