




OIL ANALYSIS REPORT

Sample Rating Trend

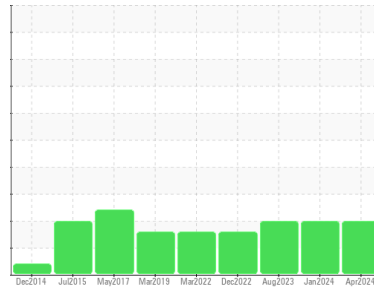

ISO



Machine Id

KAESER SK 15 4990688 (S/N 1604)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA012521	KCPA006545	KCPA004279
Sample Date	Client Info	17 Apr 2024	04 Jan 2024	18 Aug 2023
Machine Age	hrs	64481	62188	59303
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Changed	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	<1	0	0
Aluminum	ppm	ASTM D5185m >10	3	0	4
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	5	8	7
Tin	ppm	ASTM D5185m >10	<1	0	<1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	11	0	2
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	33	9	39
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	0	6	4
Zinc	ppm	ASTM D5185m	21	25	14
Sulfur	ppm	ASTM D5185m	19399	17361	20951

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	0	<1
Sodium	ppm	ASTM D5185m	8	5	9
Potassium	ppm	ASTM D5185m >20	3	<1	4
Water	%	ASTM D6304 >0.05	0.013	0.014	0.016
ppm Water	ppm	ASTM D6304 >500	136	149	169.9






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	13071	20164	25905
Particles >6µm	ASTM D7647 >1300	▲ 4481	▲ 11847	▲ 11714
Particles >14µm	ASTM D7647 >80	▲ 585	▲ 3771	▲ 2505
Particles >21µm	ASTM D7647 >20	▲ 161	▲ 939	▲ 807
Particles >38µm	ASTM D7647 >4	● 7	▲ 19	▲ 31
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/19/16	▲ 22/21/19	▲ 22/21/19

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.40	0.33	0.35

OIL ANALYSIS REPORT

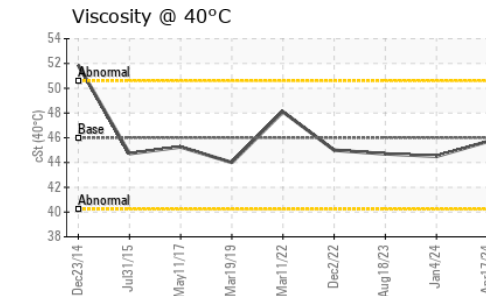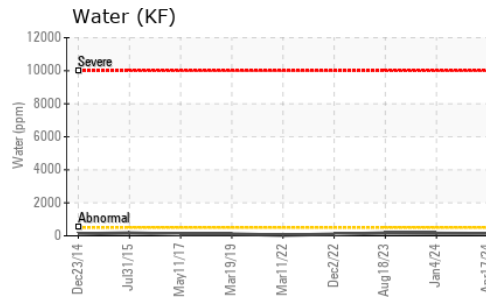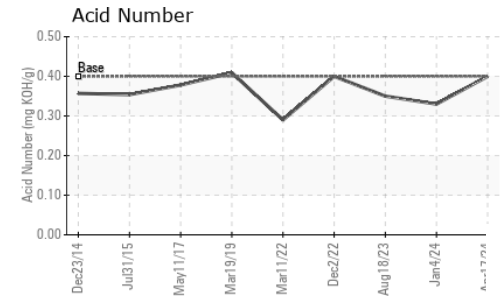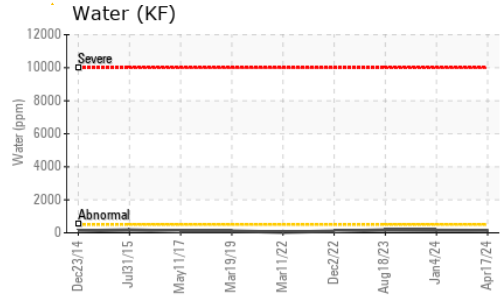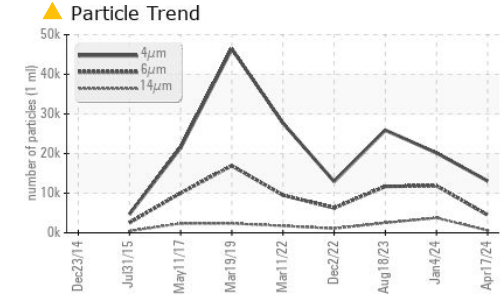





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.7	44.5

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

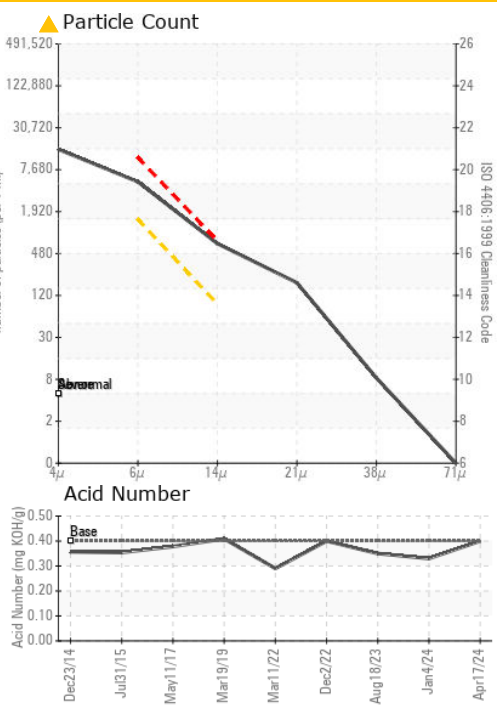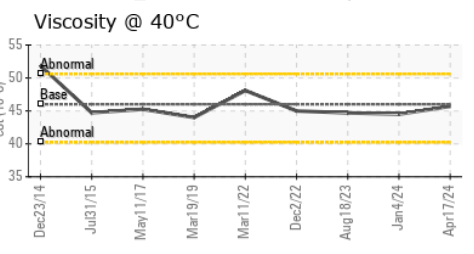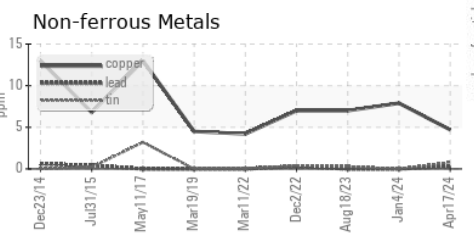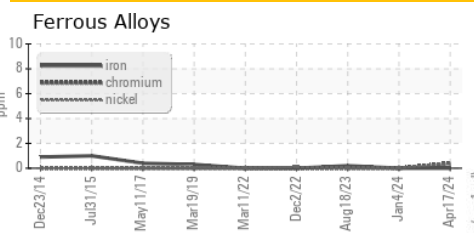

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012521 **Received** : 22 Apr 2024
Lab Number : 06156924 **Tested** : 23 Apr 2024
Unique Number : 10992347 **Diagnosed** : 24 Apr 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ASSOCIATED FEED & SUPPLY
 5213 W MAIN ST
 TURLOCK, CA
 US 95380-9413
 Contact: J. SARTIN
 jsartin@associatedfeed.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)