

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER SK20 8485614 (S/N 1805)

Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017145	KCP46105	
Sample Date		Client Info		10 Apr 2024	28 Dec 2022	
Machine Age	hrs	Client Info		8864	3397	
Oil Age	hrs	Client Info		3163	0	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	3	<1	
Lead	ppm	ASTM D5185m	>10	1	0	
Copper		ASTM D5185m	>50	7	4	
Tin	ppm	ASTM D5185m	>50 >10	، <1	4 <1	
	ppm		>10			
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	13	31	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	70	71	
Calcium	ppm	ASTM D5185m	0	2	13	
Phosphorus	ppm	ASTM D5185m	0	0	5	
Zinc	ppm	ASTM D5185m	0	2	2	
Sulfur	ppm	ASTM D5185m	23500	21367	20227	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	<1	
Sodium	ppm	ASTM D5185m		50	33	
Potassium	ppm	ASTM D5185m	>20	12	14	
Water	%	ASTM D6304	>0.05	0.027	0.021	
ppm Water	ppm	ASTM D6304	>500	276	211.3	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		28974	3926	
Particles >6µm		ASTM D7647	>1300	<u> </u>	743	
Particles >14µm		ASTM D7647	>80	A 289	36	
Particles >21µm		ASTM D7647	>20	<u> </u>	8	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>A</u> 22/20/15	19/17/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	0.27	
AGIG MUTTIDEL (AIN)	my nony	A0 HVI D0040	1.0	0.54	0.21	




Built for a lifetime

OIL ANALYSIS REPORT



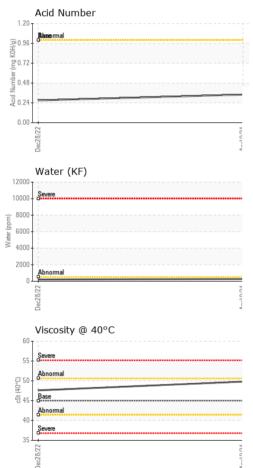

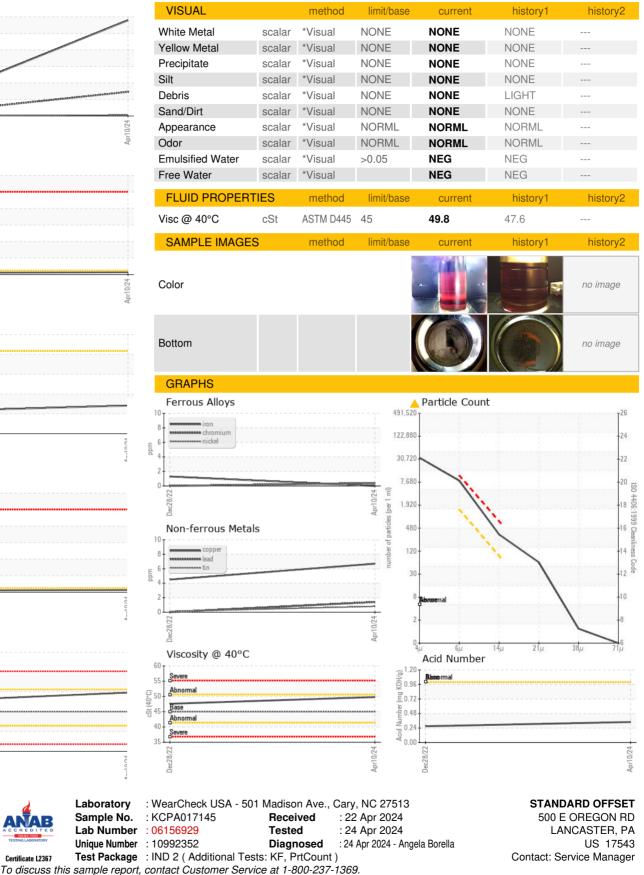

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Contact/Location: Service Manager - STALANPA

T:

F: