


OIL ANALYSIS REPORT

Sample Rating Trend

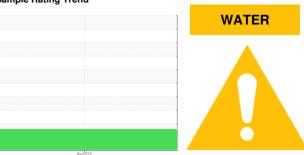

Machine Id

KAESER SM 10T 4549499 (S/N 1089)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017114		
Sample Date		Client Info		09 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
·		una natio na ni	l::		la i a ta musel	history.O
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	36		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		7		
Sulfur	ppm	ASTM D5185m		20497		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1	,	,
Sodium	ppm	ASTM D5185m	>20	11		
	ppm		. 20			
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304 ASTM D6304	>0.05	△ 0.055 △ 551		
ppm Water	ppm		>500			
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10409		
Particles >6µm		ASTM D7647		1136		
Particles >14µm		ASTM D7647	>80	55		
Particles >21µm		ASTM D7647	>20	17		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	21/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34		



OIL ANALYSIS REPORT

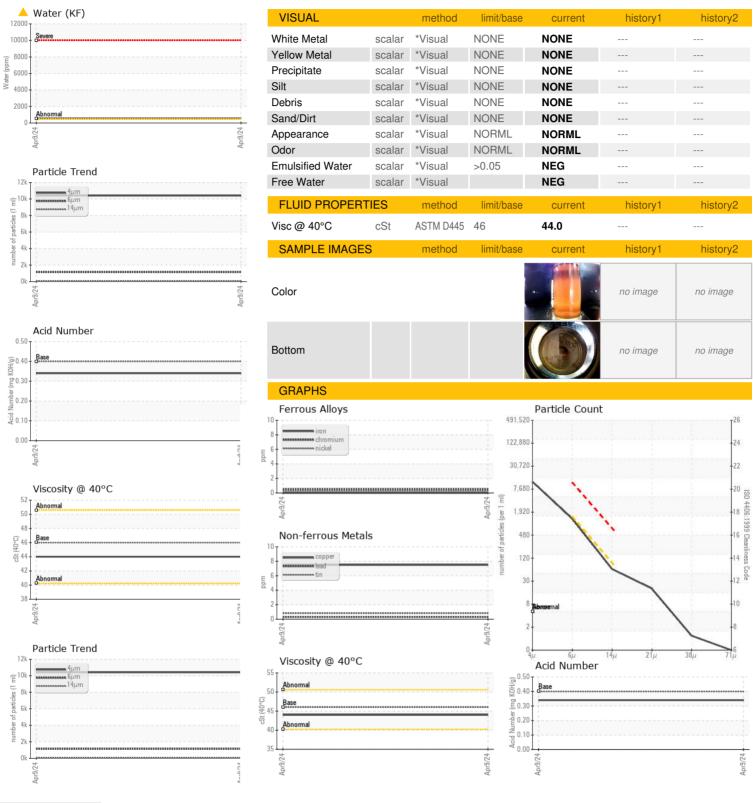



Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA017114 Lab Number : 06156933

Unique Number: 10992356

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Received : 22 Apr 2024 Tested Diagnosed

: 24 Apr 2024

: 24 Apr 2024 - Angela Borella

Kaeser Compressor - Minneapolis Ops 7574 MARKET PL DR EDEN PRAIRIE, MN US 55344

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: KAEEDE [WUSCAR] 06156933 (Generated: 04/24/2024 18:49:01) Rev: 1

Contact/Location: SERVICE MANAGER ? - KAEEDE

T:

F: