


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

6857423 (S/N 1071) Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Maž021 Jarž023 Aprž024				
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013576	KCP53121	KCP34656
Sample Date		Client Info		16 Apr 2024	20 Jan 2023	24 Mar 2021
Machine Age	hrs	Client Info		12810	0	3848
Oil Age	hrs	Client Info		0	0	3848
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ATTENTION	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	3	<1	0
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	8	12	5
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	19	12	31
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	0	0	8	1
Zinc	ppm	ASTM D5185m	0	94	69	50
Sulfur	ppm	ASTM D5185m	23500	19901	19947	15988
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	0
Sodium	ppm	ASTM D5185m		3	2	5
Potassium	ppm	ASTM D5185m	>20	3	0	2
Water	%	ASTM D6304	>0.05	0.012	△ 0.513	0.012
ppm Water	ppm	ASTM D6304	>500	127	<u></u> 5130	125.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5033		11609
Particles >6µm		ASTM D7647	>1300	<u> </u>		2240
Particles >14µm		ASTM D7647	>80	120		132
Particles >21µm		ASTM D7647	>20	30		3 0
Particles >38µm		ASTM D7647	>4	2		2
Particles >71µm		ASTM D7647	>3	0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/14		18/14
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2

0.44



OIL ANALYSIS REPORT

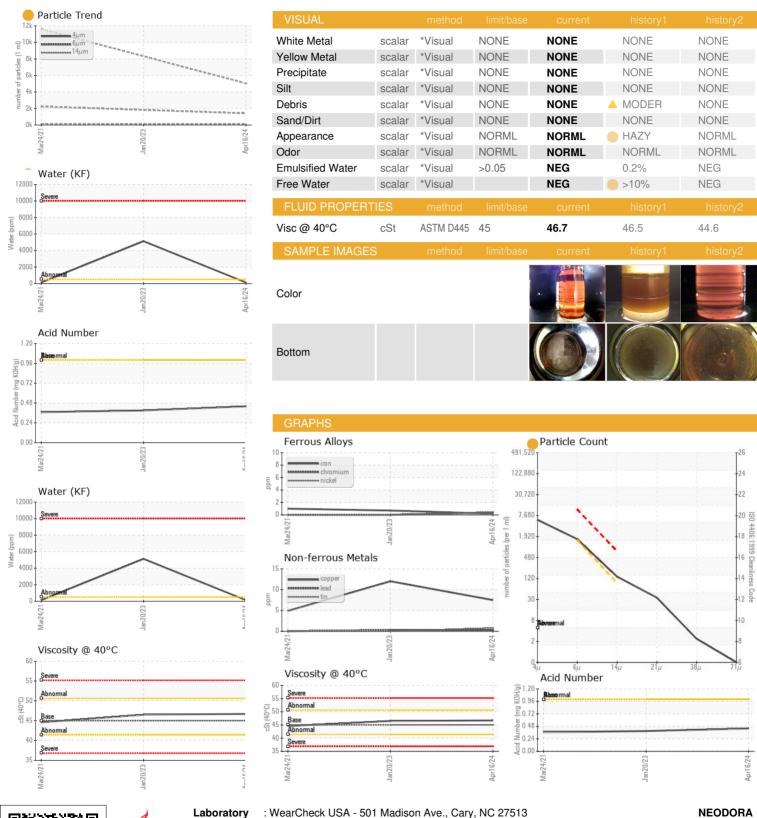





Certificate 12367

Laboratory

: 06156950

Sample No. : KCPA013576 Lab Number

Unique Number : 10992373

Received : 22 Apr 2024 **Tested** : 23 Apr 2024 Diagnosed

: 24 Apr 2024 - Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - NEOSANCA

1545 BERGER DR

Contact: Service Manager

SAN JOSE, CA

US 95112

T:

F: