


## **OIL ANALYSIS REPORT**

Sample Rating Trend

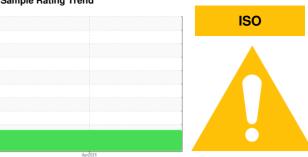

Machine Id

# KAESER ASD 40T 7621869 (S/N 1185)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

## **DIAGNOSIS**

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017192		
Sample Date		Client Info		17 Apr 2024		
Machine Age	hrs	Client Info		2739		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm		>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m		3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m		2		
Tin		ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m	>10	<1 <1		
	ppm					
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	9		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	71		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		10		
Sulfur	ppm	ASTM D5185m		20503		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.031		
ppm Water	ppm	ASTM D6304	>500	314		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7518		
Particles >6µm		ASTM D7647	>1300	<b>2820</b>		
Particles >14µm		ASTM D7647	>80	<b>▲</b> 425		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	10		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 20/19/16		
	TION	. ,			historyd	history
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37		



# **OIL ANALYSIS REPORT**







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017192 : 06156951 Unique Number : 10992374

Received : 22 Apr 2024 **Tested** Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 26 Apr 2024

: 26 Apr 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: Contact/Location: Service Manager - 84LSAN

331 RIVERSIDE DR

SAN ANTONIO, TX

Contact: Service Manager

US 78210

T: