

## **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO

#### Area **NOT** GIVEN Machine Id **A4-N** Component Gearbox

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06156983		
Sample Date		Client Info		22 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	53		
Chromium	ppm	ASTM D5185m	>15	<1		
Nickel	ppm	ASTM D5185m	>15	<1		
Titanium	ppm	ASTM D5185m		1		
Silver	ppm	ASTM D5185m		<1		
Aluminum	ppm	ASTM D5185m	>25	3		
Lead	ppm	ASTM D5185m	>100	<1		
Copper	ppm	ASTM D5185m	>200	<1		
Tin	ppm	ASTM D5185m	>25	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		6		
Phosphorus	ppm	ASTM D5185m		436		
Zinc	ppm	ASTM D5185m		6		
Sulfur	ppm	ASTM D5185m		580		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	7		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.2	0.00		
ppm Water	ppm	ASTM D6304	>2000	0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>A</b> 184031		
Particles >6µm		ASTM D7647	>5000	<u> </u>		
Particles >14µm		ASTM D7647	>640	<b>A</b> 3452		
Particles >21µm		ASTM D7647	>160	<u> </u>		
Particles >38µm		ASTM D7647	>40	8		
Particles >71µm		ASTM D7647	>10	1		
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>4</b> 25/24/19		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.14		



# **OIL ANALYSIS REPORT**


method

limit/base

current

history1

history2

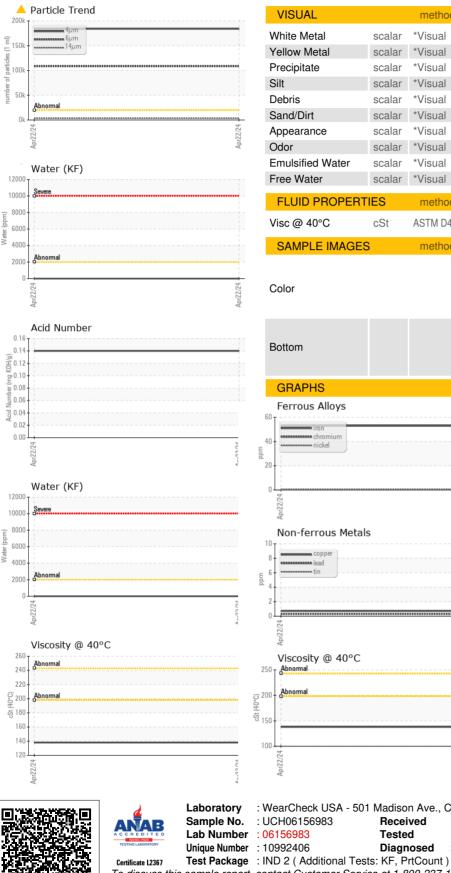

NONE \*Visual NONE scalar \*Visual NONE NONE scalar NONE scalar \*Visua NONE scalar \*Visual NONE NONE \*Visual NONE NONE scalar NONE scalar \*Visual NONE NORML \*Visual NORML scalar \*Visual NORML NORML scalar \*Visual scalar >0.2 NEG scalar \*Visual NEG method limit/base current history history cSt ASTM D445 138 method limit/base history1 current history2 no image no image no image no image Particle Count 491.52 122,88 30.72 7.68 (per 1 ml) Apr22/24 4406 1,920 1999 480 120 31 un 22/7 214 38,4 Acid Number 0.1 (mg KOH/g) Ê 0.05 Acid 0.00 Apr22/24 0100 m : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **CORROSION PRODUCTS & EQUIPMENT INC** Received : 22 Apr 2024 110 ELMGROVE PARK Tested ROCHESTER, NY : 23 Apr 2024 Diagnosed : 25 Apr 2024 - Jonathan Hester US 14624 Contact: Bill Cox

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCCORROC [WUSCAR] 06156983 (Generated: 04/25/2024 08:00:05) Rev: 1

Contact/Location: Bill Cox - UCCORROC

cox@corrosion-products.com

T: (585)455-7978

F: (585)247-7268