



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area  
**NOT GIVEN**  
 Machine Id  
**A2-S**  
 Component  
**Gearbox**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06156992</b>	---	---
Sample Date	Client Info		<b>22 Apr 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>21</b>	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---
Aluminum	ppm	ASTM D5185m	>25	<b>3</b>	---
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	---
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	---
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---
Barium	ppm	ASTM D5185m		<b>0</b>	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---
Magnesium	ppm	ASTM D5185m		<b>4</b>	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---
Phosphorus	ppm	ASTM D5185m		<b>626</b>	---
Zinc	ppm	ASTM D5185m		<b>1</b>	---
Sulfur	ppm	ASTM D5185m		<b>960</b>	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>12</b>	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---
Water	%	ASTM D6304	>0.2	<b>0.00</b>	---
ppm Water	ppm	ASTM D6304	>2000	<b>0</b>	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>▲ 155605</b>	---	---
Particles >6µm	ASTM D7647	>5000	<b>▲ 58749</b>	---	---
Particles >14µm	ASTM D7647	>640	<b>▲ 2006</b>	---	---
Particles >21µm	ASTM D7647	>160	<b>▲ 357</b>	---	---
Particles >38µm	ASTM D7647	>40	<b>10</b>	---	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>▲ 24/23/18</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.19</b>	---

# OIL ANALYSIS REPORT

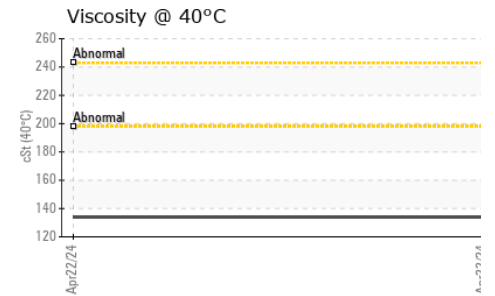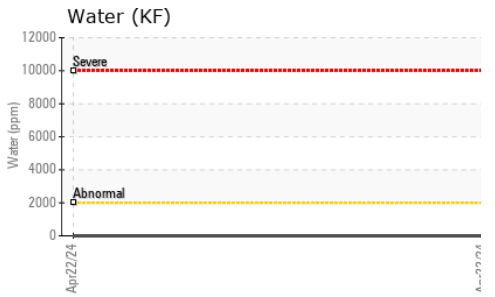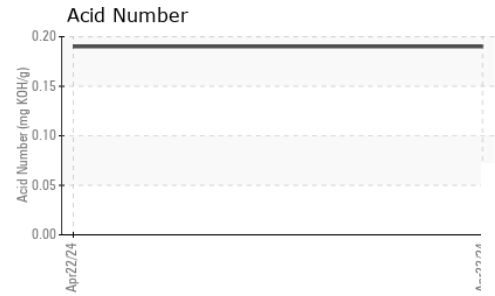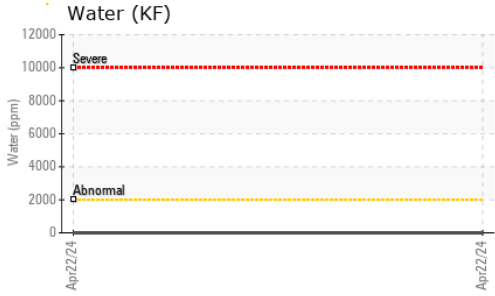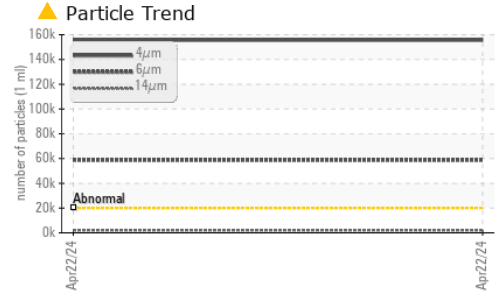





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	134	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

### GRAPHS

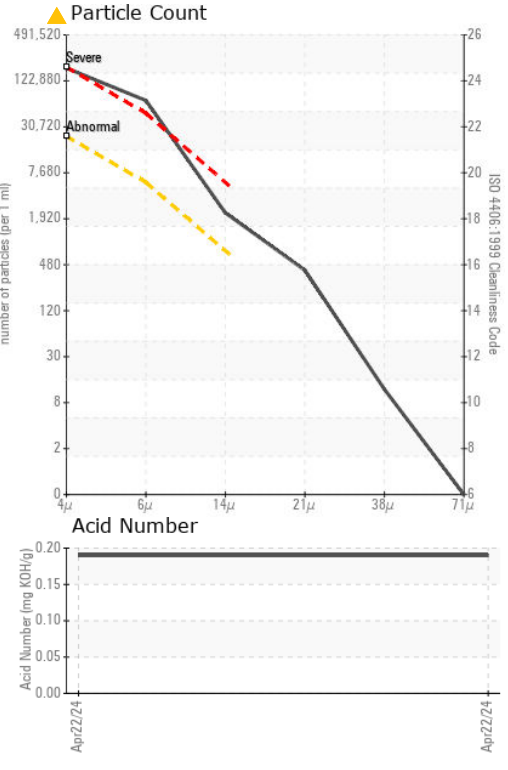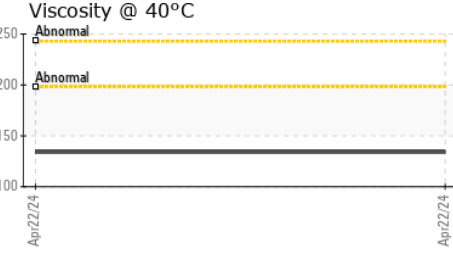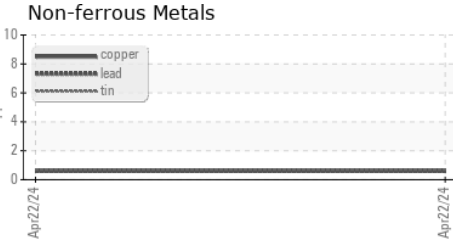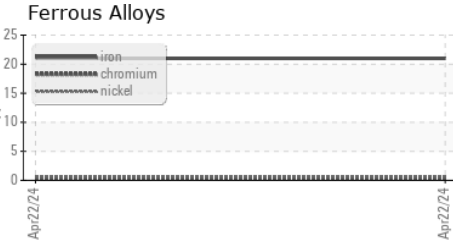

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06156992      **Received** : 22 Apr 2024  
**Lab Number** : 06156992      **Tested** : 23 Apr 2024  
**Unique Number** : 10992415      **Diagnosed** : 25 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CORROSION PRODUCTS & EQUIPMENT INC**  
 110 ELMGROVE PARK  
 ROCHESTER, NY  
 US 14624  
 Contact: Bill Cox  
 cox@corrosion-products.com  
 T: (585)455-7978  
 F: (585)247-7268

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)