


OIL ANALYSIS REPORT

PG 46 [276261]

ATLAS COPCO 5709 - SCHIELFRING

Component Compressor



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000789		
Sample Date		Client Info		05 Mar 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	0		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		267		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		158		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2


0.081

Acid Number (AN)

mg KOH/g ASTM D8045




OIL ANALYSIS REPORT

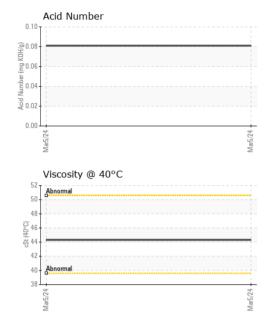






GRAPHS

Bottom









no image





Certificate 12367

Laboratory Sample No.

: UFD0000789 Lab Number : 06157015 Unique Number : 10992438

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 22 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Jonathan Hester

US 60193 Contact: ED DIENER ed.diener@fluidairedynamics.com

FLUID-AIRE DYNAMICS

550 ALBION AVE

T: (847)678-8388

SCHAUMBURG, IL

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCFLUSCH [WUSCAR] 06157015 (Generated: 04/25/2024 08:13:23) Rev: 1

Contact/Location: ED DIENER - UCFLUSCH

no image

no image