


OIL ANALYSIS REPORT

PNEUTECH PG-46 [279162] INGERSOLL RAND CBV208644 - AUTOMATIC

Component



DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000790		
Sample Date		Client Info		04 Mar 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		2		
Phosphorus	ppm	ASTM D5185m		328		
Zinc	ppm	ASTM D5185m		187		
Sulfur	ppm	ASTM D5185m		101		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.40		




OIL ANALYSIS REPORT

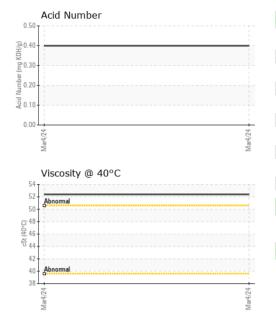





GRAPHS

Bottom









no image

no image





Certificate 12367

Laboratory Sample No. Lab Number : 06157025

Test Package : IND 2

: UFD0000790 Unique Number : 10992448

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 22 Apr 2024 **Tested** Diagnosed

: 23 Apr 2024

: 24 Apr 2024 - Sean Felton

Contact: ED DIENER ed.diener@fluidairedynamics.com

T: (847)678-8388

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

FLUID-AIRE DYNAMICS

550 ALBION AVE

US 60193

SCHAUMBURG, IL