


# **OIL ANALYSIS REPORT**

# **PG** 46 [278076] PNEUTECH AK100014901 - PRECISE DP

Component Compressor





### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000922		
Sample Date		Client Info		20 Feb 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		288		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		121		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
		10T11 D00:-				


0.34

Acid Number (AN)


mg KOH/g ASTM D8045




## **OIL ANALYSIS REPORT**

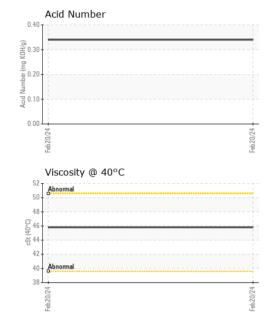



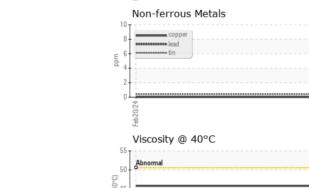







Certificate 12367

Laboratory Sample No.

Lab Number : 06157031

: UFD0000922 Unique Number : 10992454 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 22 Apr 2024 **Tested** : 23 Apr 2024

Diagnosed

: 24 Apr 2024 - Sean Felton

Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

**FLUID-AIRE DYNAMICS** 

550 ALBION AVE

US 60193

SCHAUMBURG, IL

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)