



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Area

[PMOAS3372441]

Machine Id

NFA655G53420

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 40 (--- QTS)

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 40. Please confirm. Please specify the component make and model with your next sample.

### Wear

Metal levels are typical for a new component breaking in.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0035079	---	---
Sample Date	Client Info			19 Apr 2024	---	---
Machine Age	hrs	Client Info		708	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				NORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	---	---
Water	WC Method	>0.2		NEG	---	---
Glycol	WC Method			NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	1	---	---
Chromium	ppm	ASTM D5185m	>20	0	---	---
Nickel	ppm	ASTM D5185m	>4	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>3	0	---	---
Aluminum	ppm	ASTM D5185m	>20	<1	---	---
Lead	ppm	ASTM D5185m	>40	0	---	---
Copper	ppm	ASTM D5185m	>330	3	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	38	---	---
Barium	ppm	ASTM D5185m	10	0	---	---
Molybdenum	ppm	ASTM D5185m	100	9	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m	450	71	---	---
Calcium	ppm	ASTM D5185m	3000	2202	---	---
Phosphorus	ppm	ASTM D5185m	1150	934	---	---
Zinc	ppm	ASTM D5185m	1350	1130	---	---
Sulfur	ppm	ASTM D5185m	4250	4529	---	---




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7	---	---
Sodium	ppm	ASTM D5185m	>216	1	---	---
Potassium	ppm	ASTM D5185m	>20	1	---	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.1	---	---
Nitration	Abs/cm	*ASTM D7624	>20	5.3	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	16.1	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.9	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.1	---	---











# OIL ANALYSIS REPORT

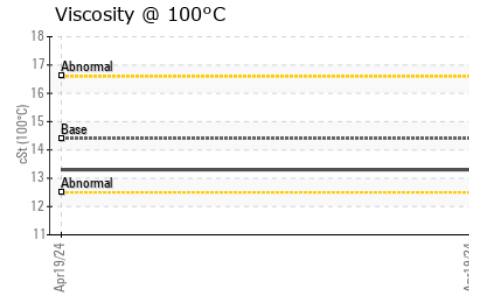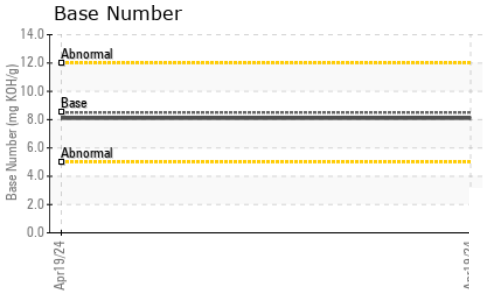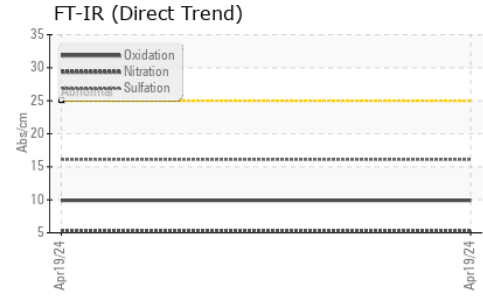

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	---	---
Precipitate	scalar	*Visual	NONE	---	---
Silt	scalar	*Visual	NONE	---	---
Debris	scalar	*Visual	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	---	---
Appearance	scalar	*Visual	NORML	---	---
Odor	scalar	*Visual	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	---	---
Free Water	scalar	*Visual	---	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.3	---

## GRAPHS

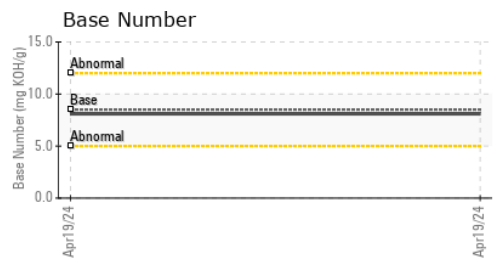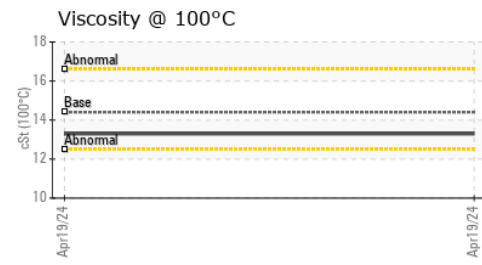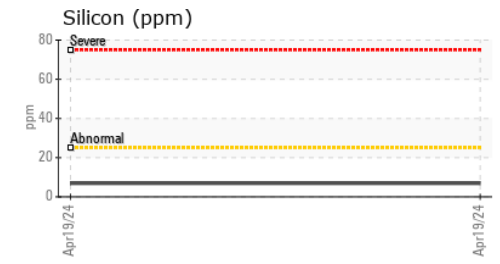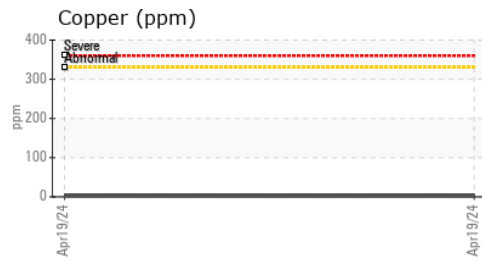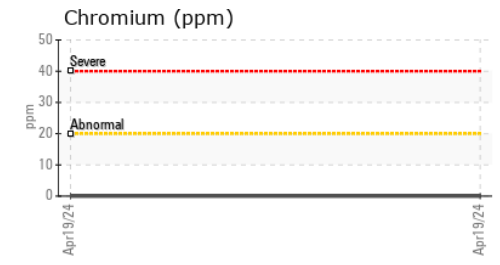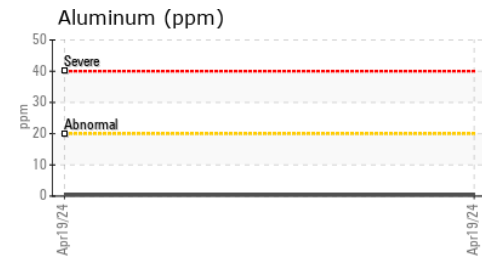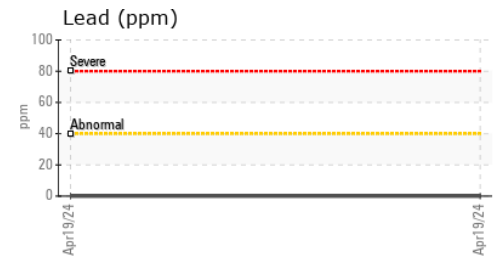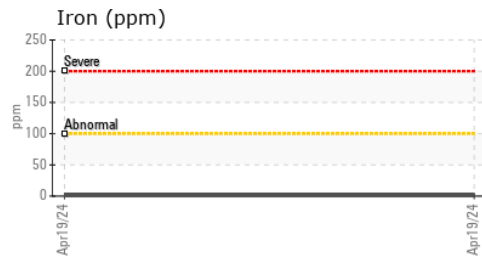

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0035079 **Received** : 23 Apr 2024  
**Lab Number** : 06157484 **Tested** : 24 Apr 2024  
**Unique Number** : 10992907 **Diagnosed** : 24 Apr 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227