




OIL ANALYSIS REPORT

Sample Rating Trend

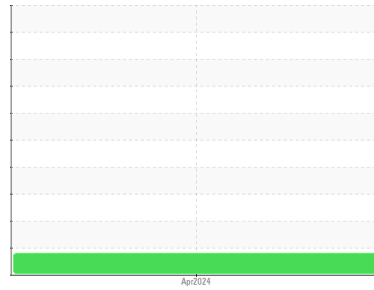

FUEL



Machine Id
6561
 Component
Diesel Engine
 Fluid
 {not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

▲ Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0926832	---	---
Sample Date	Client Info		15 Apr 2024	---	---
Machine Age	hrs	Client Info	9291	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			MARGINAL	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	37	---	---
Chromium	ppm	ASTM D5185m >20	<1	---	---
Nickel	ppm	ASTM D5185m >4	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >3	0	---	---
Aluminum	ppm	ASTM D5185m >20	1	---	---
Lead	ppm	ASTM D5185m >40	0	---	---
Copper	ppm	ASTM D5185m >330	<1	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	36	---	---
Barium	ppm	ASTM D5185m	<1	---	---
Molybdenum	ppm	ASTM D5185m	71	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	346	---	---
Calcium	ppm	ASTM D5185m	1612	---	---
Phosphorus	ppm	ASTM D5185m	896	---	---
Zinc	ppm	ASTM D5185m	1111	---	---
Sulfur	ppm	ASTM D5185m	3350	---	---





CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	6	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---
Fuel	%	ASTM D3524 >5	▲ 2.1	---	---

INFRA-RED	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	1.2	---	---
Nitration	Abs/cm	*ASTM D7624 >20	10.1	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	25.8	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	24.5	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	4.8	---	---







OIL ANALYSIS REPORT

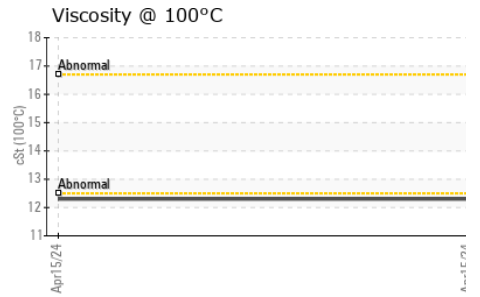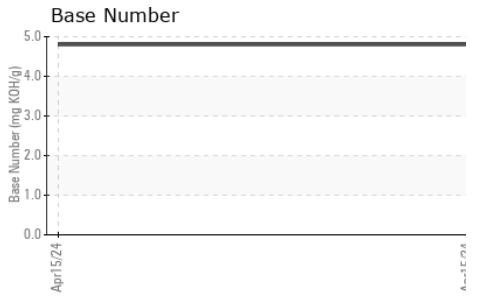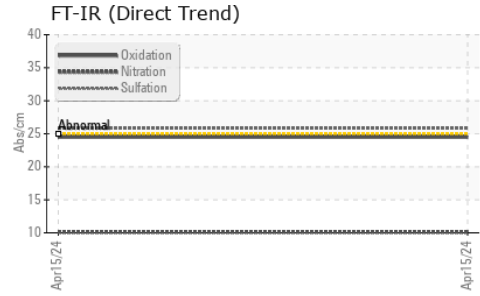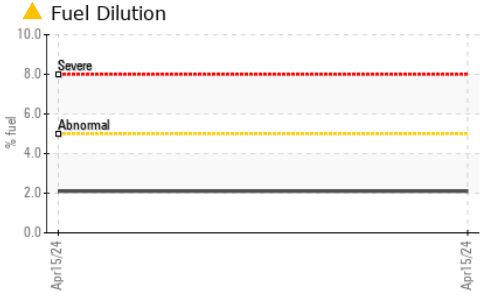

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.3	---	---

GRAPHS

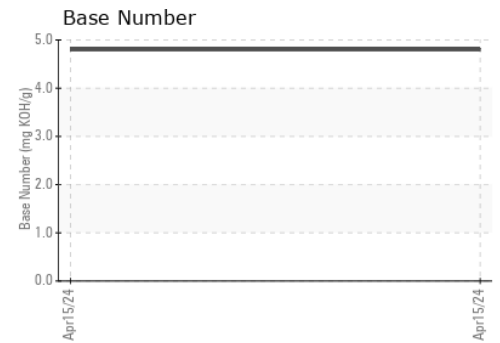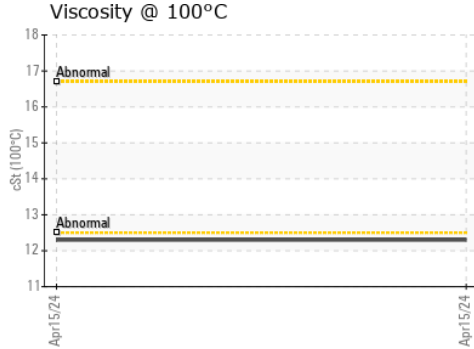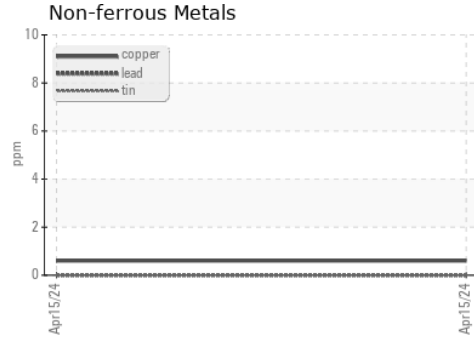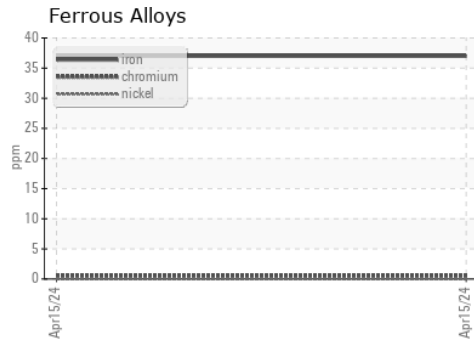

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0926832 **Received** : 23 Apr 2024
Lab Number : 06157511 **Tested** : 25 Apr 2024
Unique Number : 10992934 **Diagnosed** : 25 Apr 2024 - Wes Davis
Test Package : FLEET (Additional Tests: FuelDilution, PercentFuel)

FLORIDA POWER & LIGHT
 2457 PORT WEST BLVD
 RIVIERA BEACH, FL
 US 33407
 Contact: ALEX MECKEL
 alex.meckel@fpl.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: