

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id

KAESER SFC 75S 5957079 (S/N 3684)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Ν		

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr2023	3 Oct2023	Jan 2024 A	pr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130143	KC126531	KC121476
Sample Date		Client Info		16 Apr 2024	08 Jan 2024	02 Oct 2023
Machine Age	hrs	Client Info		57891	55530	53196
Oil Age	hrs	Client Info		2300	0	0
Oil Changed		Client Info		Not Changd	N/A	N/A
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	2	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm		>50	2	8	11
Tin	ppm		>10	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	9	<1	2
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	37	6
Zinc	ppm	ASTM D5185m		15	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	4	3
Sodium	ppm	ASTM D5185m		2	2	4
Potassium	ppm	ASTM D5185m	>20	2	<1	<1
Water	%	ASTM D6304	>0.05	0.009	0.010	△ 0.332
ppm Water	ppm	ASTM D6304	>500	90	102	▲ 3320
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5409	2436	
Particles >6µm		ASTM D7647	>1300	1146	763	
Particles >14μm		ASTM D7647	>80	76	114	
Particles >21µm		ASTM D7647	>20	20	44	
Particles >38μm		ASTM D7647	>4	0	3	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/17/13	18/17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A		AOTAA DOO 45	0.4	0.40	0.00	0.00

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.38

0.46

0.38



OIL ANALYSIS REPORT

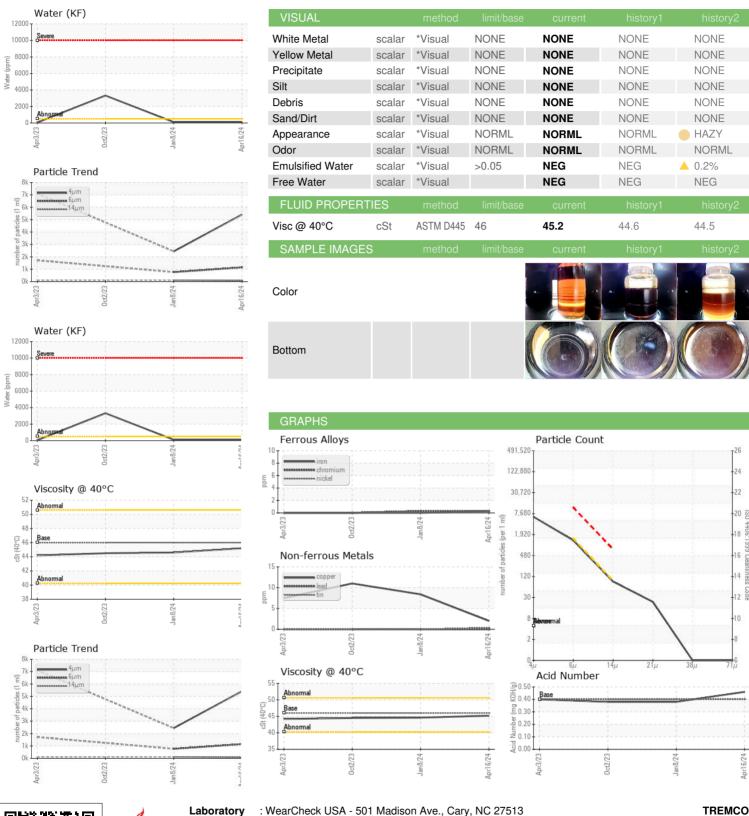





Certificate 12367

Laboratory Sample No. Lab Number

: 06157708 Unique Number : 10993131

: KC130143 Test Package : IND 2

Received : 23 Apr 2024 **Tested** : 24 Apr 2024

Diagnosed : 25 Apr 2024 - Don Baldridge

US 44127 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F:

3361 E 80TH ST

CLEVELAND, OH