




OIL ANALYSIS REPORT

Sample Rating Trend

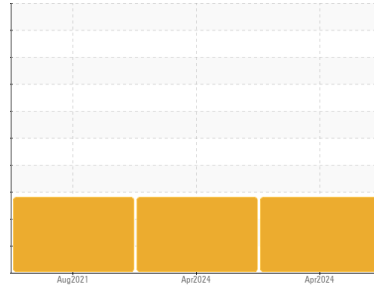

WATER



Machine Id
OAKWOOD VILLAGE EAST COM CTR C-2A CIRC 2 (S/N U18C00508)
 Component
Refrigeration Compressor
 Fluid
TRANE 0048 (--- GAL)

DIAGNOSIS

● Recommendation

The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil.

● Fluid Condition

The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0730389	WC0709604	WC0340242
Sample Date	Client Info			12 Apr 2024	10 Apr 2024	19 Aug 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ATTENTION	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	<1	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	2
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	5	2	<1
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<1	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0	0
Magnesium	ppm	ASTM D5185m	0	2	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	5	2	0	0
Zinc	ppm	ASTM D5185m	0	23	6	0
Sulfur	ppm	ASTM D5185m	10	0	0	565

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4	3	0
Sodium	ppm	ASTM D5185m		0	0	26
Potassium	ppm	ASTM D5185m	>20	2	0	3
Water	%	ASTM D6304	>0.01	▲ 0.038	▲ 0.039	▲ 0.088
ppm Water	ppm	ASTM D6304	>100	▲ 382	▲ 400	▲ 884.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.09	● 0.219	● 0.194	▲ 0.16




OIL ANALYSIS REPORT

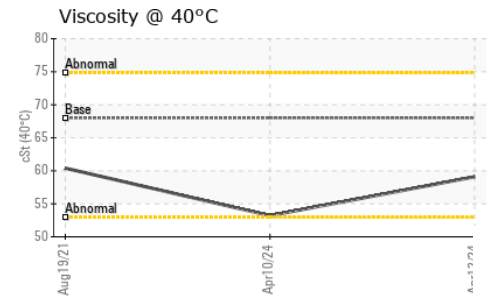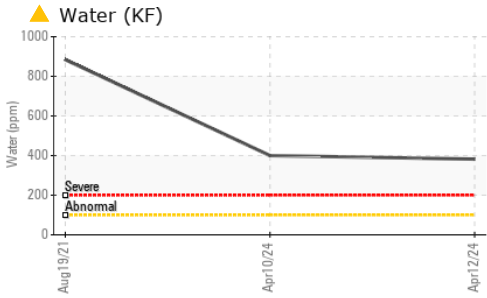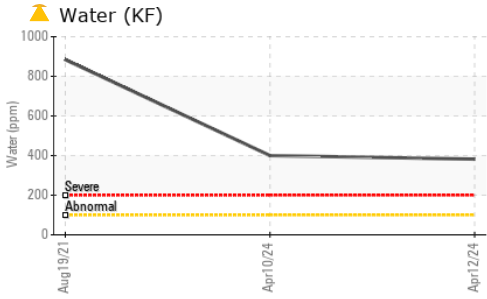





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	59.1	53.2	60.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

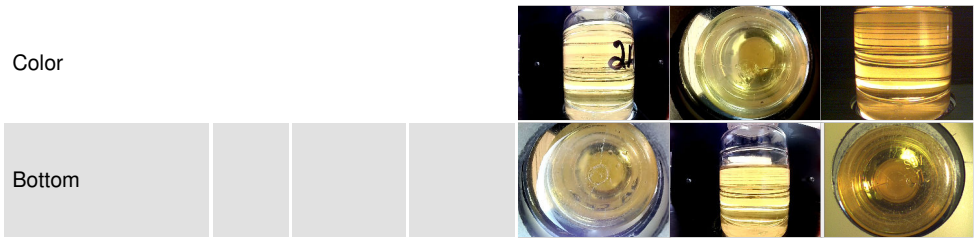

GRAPHS

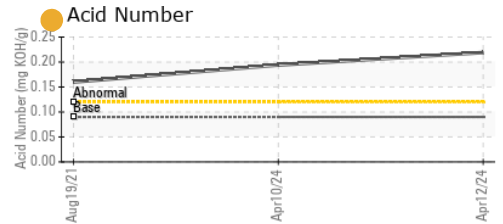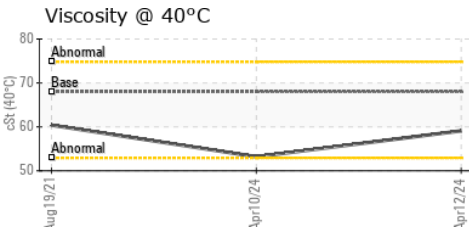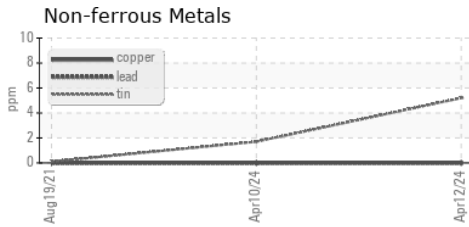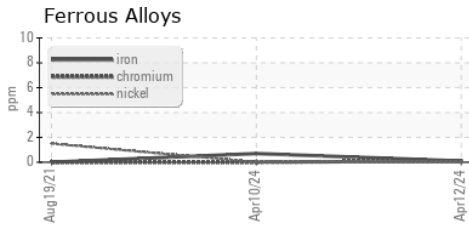

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0730389 **Received** : 23 Apr 2024
Lab Number : **06157740** **Tested** : 24 Apr 2024
Unique Number : 10993163 **Diagnosed** : 25 Apr 2024 - Jonathan Hester
Test Package : IND 2

NORTH AMERICAN MECHANICAL
 4401 STATE RD 19
 WINDSOR, WI
 US 53598
 Contact: STACEY QUAM
 squam@naminc.com
 T: (608)240-8906
 F: (608)240-8965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)