




# OIL ANALYSIS REPORT

Sample Rating Trend

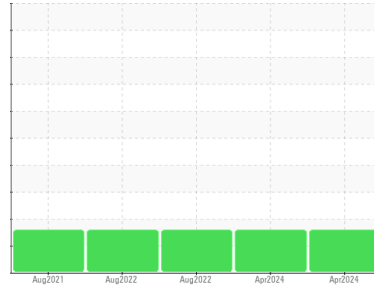

**WATER**



Machine Id  
**OAKWOOD VILLAGE EAST COM CTR C-2B CIRC 1 (S/N U18C00508)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**TRANE 0048 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a trace of moisture present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0730390</b>	WC0709606	WC0578152
Sample Date	Client Info		<b>15 Apr 2024</b>	10 Apr 2024	18 Aug 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>MARGINAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	2
Tin	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1	<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>2</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 5	<b>2</b>	0	4
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 10	<b>0</b>	0	2

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	2	4
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>▲ 0.038</b>	▲ 0.051	▲ 0.098
ppm Water	ppm	ASTM D6304 >100	<b>▲ 384</b>	▲ 516	▲ 989.2

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.09	<b>0.042</b>	0.047	0.087




# OIL ANALYSIS REPORT

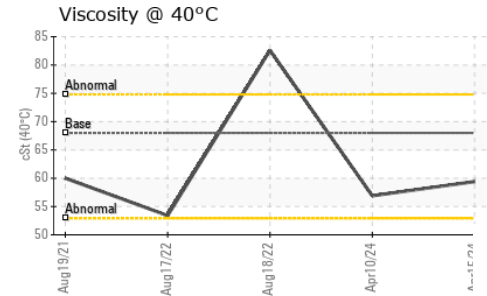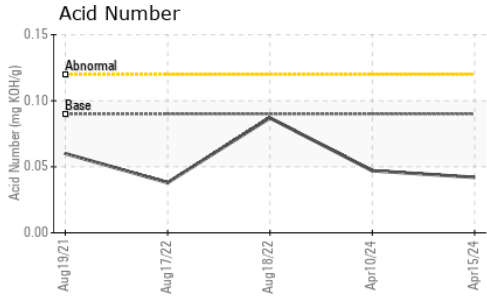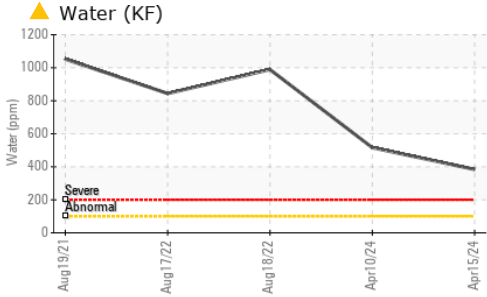





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>59.4</b>	56.9	82.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

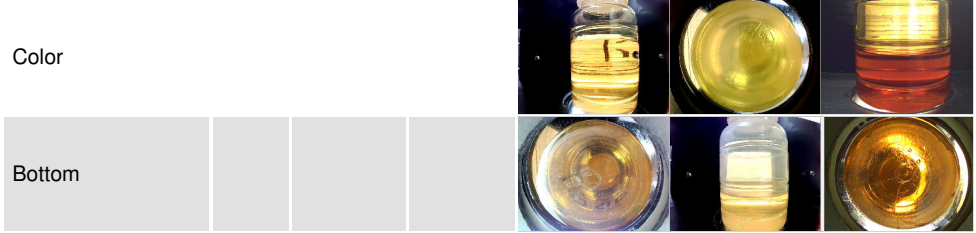

## GRAPHS

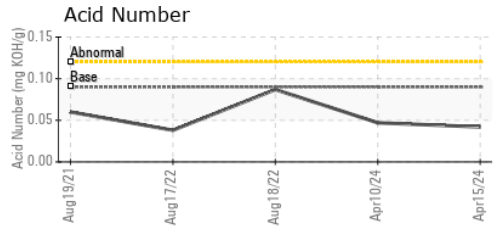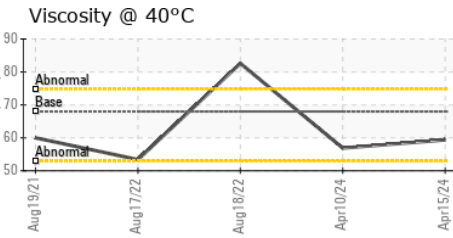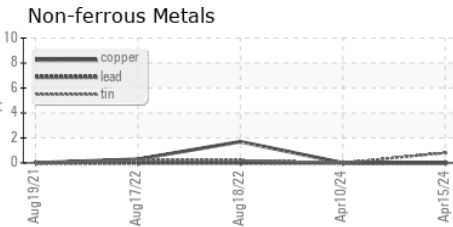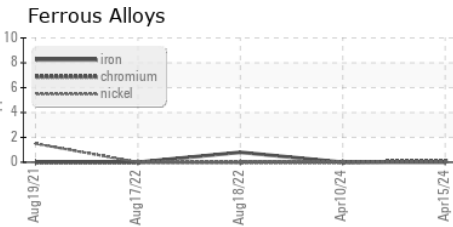

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0730390      **Received** : 23 Apr 2024  
**Lab Number** : **06157743**      **Tested** : 24 Apr 2024  
**Unique Number** : 10993166      **Diagnosed** : 25 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2

**NORTH AMERICAN MECHANICAL**  
 4401 STATE RD 19  
 WINDSOR, WI  
 US 53598  
 Contact: STACEY QUAM  
 squam@naminc.com  
 T: (608)240-8906  
 F: (608)240-8965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)