




OIL ANALYSIS REPORT

Sample Rating Trend

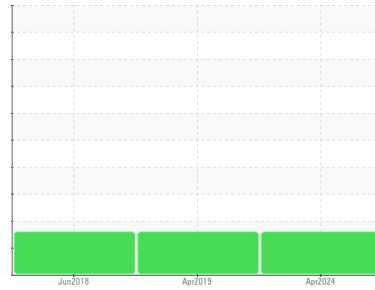

WATER



Machine Id
COPELAND FORT HEALTHCARE CH 1 CIRC 1 (S/N STNU0712000183)
 Component
Refrigeration Compressor
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0730386	WCI2334357	WCI2315668
Sample Date	Client Info		15 Apr 2024	10 Apr 2019	11 Jun 2018
Machine Age	yrs	Client Info	0	8	7
Oil Age	yrs	Client Info	0	8	7
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			MARGINAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	1	<1
Chromium	ppm	ASTM D5185m >2	<1	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	<1	0	0
Lead	ppm	ASTM D5185m >2	0	1	<1
Copper	ppm	ASTM D5185m >8	0	<1	0
Tin	ppm	ASTM D5185m >4	<1	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	2	<1	0
Calcium	ppm	ASTM D5185m	0	0	<1
Phosphorus	ppm	ASTM D5185m	119	2	1
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	0	0	0

CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	2	6
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	1	0	0
Water	%	ASTM D6304 >0.01	▲ 0.048	▲ 0.063	▲ 0.068
ppm Water	ppm	ASTM D6304 >100	▲ 486	▲ 630	▲ 680

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.028	0.015	0.015




OIL ANALYSIS REPORT

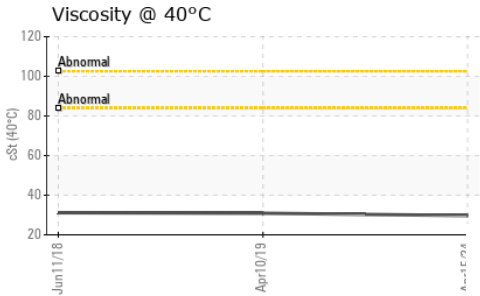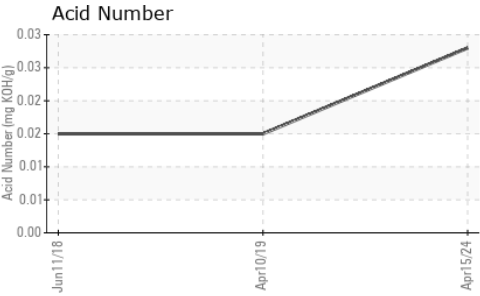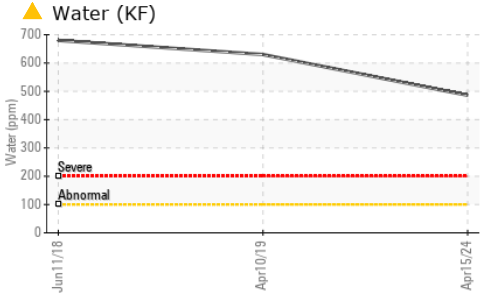





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	29.7	30.9	31.16

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

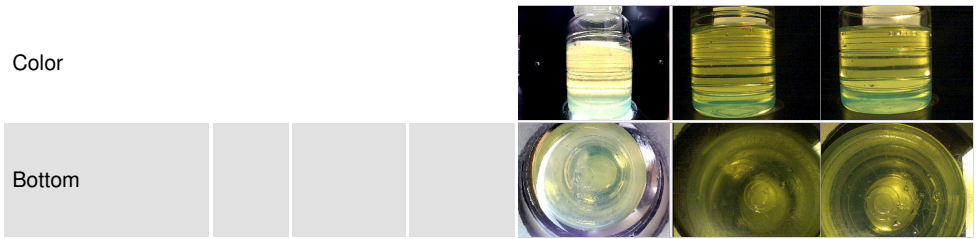

GRAPHS

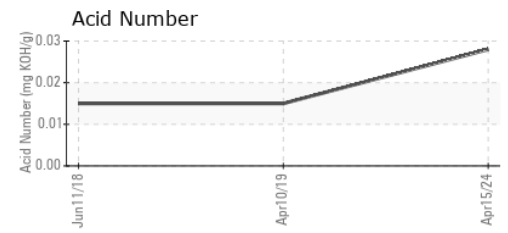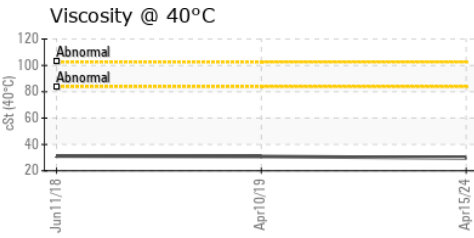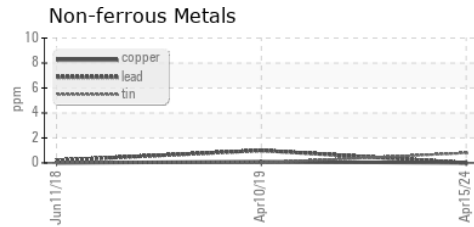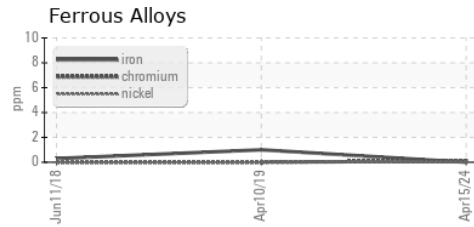

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0730386
Lab Number : 06157746
Unique Number : 10993169
Test Package : IND 2
Received : 23 Apr 2024
Tested : 24 Apr 2024
Diagnosed : 25 Apr 2024 - Jonathan Hester

NORTH AMERICAN MECHANICAL
 4401 STATE RD 19
 WINDSOR, WI
 US 53598
 Contact: STACEY QUAM
 squam@naminc.com
 T: (608)240-8906
 F: (608)240-8965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)