


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

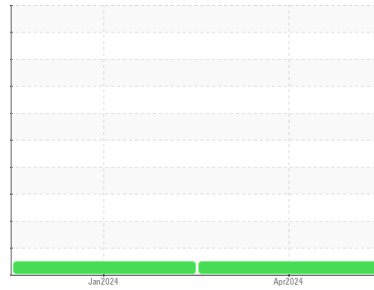

Area

**NOT GIVEN**

Machine Id

**SULLIVAN PALATEK 22ME003603 - JJE PALMETTO STATE ARMORY**

Component

**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS06157787</b>	UCS06089599	---
Sample Date	Client Info			<b>08 Apr 2024</b>	30 Jan 2024	---
Machine Age	hrs	Client Info		<b>17</b>	3	---
Oil Age	hrs	Client Info		<b>17</b>	2	---
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	1	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	1	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>650</b>	595	---
Zinc	ppm	ASTM D5185m		<b>0</b>	10	---
Sulfur	ppm	ASTM D5185m		<b>1532</b>	1419	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.133</b>	0.055	---


# OIL ANALYSIS REPORT

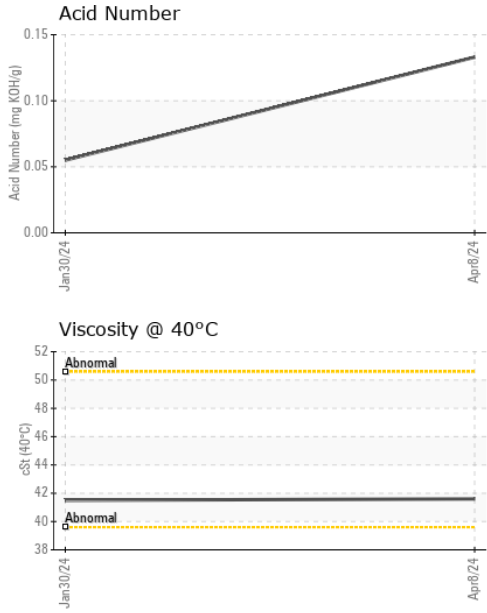





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>41.6</b>	41.5	---

SAMPLE IMAGES

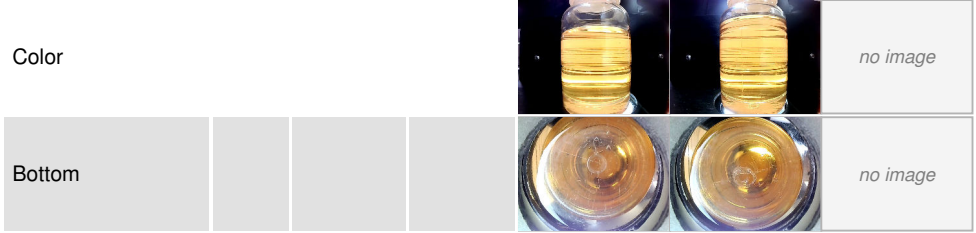

GRAPHS

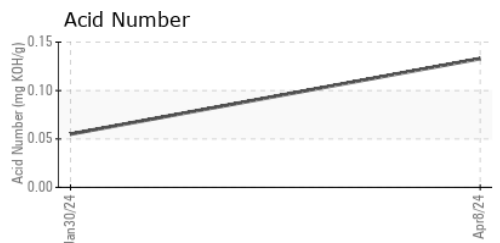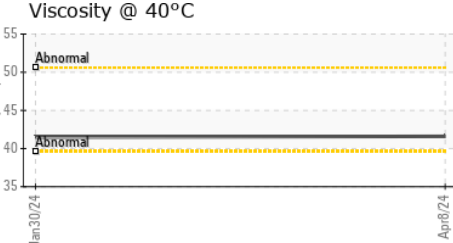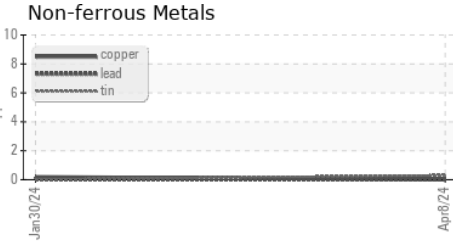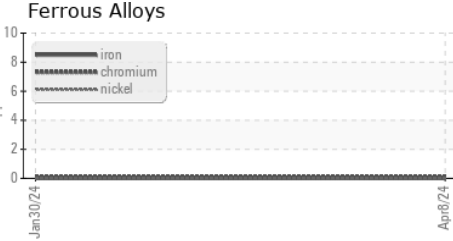

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06157787      **Received** : 23 Apr 2024  
**Lab Number** : **06157787**      **Tested** : 24 Apr 2024  
**Unique Number** : 10993210      **Diagnosed** : 25 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**AIR COMPRESSOR SERVICES**  
 GREENVILLE, SC  
 US 29609  
 Contact: SCOTT  
 scott@aircompressorservices.com  
 T: (877)592-9892  
 F: