




OIL ANALYSIS REPORT

Sample Rating Trend

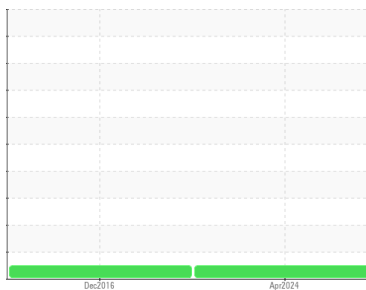

NORMAL



Area

SYNOIL 8K

Machine Id

GARDNER DENVER EBMQLA M65259 - SERIGRAPH

Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCZ06157792	UCZ04125120	---
Sample Date	Client Info			15 Apr 2024	08 Dec 2016	---
Machine Age	hrs	Client Info		118840	88321	---
Oil Age	hrs	Client Info		4700	4200	---
Oil Changed	Client Info			Changed	Not Changd	---
Sample Status				NORMAL	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>5	<1	0	---
Nickel	ppm	ASTM D5185m		0	<1	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>15	0	<1	---
Lead	ppm	ASTM D5185m	>65	0	<1	---
Copper	ppm	ASTM D5185m	>65	0	<1	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.3	0	<1	---
Barium	ppm	ASTM D5185m	0.3	1	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0.9	0	0	---
Magnesium	ppm	ASTM D5185m	0.2	0	0	---
Calcium	ppm	ASTM D5185m	0.1	0	<1	---
Phosphorus	ppm	ASTM D5185m	429	279	336	---
Zinc	ppm	ASTM D5185m	0.3	67	37	---
Sulfur	ppm	ASTM D5185m	1336	392	1043	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	6	20	---
Sodium	ppm	ASTM D5185m		2	5	---
Potassium	ppm	ASTM D5185m	>20	<1	4	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	0.38	0.174	---




OIL ANALYSIS REPORT

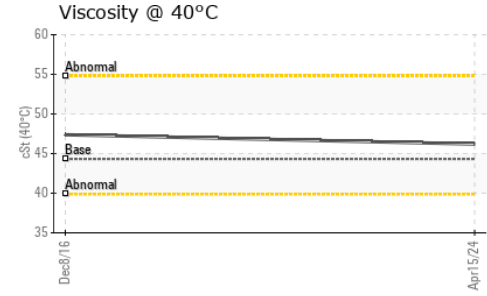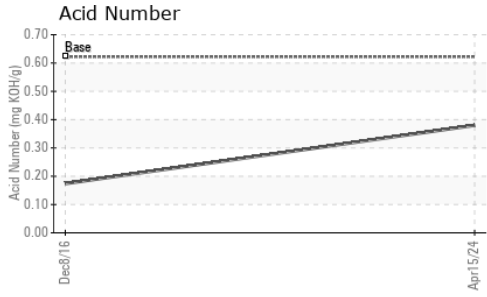





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.32	46.2	47.38	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

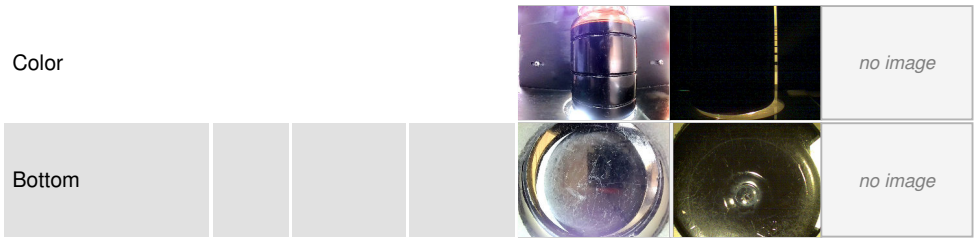

GRAPHS

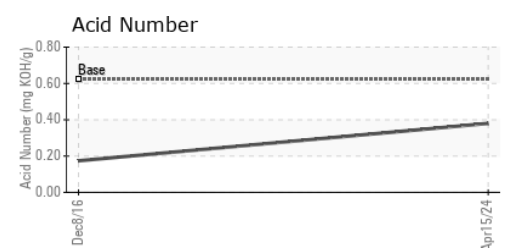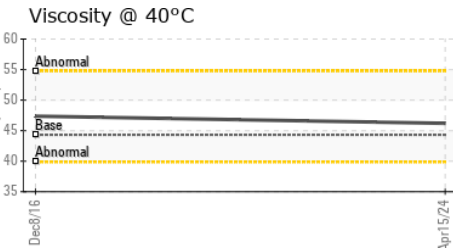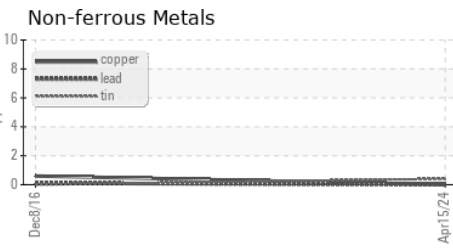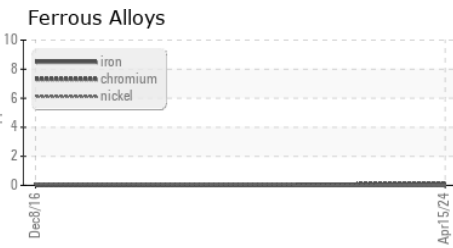

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ06157792 **Received** : 23 Apr 2024
Lab Number : **06157792** **Tested** : 24 Apr 2024
Unique Number : 10993215 **Diagnosed** : 25 Apr 2024 - Sean Felton
Test Package : IND 2

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: AARON LANE
 aaron.lane@zornair.com
 T: (800)476-4637
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)