

# **OIL ANALYSIS REPORT**

Sample Rating Trend

## NORMAL



# NOT GIVEN INGERSOLL RAND CBV664585 - MERRICK

Component Compressor

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06157807		
Sample Date		Client Info		23 Apr 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	576		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	5	<1		
Calcium	ppm	ASTM D5185m	10	0		
Phosphorus	ppm	ASTM D5185m	250	<1		
Zinc	ppm	ASTM D5185m	100	2		
Sulfur	ppm	ASTM D5185m	400	275		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		16		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)


mg KOH/g ASTM D8045

0.058



# **OIL ANALYSIS REPORT**

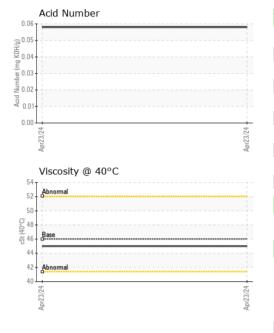

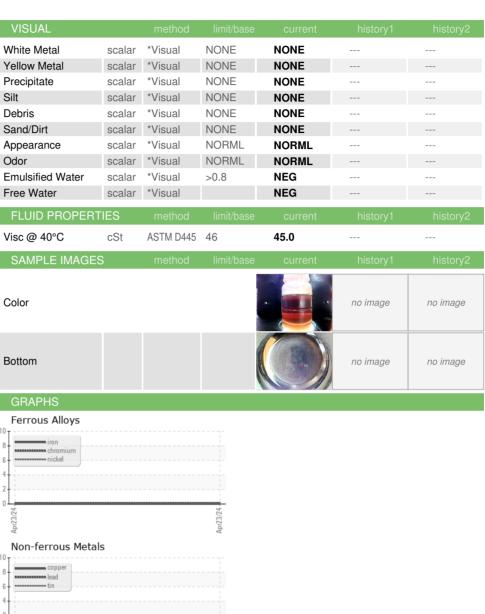





Laboratory

Sample No. Lab Number : 06157807

: UCH06157807 Unique Number : 10993230

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 23 Apr 2024 **Tested** : 24 Apr 2024

Diagnosed : 25 Apr 2024 - Don Baldridge

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Viscosity @ 40°C

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CISCO AIR SYSTEMS** 

214 27TH ST SACRAMENTO, CA US 95816

Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com

T: (916)444-2525 F: x:

Contact/Location: BARRY FRKOVICH - UCCISSAC

Acid Number

皇 0.02 Acid